




# OIL ANALYSIS REPORT

Sample Rating Trend

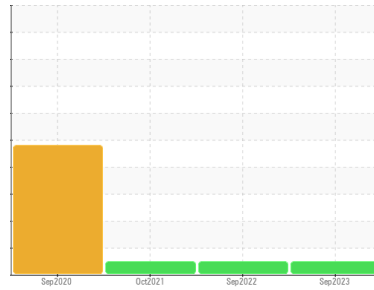

**NORMAL**



Machine Id  
**PTU-3 - M2-0415**

Component  
**Gearbox**  
Fluid  
**GULF EP 100 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.  
NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

### Wear

All component wear rates are normal.

### Contamination

The water content is negligible. There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>RP0038779</b>	RP0030012	RP0022494
Sample Date	Client Info			<b>06 Sep 2023</b>	09 Sep 2022	05 Oct 2021
Machine Age	hrs	Client Info		<b>0</b>	0	0
Oil Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>N/A</b>	Not Chngd	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL




WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>200	<b>34</b>	33	25
Chromium	ppm	ASTM D5185m	>15	<b>0</b>	<1	<1
Nickel	ppm	ASTM D5185m	>15	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>0</b>	0	<1
Silver	ppm	ASTM D5185m		<b>0</b>	<1	<1
Aluminum	ppm	ASTM D5185m	>25	<b>0</b>	<1	1
Lead	ppm	ASTM D5185m	>100	<b>0</b>	<1	<1
Copper	ppm	ASTM D5185m	>200	<b>0</b>	<1	<1
Tin	ppm	ASTM D5185m	>25	<b>0</b>	<1	<1
Antimony	ppm	ASTM D5185m	>5	<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	<1

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>10</b>	11	13
Barium	ppm	ASTM D5185m		<b>0</b>	<1	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	<1	<1
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m		<b>0</b>	2	2
Calcium	ppm	ASTM D5185m		<b>16</b>	17	17
Phosphorus	ppm	ASTM D5185m		<b>174</b>	188	176
Zinc	ppm	ASTM D5185m		<b>0</b>	6	2

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	<b>&lt;1</b>	1	<1
Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	1	1
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	0
Water	%	ASTM D6304	>0.2	<b>0.001</b>	0.008	0.005
ppm Water	ppm	ASTM D6304	>2000	<b>14.2</b>	84.3	52.0

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.31</b>	0.50	0.462


# OIL ANALYSIS REPORT

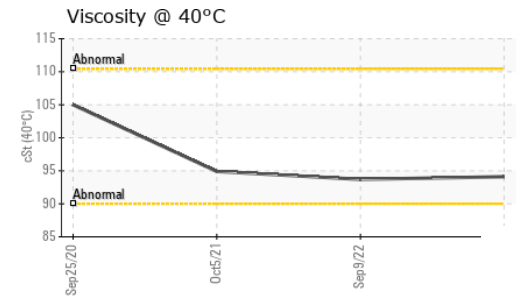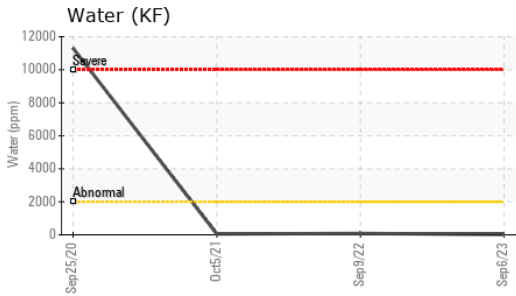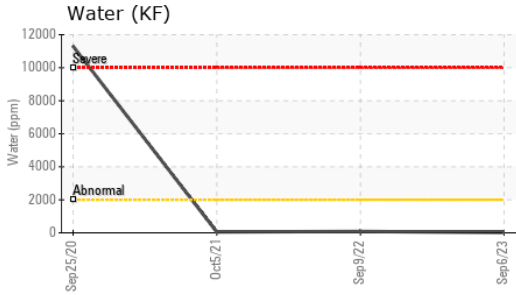





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	94.1	93.7	94.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

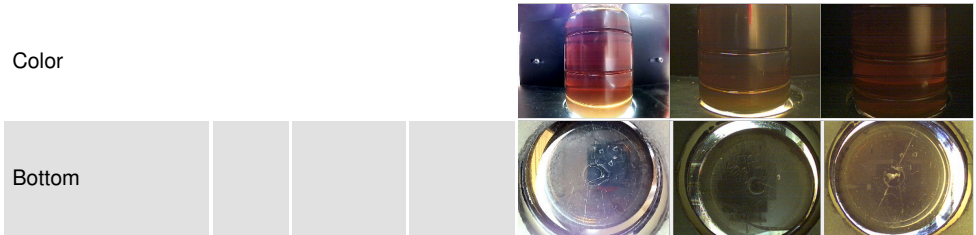

## GRAPHS

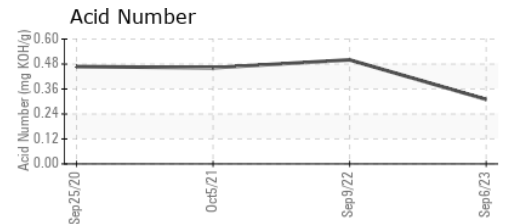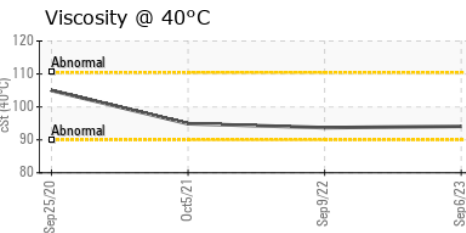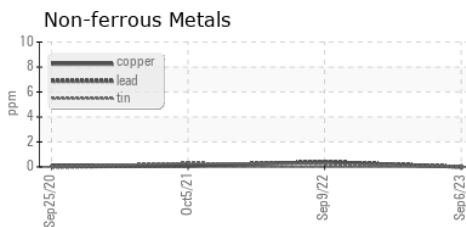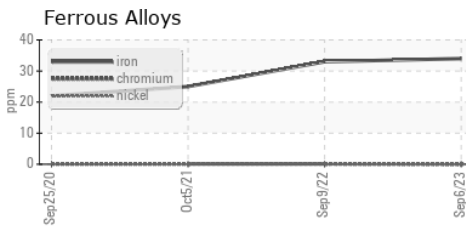

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : RP0038779 **Received** : 28 Sep 2023  
**Lab Number** : 05964244 **Diagnosed** : 29 Sep 2023  
**Unique Number** : 10670795 **Diagnostician** : Wes Davis  
**Test Package** : IND 2

**VEOLIA WATER**  
 1 NEW BOSTON RD EXTENSION  
 STURBRIDGE, MA  
 US 01566  
 Contact: WAYNE JOHNSON  
 WAYNE.JOHNSON2@VEOLIA.COM  
 T: (508)347-2514  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)