




# OIL ANALYSIS REPORT



Area  
**IRIG [6105975]**  
 Machine Id  
**IRIG-GN-1101 IRIG-GN-1101 GENSET#1**  
 Component  
**Diesel Engine**  
 Fluid  
**CHEVRON DELO 400 MULTIGRADE 15W40 (40 GAL)**

## Sample Rating Trend

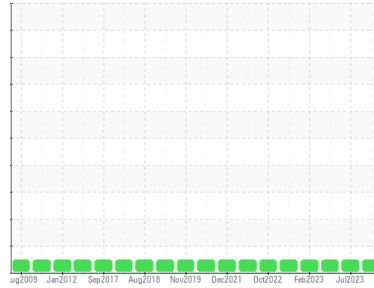

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>HLC0002818</b>	HLC0002742	HLC0002705
Sample Date	Client Info	<b>15 Sep 2023</b>	30 Jul 2023	18 May 2023
Machine Age	hrs Client Info	<b>8030</b>	7531	6615
Oil Age	hrs Client Info	<b>500</b>	500	0
Oil Changed	Client Info	<b>Changed</b>	N/A	N/A
Sample Status		<b>NORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

method	limit/base	current	history1	history2
Fuel	WC Method >5	<b>&lt;1.0</b>	<1.0	<1.0
Glycol	WC Method	<b>NEG</b>	NEG	NEG

## WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >100	<b>28</b>	20	17
Chromium	ppm ASTM D5185m >20	<b>&lt;1</b>	<1	<1
Nickel	ppm ASTM D5185m >2	<b>0</b>	0	<1
Titanium	ppm ASTM D5185m >2	<b>&lt;1</b>	<1	<1
Silver	ppm ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm ASTM D5185m >25	<b>3</b>	<1	0
Lead	ppm ASTM D5185m >40	<b>0</b>	<1	<1
Copper	ppm ASTM D5185m >330	<b>1</b>	1	1
Tin	ppm ASTM D5185m >15	<b>&lt;1</b>	<1	<1
Vanadium	ppm ASTM D5185m	<b>&lt;1</b>	<1	0
Cadmium	ppm ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m 151	<b>67</b>	68	74
Barium	ppm ASTM D5185m 0.4	<b>0</b>	0	0
Molybdenum	ppm ASTM D5185m 250	<b>&lt;1</b>	4	<1
Manganese	ppm ASTM D5185m	<b>&lt;1</b>	<1	<1
Magnesium	ppm ASTM D5185m 0	<b>810</b>	843	720
Calcium	ppm ASTM D5185m 2046	<b>1421</b>	1449	1426
Phosphorus	ppm ASTM D5185m 1043	<b>751</b>	780	709
Zinc	ppm ASTM D5185m 943	<b>876</b>	941	850
Sulfur	ppm ASTM D5185m 5012	<b>3196</b>	3955	3032

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >25	<b>4</b>	5	3
Sodium	ppm ASTM D5185m	<b>3</b>	38	0
Potassium	ppm ASTM D5185m >20	<b>1</b>	5	4



## INFRA-RED

method	limit/base	current	history1	history2
Soot %	% *ASTM D7844 >3	<b>0.5</b>	0.4	0.3
Nitration	Abs/cm *ASTM D7624 >20	<b>9.1</b>	9.3	9.5
Sulfation	Abs.1mm *ASTM D7415 >30	<b>19.6</b>	19.4	19.9

## FLUID DEGRADATION

method	limit/base	current	history1	history2
Oxidation	Abs.1mm *ASTM D7414 >25	<b>14.6</b>	13.9	15.0
Base Number (BN)	mg KOH/g ASTM D2896 12.5	<b>8.73</b>	10.00	10.75





# OIL ANALYSIS REPORT

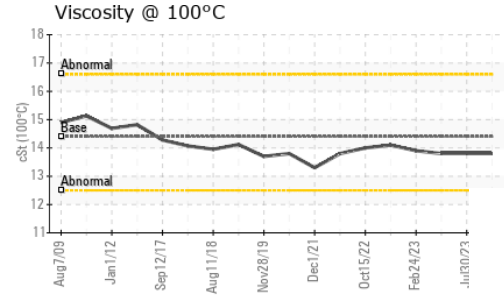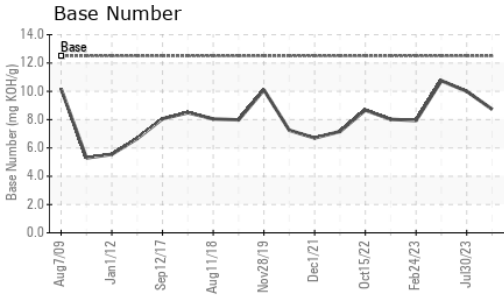

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D445	14.4	<b>13.8</b>	13.8	13.8

## GRAPHS

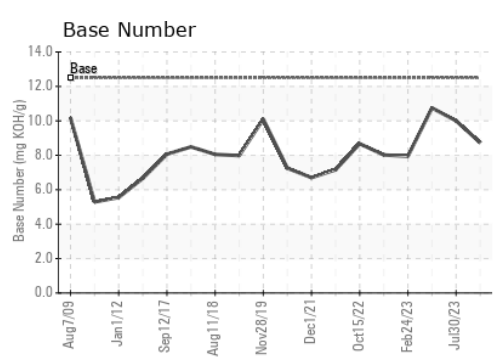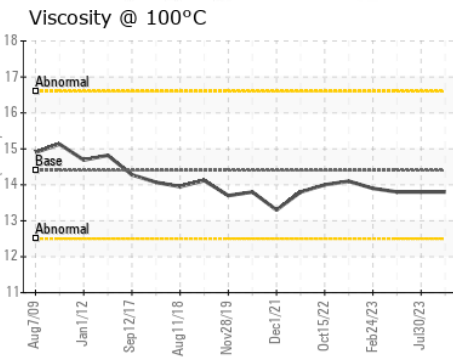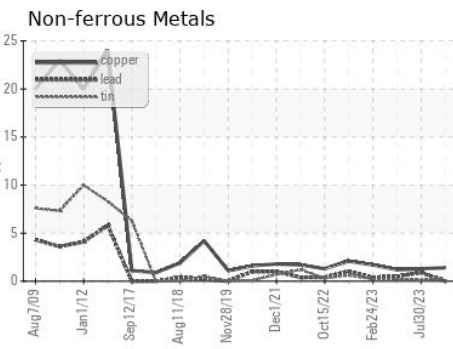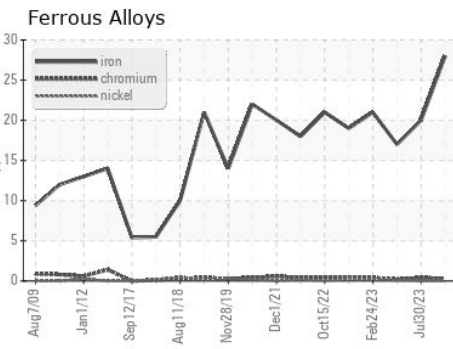

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : HLC0002818 **Received** : 28 Sep 2023  
**Lab Number** : **05964307** **Diagnosed** : 03 Oct 2023  
**Unique Number** : 10670858 **Diagnostician** : Jonathan Hester  
**Test Package** : IND 2

**HILCORP EXPLORATION ALASKA - MILNE POINT**  
 1000 MILNE POINT RD  
 PRUDOE BAY, AK  
 US 99734  
 Contact: Evan Reilly  
 evan.reilly@hilcorp.com  
 T: (907)670-3231  
 F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)