




# PROBLEM SUMMARY

## Sample Rating Trend


ISO

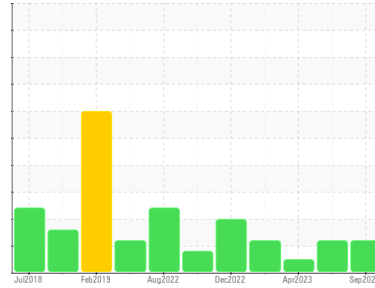

Area  
**GP-105 [23508020]**  
 Machine Id  
**B40426 - PUMP VACUUM BUSCH RAU250 LINE 2 FORMING PUMP (S/N D13965)**  
 Component  
**Pump**  
 Fluid  
**PETRO CANADA PURITY FG HYD AW 100 (5 GAL)**

## COMPONENT CONDITION SUMMARY

### ▲ Particle Trend

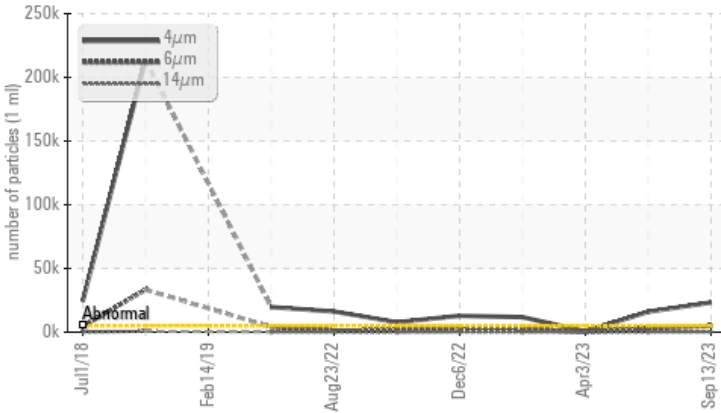

## RECOMMENDATION

No corrective action is recommended at this time.  
 Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ABNORMAL	NORMAL
Particles >4µm	ASTM D7647	>5000	▲ 23276	▲ 16022	658
Particles >6µm	ASTM D7647	>1300	▲ 4854	▲ 2993	158
Oil Cleanliness	ISO 4406 (c)	>19/17/14	▲ 22/19/14	▲ 21/19/14	17/14/11

Customer Id: HORAUS  
 Sample No.: WC0842482  
 Lab Number: 05964577  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Don Baldrige +1  
[don.b505@comcast.net](mailto:don.b505@comcast.net)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

*There are no recommended actions for this sample.*

## HISTORICAL DIAGNOSIS

### 19 Jul 2023 Diag: Don Baldrige

ISO



No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 03 Apr 2023 Diag: Angela Borella

NORMAL



No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 03 Feb 2023 Diag: Jonathan Hester

ISO



No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





# OIL ANALYSIS REPORT

Sample Rating Trend

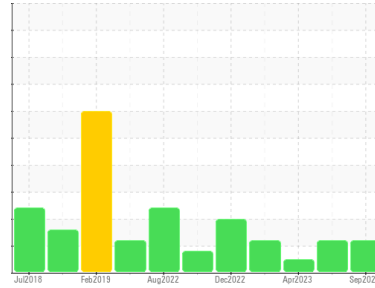

ISO



Area  
**GP-105 [23508020]**  
 Machine Id  
**B40426 - PUMP VACUUM BUSCH RAU250 LINE 2 FORMING PUMP (S/N D13965)**  
 Component  
**Pump**  
 Fluid  
**PETRO CANADA PURITY FG HYD AW 100 (5 GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0842482</b>	WC0826110	WC0781453
Sample Date	Client Info		<b>13 Sep 2023</b>	19 Jul 2023	03 Apr 2023
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>Not Chngd</b>	N/A	N/A
Sample Status			<b>ABNORMAL</b>	ABNORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >90	<b>3</b>	3	0
Chromium	ppm	ASTM D5185m >5	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >5	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >3	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >7	<b>0</b>	0	0
Lead	ppm	ASTM D5185m >12	<b>0</b>	<1	0
Copper	ppm	ASTM D5185m >30	<b>0</b>	<1	0
Tin	ppm	ASTM D5185m >9	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	2	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m	<b>3</b>	<1	0
Calcium	ppm	ASTM D5185m	<b>3</b>	1	0
Phosphorus	ppm	ASTM D5185m	<b>107</b>	28	15
Zinc	ppm	ASTM D5185m	<b>5</b>	0	2
Sulfur	ppm	ASTM D5185m	<b>280</b>	72	0

## CONTAMINANTS





	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >60	<b>11</b>	13	<1
Sodium	ppm	ASTM D5185m	<b>2</b>	0	0
Potassium	ppm	ASTM D5185m >20	<b>2</b>	2	<1

## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	<b>▲ 23276</b>	▲ 16022	658
Particles >6µm	ASTM D7647	>1300	<b>▲ 4854</b>	▲ 2993	158
Particles >14µm	ASTM D7647	>160	<b>121</b>	94	16
Particles >21µm	ASTM D7647	>40	<b>18</b>	21	4
Particles >38µm	ASTM D7647	>10	<b>1</b>	2	0
Particles >71µm	ASTM D7647	>3	<b>0</b>	1	0
Oil Cleanliness	ISO 4406 (c)	>19/17/14	<b>▲ 22/19/14</b>	▲ 21/19/14	17/14/11

## FLUID DEGRADATION


	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.27	<b>0.089</b>	0.073	0.22

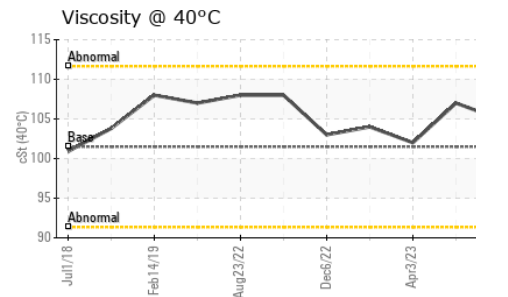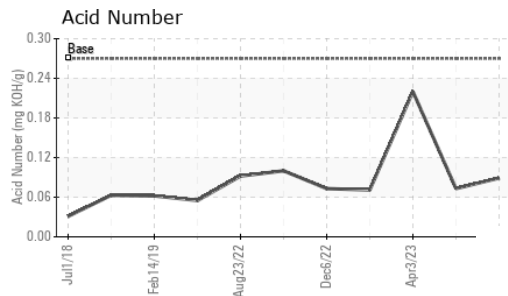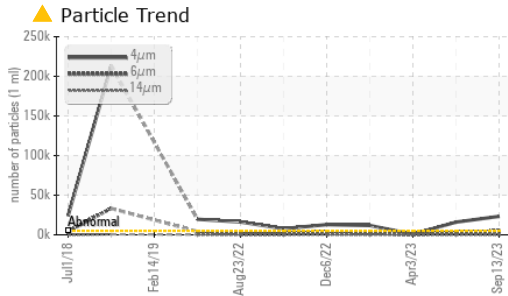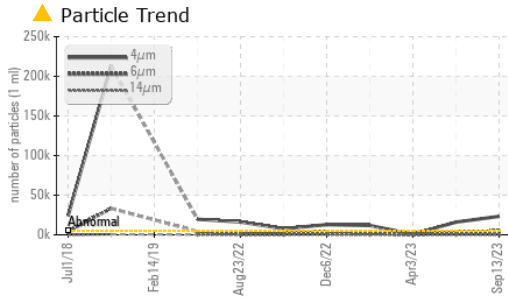






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	101.5	105	107

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

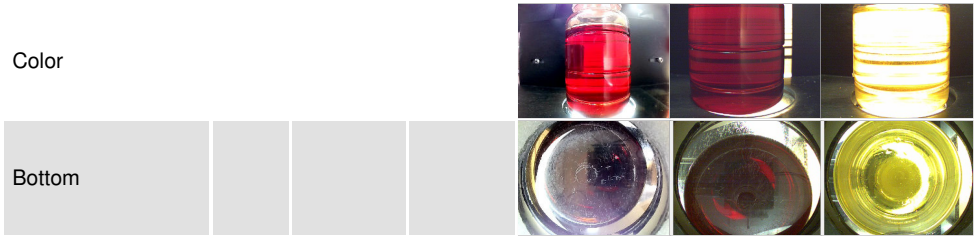

## GRAPHS

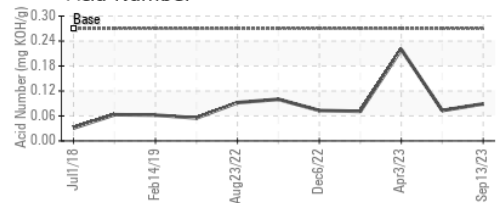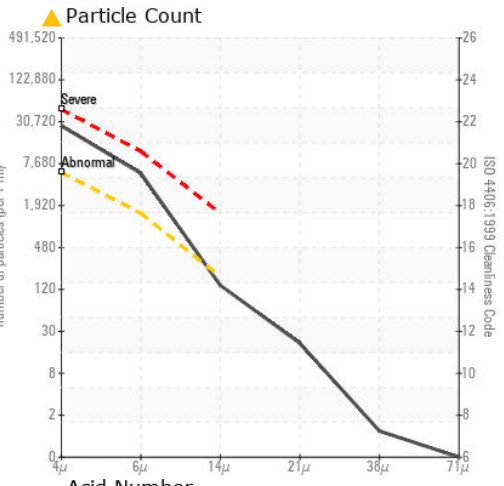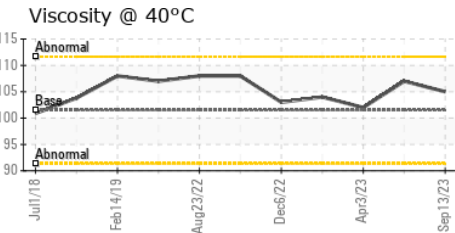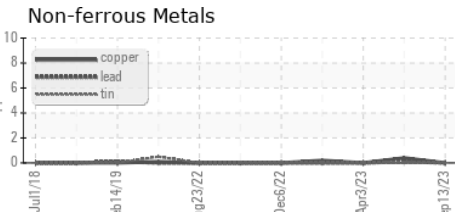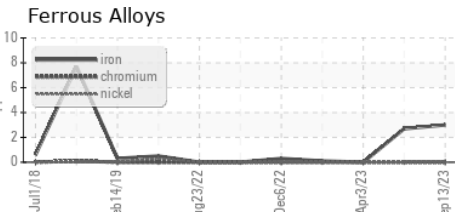

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0842482 **Received** : 29 Sep 2023  
**Lab Number** : 05964577 **Diagnosed** : 02 Oct 2023  
**Unique Number** : 10671128 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: PrtCount )

**HORMEL FOODS - AUSTIN**  
 1101 NORTH MAIN ST  
 AUSTIN, MN  
 US 55912  
 Contact: RYAN LOWE  
 rslowe@hormel.com  
 T: (507)437-5674  
 F: (507)437-9805

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)