




PROBLEM SUMMARY

Sample Rating Trend

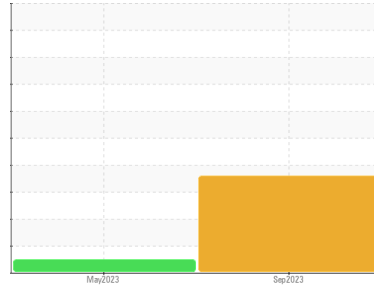

WEAR




Machine Id
TRANSFER TRANSFER


Component
Lube System
Fluid
ISO 150 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Ferrous Alloys

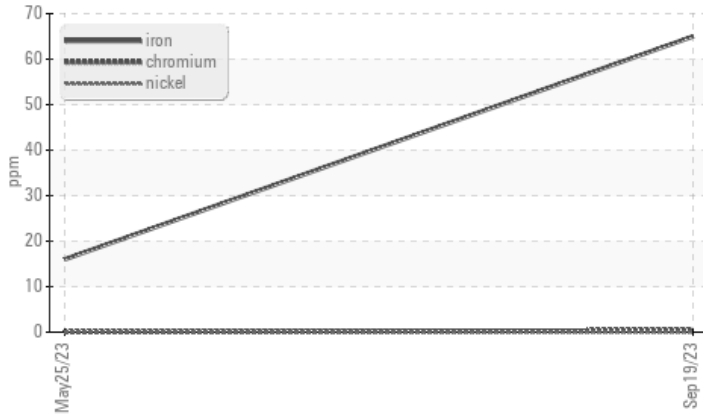

▲ Particle Trend

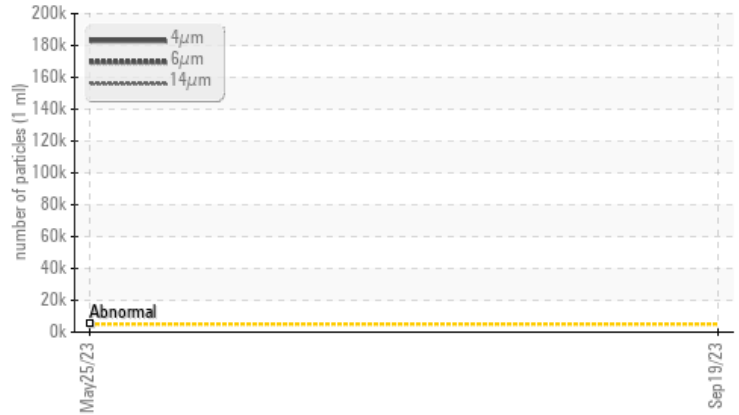

RECOMMENDATION

We recommend you service the filters on this component if applicable. We recommend an early resample to monitor this condition.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	NORMAL	---
Iron	ppm	ASTM D5185m	>20	▲ 65	16	---
Particles >4µm		ASTM D7647	>5000	▲ 184977	---	---
Particles >6µm		ASTM D7647	>1300	▲ 140658	---	---
Particles >14µm		ASTM D7647	>160	▲ 11589	---	---
Particles >21µm		ASTM D7647	>40	▲ 258	---	---
Oil Cleanliness		ISO 4406 (c)	>19/17/14	▲ 25/24/21	---	---
Silt	scalar	*Visual	NONE	▲ MODER	NONE	---

Customer Id: TESAUSTLC
Sample No.: TLC05964592
Lab Number: 05964592
Test Package: PLANT



To manage this report scan the QR code

To discuss the diagnosis or test data:
Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component if applicable.
Resample	---	---	?	We recommend an early resample to monitor this condition.

HISTORICAL DIAGNOSIS

25 May 2023 Diag: Jonathan Hester

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

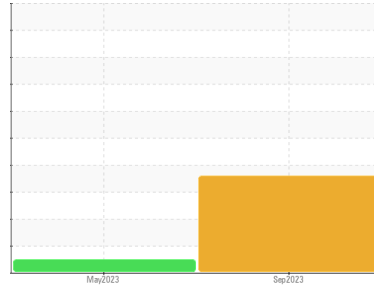

WEAR



Machine Id
TRANSFER TRANSFER

Component
Lube System
Fluid
ISO 150 (--- GAL)

DIAGNOSIS

▲ Recommendation

We recommend you service the filters on this component if applicable. We recommend an early resample to monitor this condition.

▲ Wear

The iron level is abnormal.

▲ Contamination

There is a high amount of particulates present in the oil. There is a moderate amount of visible silt present in the sample.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			TLC05964592	TLC0001165	---
Sample Date	Client Info			19 Sep 2023	25 May 2023	---
Machine Age	hrs	Client Info		0	0	---
Oil Age	hrs	Client Info		0	0	---
Oil Changed	Client Info			N/A	N/A	---
Sample Status				ABNORMAL	NORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	▲ 65	16	---
Chromium	ppm	ASTM D5185m	>20	<1	0	---
Nickel	ppm	ASTM D5185m	>20	0	0	---
Titanium	ppm	ASTM D5185m		<1	0	---
Silver	ppm	ASTM D5185m		0	0	---
Aluminum	ppm	ASTM D5185m	>20	2	0	---
Lead	ppm	ASTM D5185m	>20	6	5	---
Copper	ppm	ASTM D5185m	>20	11	8	---
Tin	ppm	ASTM D5185m	>20	1	<1	---
Vanadium	ppm	ASTM D5185m		0	0	---
Cadmium	ppm	ASTM D5185m		0	0	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	---
Barium	ppm	ASTM D5185m		<1	3	---
Molybdenum	ppm	ASTM D5185m		2	<1	---
Manganese	ppm	ASTM D5185m		<1	<1	---
Magnesium	ppm	ASTM D5185m		9	3	---
Calcium	ppm	ASTM D5185m		43	21	---
Phosphorus	ppm	ASTM D5185m		297	283	---
Zinc	ppm	ASTM D5185m		53	34	---
Sulfur	ppm	ASTM D5185m		8964	10507	---





CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	9	3	---
Sodium	ppm	ASTM D5185m		4	0	---
Potassium	ppm	ASTM D5185m	>20	<1	<1	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	▲ 184977	---	---
Particles >6µm		ASTM D7647	>1300	▲ 140658	---	---
Particles >14µm		ASTM D7647	>160	▲ 11589	---	---
Particles >21µm		ASTM D7647	>40	▲ 258	---	---
Particles >38µm		ASTM D7647	>10	1	---	---
Particles >71µm		ASTM D7647	>3	0	---	---
Oil Cleanliness		ISO 4406 (c)	>19/17/14	▲ 25/24/21	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.39	0.39	---




OIL ANALYSIS REPORT

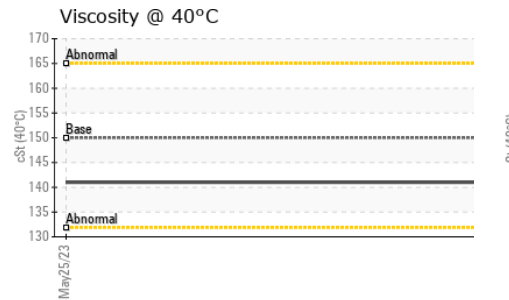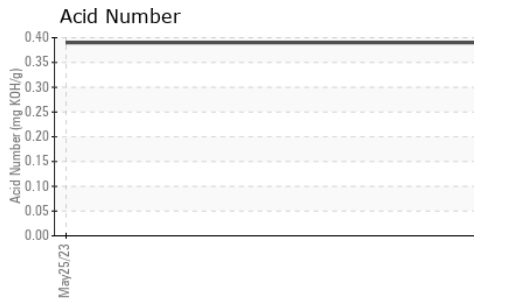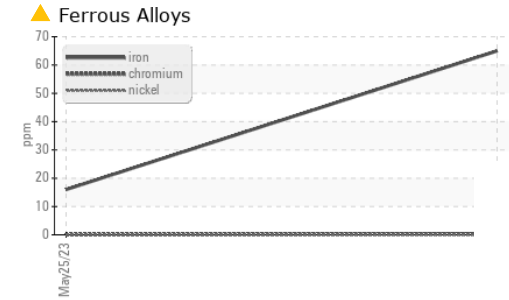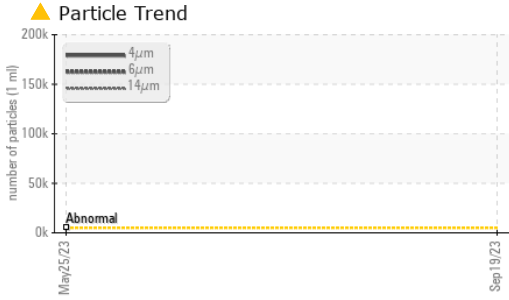





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	▲ MODER	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	150	141	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

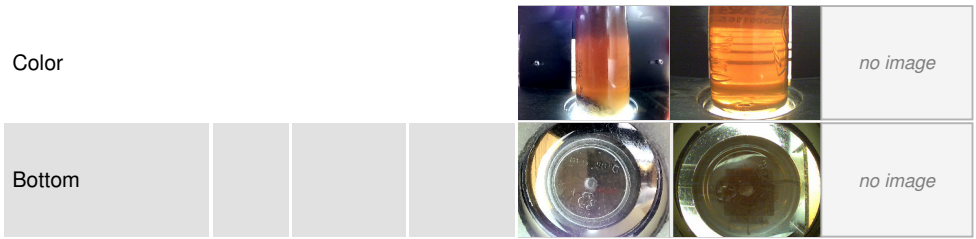

GRAPHS

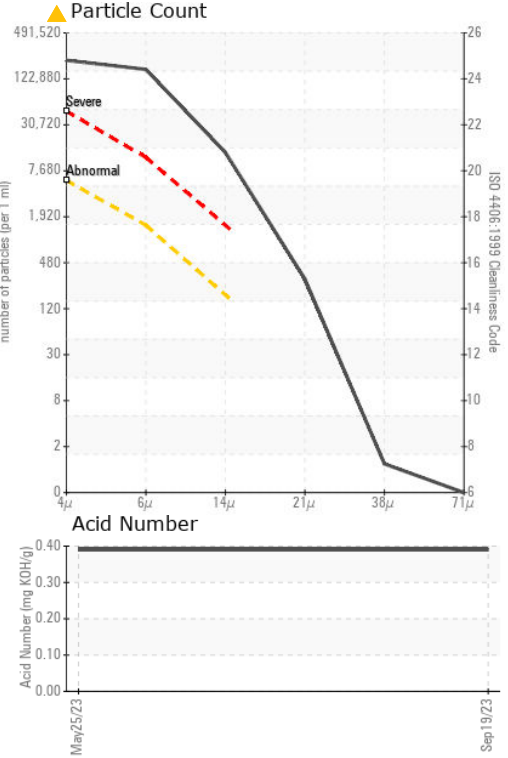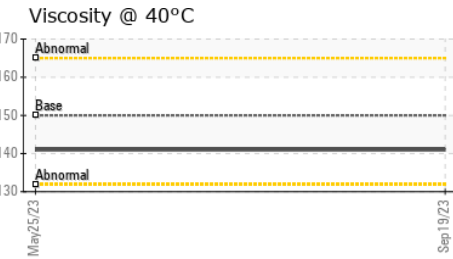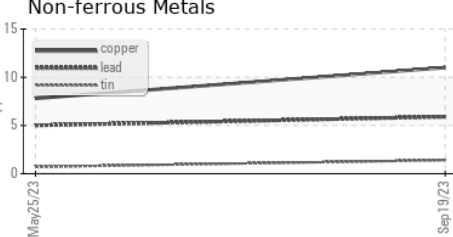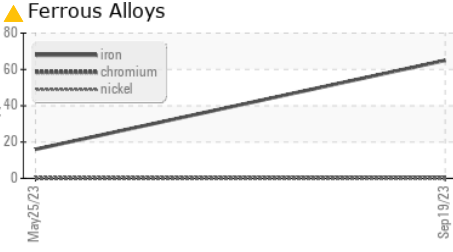

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TLC05964592 **Received** : 29 Sep 2023
Lab Number : 05964592 **Diagnosed** : 02 Oct 2023
Unique Number : 10671143 **Diagnostician** : Don Baldrige
Test Package : PLANT

TESLA
 1 Tesla Road, BIW E58
 Austin, TX
 US 78725
 Contact: Dave Mitchell
 davmitchell@tesla.com
 T: (260)226-1968
 F:

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)