


Machine Id TAN TAN Component Lube System Fluid NOT GIVEN (--- GAL)

COMPONENT CONDITION SUMMARY

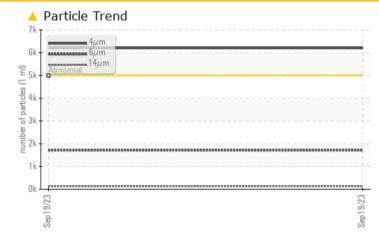

RECOMMENDATION

No corrective action is recommended at this time. Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

PROBLEMATIC TEST RESULTS									
Sample Status		ATTENTI	ON						
Particles >4µm	ASTM D7647 >	>5000 A 6202							
Particles >6µm	ASTM D7647 >	>1300 🔺 1718							
Oil Cleanliness	ISO 4406 (c) >	>19/17/14 🔺 20/18/ *	14						

Customer Id: TESAUSTLC Sample No.: TLC05964593 Lab Number: 05964593 Test Package: PLANT



To manage this report scan the QR code

To discuss the diagnosis or test data: Don Baldridge +1 <u>don.b505@comcast.net</u>

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS						
Action	Status	Date	Done By	Description		
Information Required			?	Please specify the brand, type, and viscosity of the oil on your next sample.		

HISTORICAL DIAGNOSIS



OIL ANALYSIS REPORT

Sample Rating Trend

SAMPLE INFORMATION method limit/base current





history2

history1

NOT GIVEN (--- GAL)

TAN TAN

Machine Id

Component Lube System

Fluid

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	ATION	method	limit/base	current	history i	nistory2
Sample Number		Client Info		TLC05964593		
Sample Date		Client Info		19 Sep 2023		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ATTENTION		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	2		
Chromium	ppm	ASTM D5185m	>20	0		
Nickel	ppm	ASTM D5185m	>20	0		
Titanium	ppm	ASTM D5185m	200	0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>20	0		
Lead	ppm	ASTM D5185m	>20	2		
Copper	ppm	ASTM D5185m	>20	14		
Tin		ASTM D5185m	>20	14 <1		
Vanadium	ppm	ASTM D5185m	>20	0		
Cadmium	ppm	ASTM D5185m		0		
Gaumum	ppm	ASTIVI DOTODIII		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		<1		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m		7		
Calcium	ppm	ASTM D5185m		23		
Phosphorus	ppm	ASTM D5185m		194		
Zinc	ppm	ASTM D5185m		23		
Sulfur	ppm	ASTM D5185m		5899		
CONTAMINANTS	\$	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<1		
Sodium	ppm	ASTM D5185m		1		
Potassium	ppm	ASTM D5185m	>20	0		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	6202		
Particles >6µm		ASTM D7647	>1300	<u> </u>		
Particles >14µm		ASTM D7647	>160	132		
Particles >21µm		ASTM D7647	>40	32		
Particles >38µm		ASTM D7647	>10	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>19/17/14	20/18/14		
FLUID DEGRADA		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.19		
(-)	0 - 0					



Acid Number

Viscosity @ 40°C

0.2

(B/HO)

-B 0.05

0.00

110

105

90

Sep 19/23

Abn

(100 to 100 to 1

Sep

OIL ANALYSIS REPORT

scalar

method

*Visual

limit/base

NONE

current


NONE


history1


history2

VISUAL

White Metal





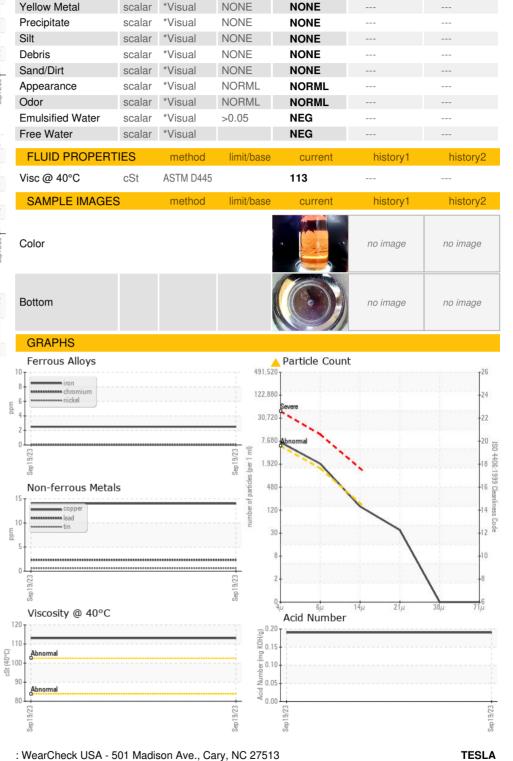



TESLA 1 Tesla Road, BIW E58 Austin, TX US 78725 Contact: Dave Mitchell davmitchell@tesla.com T: (260)226-1968 F:

Certificate L2367 Test Package : PLANT

: TLC05964593

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

: 05964593

: 10671144

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Received

Diagnosed

Diagnostician

: 29 Sep 2023

: 02 Oct 2023

: Don Baldridge

Laboratory

Sample No.

Lab Number

Unique Number