




PROBLEM SUMMARY


Sample Rating Trend

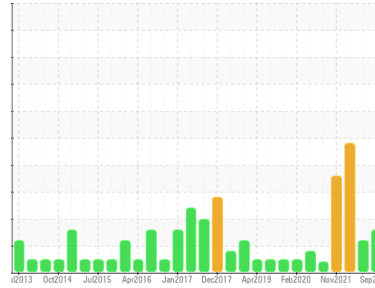

Machine Id
KAESER SFC 75ST 4575180 (S/N 1009)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

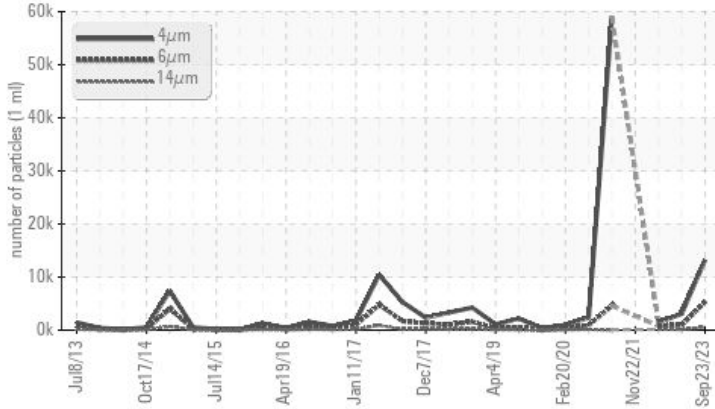

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ATTENTION	ABNORMAL
Particles >6µm	ASTM D7647	>1300	▲ 5326	964	795
Particles >14µm	ASTM D7647	>80	▲ 549	▲ 95	▲ 135
Particles >21µm	ASTM D7647	>20	▲ 114	▲ 30	▲ 46
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 21/20/16	▲ 19/17/14	▲ 18/17/14

Customer Id: MODALI
 Sample No.: KC124511
 Lab Number: 05964610
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

09 Jun 2023 Diag: Don Baldrige

ISO



No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



14 Oct 2022 Diag: Don Baldrige

WATER



The filter change at the time of sampling has been noted. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition. All component wear rates are normal. There is a moderate amount of particulates present in the oil. There is a light concentration of water present in the oil. Free water present. The AN level is acceptable for this fluid.

view report



22 Nov 2021 Diag: Jonathan Hester

WATER



We advise that you stop the unit and follow the water drain-off procedure for this component. The filter change at the time of sampling has been noted. We recommend an early resample in 500 hours to monitor this condition. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. Free water present. There is a light concentration of water present in the oil. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report




Machine Id
KAESER SFC 75ST 4575180 (S/N 1009)

Component

Compressor

Fluid

KAESER SIGMA (OEM) S-460 (--- GAL)

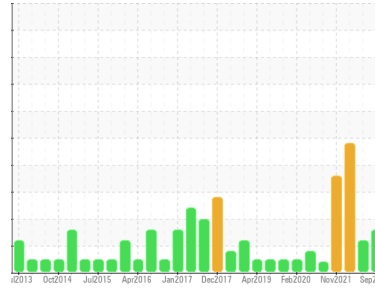

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KC124511	KC102061	KC85887
Sample Date	Client Info	23 Sep 2023	09 Jun 2023	14 Oct 2022
Machine Age	hrs	13762	72316	67208
Oil Age	hrs	0	5000	3000
Oil Changed	Client Info	N/A	Not Changd	Not Changd
Sample Status		ABNORMAL	ATTENTION	ABNORMAL

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	0	<1	0
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	<1	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	0	<1	3
Lead	ppm	ASTM D5185m >10	0	0	0
Copper	ppm	ASTM D5185m >50	2	5	4
Tin	ppm	ASTM D5185m >10	0	0	0
Antimony	ppm	ASTM D5185m	---	---	---
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m 90	0	2	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	0	<1
Magnesium	ppm	ASTM D5185m 90	3	<1	15
Calcium	ppm	ASTM D5185m 2	2	0	0
Phosphorus	ppm	ASTM D5185m	2	<1	0
Zinc	ppm	ASTM D5185m	5	<1	21

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	0	<1	<1
Sodium	ppm	ASTM D5185m	0	0	4
Potassium	ppm	ASTM D5185m >20	0	0	3
Water	%	ASTM D6304 >0.05	0.007	0.006	▲ 0.253
ppm Water	ppm	ASTM D6304 >500	75.0	66.1	▲ 2530






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	13206	3097	1459
Particles >6µm	ASTM D7647 >1300	▲ 5326	964	795
Particles >14µm	ASTM D7647 >80	▲ 549	▲ 95	▲ 135
Particles >21µm	ASTM D7647 >20	▲ 114	▲ 30	▲ 46
Particles >38µm	ASTM D7647 >4	2	2	▲ 7
Particles >71µm	ASTM D7647 >3	0	0	1
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ 21/20/16	▲ 19/17/14	▲ 18/17/14

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.46	0.50	0.40

OIL ANALYSIS REPORT

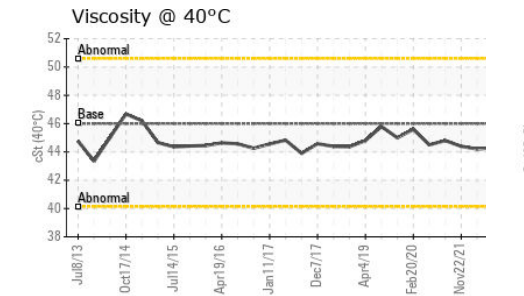
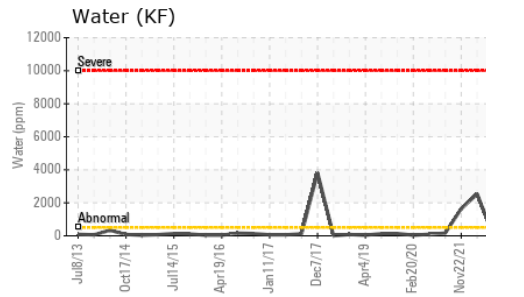
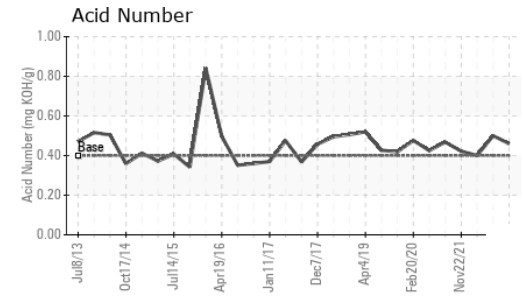
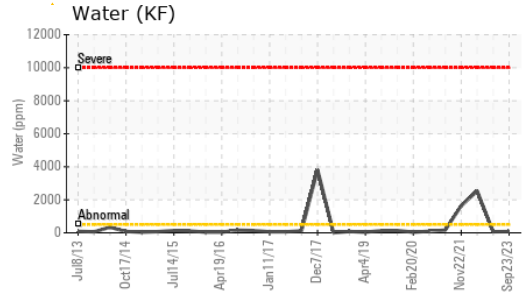
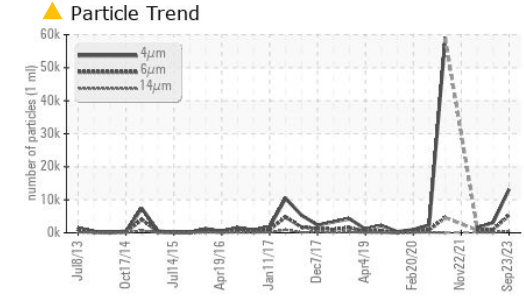


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	▲ 0.2%
Free Water	scalar	*Visual		NEG	▲ 1.0

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	44.6	44.3	44.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

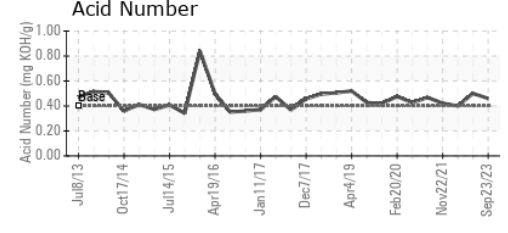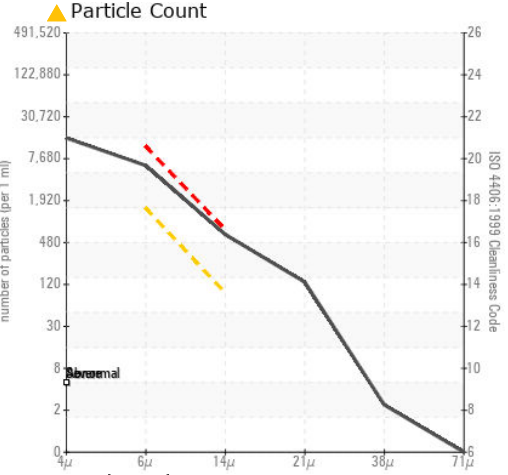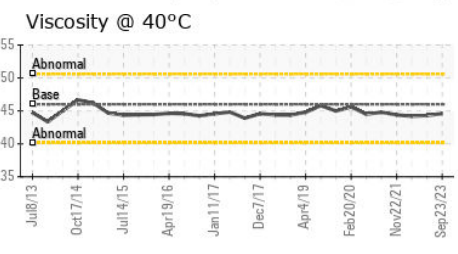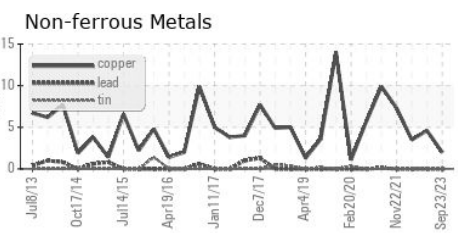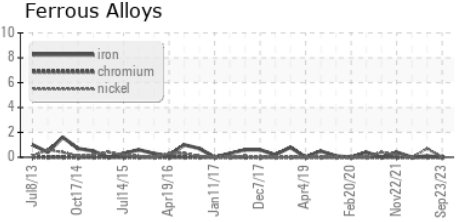

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC124511 **Received** : 29 Sep 2023
Lab Number : 05964610 **Diagnosed** : 02 Oct 2023
Unique Number : 10671161 **Diagnostician** : Don Baldrige
Test Package : IND 2

MODERNE GLASS
 1000 INDUSTRIAL BLVD
 ALIQUIPPA, PA
 US 15001
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: