


### **PROBLEM SUMMARY**


# KAESER DSD 250 8422142 (S/N 1180)

Compressor

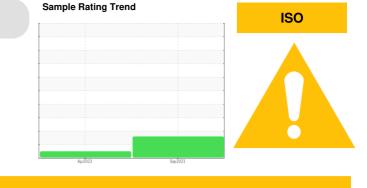

### KAESER SIGMA (OEM) S-460 (--- QTS)

### COMPONENT CONDITION SUMMARY

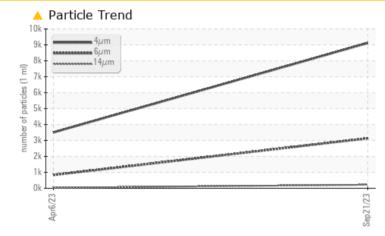

### RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### PROBLEMATIC TEST RESULTS

Sample Status		ABNORMAL	NORMAL					
Particles >6µm	ASTM D7647 >1300	A 3134	831					
Particles >14µm	ASTM D7647 >80	<b>A</b> 220	33					
Particles >21µm	ASTM D7647 >20	<u> </u>	8					
Oil Cleanliness	ISO 4406 (c) >/17	/13 🔺 20/19/15	19/17/12					

Customer Id: NORHOL Sample No.: KC110821 Lab Number: 05964611 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Don Baldridge +1 don.b505@comcast.net

*To change component or sample information:* Customer Service +1 1-800-237-1369 <u>customerservice@wearcheck.com</u> There are no recommended actions for this sample.

### HISTORICAL DIAGNOSIS

### 06 Apr 2023 Diag: Don Baldridge

NORMAL



Resample at the next service interval to monitor.All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





### **OIL ANALYSIS REPORT**

#### Machine Id KAESER DSD 250 8422142 (S/N 1180) Component

Compressor Fluid

KAESER SIGMA (OEM) S-460 (--- QTS)

### DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear


All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

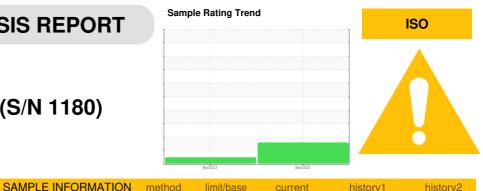



SAMPLE INFORM	/IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC110821	KC101793	
Sample Date		Client Info		21 Sep 2023	06 Apr 2023	
Machine Age	hrs	Client Info		6709	4493	
Oil Age	hrs	Client Info		3482	1200	
Oil Changed		Client Info		Not Changd	Not Changd	
Sample Status				ABNORMAL	NORMAL	
-		and the set	1		In the term of the	la la tana 0
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	<1	<1	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	6	<1	
Tin	ppm	ASTM D5185m	>10	0	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	0	73	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		0	<1	
Magnesium	ppm	ASTM D5185m	90	7	85	
Calcium	ppm	ASTM D5185m	2	2	1	
Phosphorus	ppm	ASTM D5185m		2	0	
Zinc	ppm	ASTM D5185m		8	0	
CONTAMINANTS		method	limit/base	current	biotond	history2
					history1	TIISTOL A
Silicon	ppm		>25	0	1	
Sodium	ppm	ASTM D5185m		2	20	
Potassium	ppm	ASTM D5185m	>20	<1	2	
Water	%	ASTM D6304	>0.05	0.007	0.031	
ppm Water	ppm	ASTM D6304	>500	77.1	318.1	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		9117	3505	
Particles >6µm		ASTM D7647	>1300	<u> </u>	831	
Particles >14µm		ASTM D7647	>80	<u> </u>	33	
Particles >21µm		ASTM D7647	>20	<u> </u>	8	
Particles >38µm		ASTM D7647	>4	1	1	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	<b>A</b> 20/19/15	19/17/12	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.39	0.42	





Built for a lifetime

## **OIL ANALYSIS REPORT**





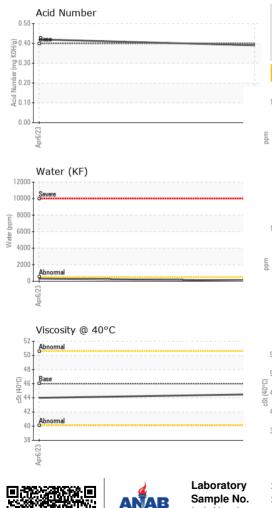

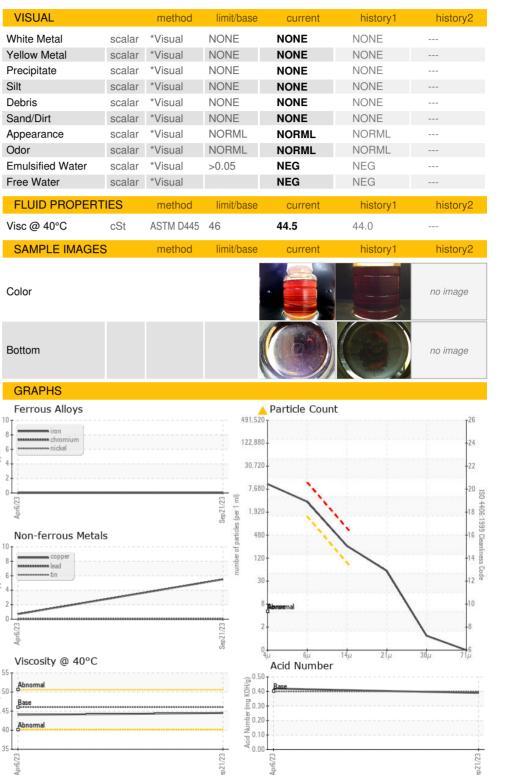

Sep21/23. NORTH AMERICAN HOGANAS : WearCheck USA - 501 Madison Ave., Cary, NC 27513 111 HOGANAS WAY, STONEY CREEK MILL : KC110821 Received : 29 Sep 2023 Lab Number : 02 Oct 2023 HOLLSOPPLE, PA · 05964611 Diagnosed US 15935 Unique Number : 10671162 Diagnostician : Don Baldridge Test Package : IND 2 Contact: SERVICE MANAGER Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369. \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. T: 

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: SERVICE MANAGER - NORHOL