

PROBLEM SUMMARY

Sample Rating Trend

ISO

Machine Id


KAESER BSD 50 3175059 (S/N 1675)

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

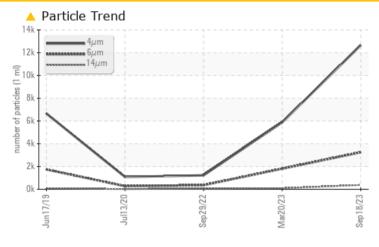

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS								
Sample Status			ABNORMAL	ATTENTION	NORMAL			
Particles >6µm	ASTM D7647	>1300	△ 3254	<u>▲</u> 1808	360			
Particles >14μm	ASTM D7647	>80	4 377	4 90	68			
Particles >21μm	ASTM D7647	>20	4 99	18	21			
Oil Cleanliness	ISO 4406 (c)	>/17/13	21/19/16	20/18/14	17/16/13			

Customer Id: MONAMS Sample No.: KC124509 Lab Number: 05964624 Test Package: IND 2

To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

20 Mar 2023 Diag: Doug Bogart

ISO



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



29 Sep 2022 Diag: Jonathan Hester

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



13 Jul 2020 Diag: Angela Borella

NORMAL




Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT

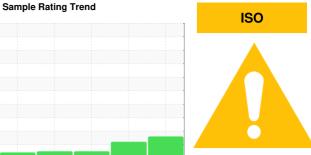

KAESER BSD 50 3175059 (S/N 1675)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Jun2019	Jul2020	Sep2022 Mar2023	Sep2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC124509	KC101509	KC105540
Sample Date		Client Info		18 Sep 2023	20 Mar 2023	29 Sep 2022
Machine Age	hrs	Client Info		88728	84428	80303
Oil Age	hrs	Client Info		0	4100	11000
Oil Changed		Client Info		N/A	Changed	Changed
Sample Status				ABNORMAL	ATTENTION	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	<1	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	<1
Aluminum	ppm	ASTM D5185m	>10	0	1	<1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm		>50	4	3	13
Tin	ppm	ASTM D5185m	>10	0	<1	0
Antimony	ppm	ASTM D5185m				
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	34	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	90	4	41	<1
Calcium	ppm	ASTM D5185m	2	2	<1	0
Phosphorus	ppm	ASTM D5185m		2	13	<1
Zinc	ppm	ASTM D5185m		6	2	0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	<1	0
Sodium	ppm	ASTM D5185m		<1	10	0
Potassium	ppm	ASTM D5185m	>20	0	4	<1
Water	%	ASTM D6304	>0.05	0.008	0.011	0.003
ppm Water	ppm	ASTM D6304	>500	82.0	113.9	36.9
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		12651	5879	1225
Particles >6µm		ASTM D7647	>1300	A 3254	<u></u> 1808	360
Particles >14µm		ASTM D7647	>80	4 377	9 0	68
Particles >21µm		ASTM D7647	>20	<u>^</u> 99	18	21
Particles >38µm		ASTM D7647	>4	4	1	2
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u> </u>	2 0/18/14	17/16/13
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.37	0.43	0.41



OIL ANALYSIS REPORT

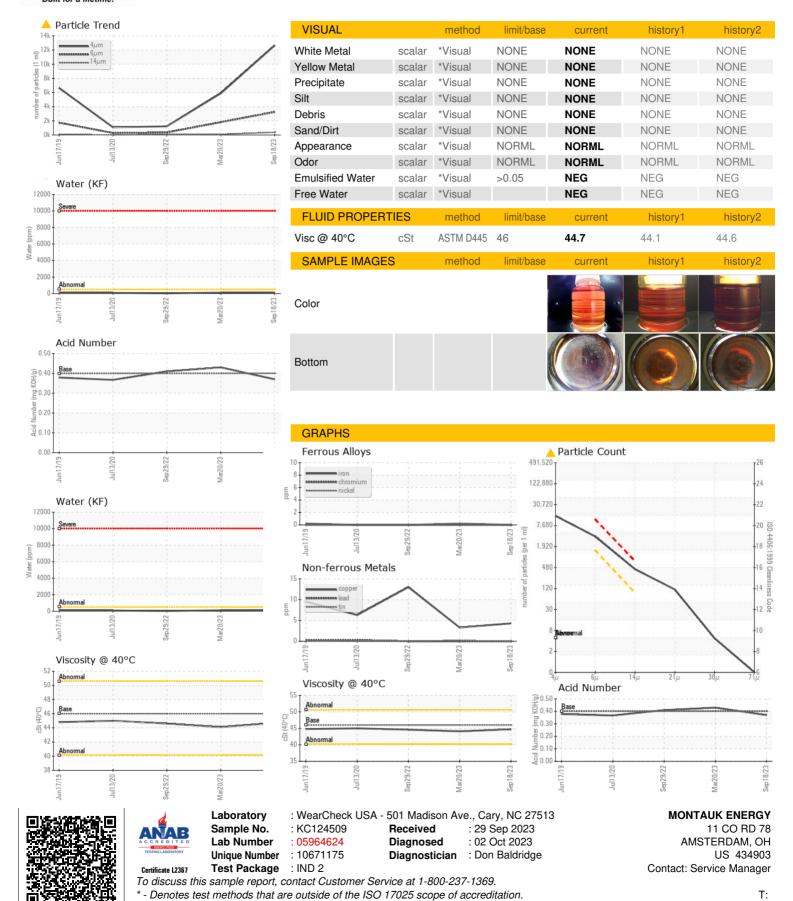

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: