

# **PROBLEM SUMMARY**

Sample Rating Trend

ISO

Machine Id

# KAESER AS30T 7290798 (S/N 1484)

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

### **COMPONENT CONDITION SUMMARY**



### RECOMMENDATION

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS									
Sample Status			ABNORMAL	ABNORMAL					
Particles >6µm	ASTM D7647	>1300	<b>10075</b>						
Particles >14μm	ASTM D7647	>80	<b>1321</b>						
Particles >21µm	ASTM D7647	>20	<b>4</b> 391						
Particles >38μm	ASTM D7647	>4	<b>16</b>						
Oil Cleanliness	ISO 4406 (c)	>/17/13	<u>22/21/18</u>						

Customer Id: DYNWAS Sample No.: KC110812 Lab Number: 05964625 Test Package: IND 2

To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS								
Action	Status	Date	Done By	Description				
Change Fluid			?	Oil and filter change at the time of sampling has been noted.				
Change Filter			?	Oil and filter change at the time of sampling has been noted.				

# HISTORICAL DIAGNOSIS

## 18 Oct 2022 Diag: Don Baldridge

VIS DEBRIS



No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.






# **OIL ANALYSIS REPORT**

# KAESER AS30T 7290798 (S/N 1484)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)





## **DIAGNOSIS**

### Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

## Contamination

There is a high amount of particulates present in the oil.


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			0ct2022	Sep 2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC110812	KC85846	
Sample Date		Client Info		19 Sep 2023	18 Oct 2022	
Machine Age	hrs	Client Info		9855	6985	
Oil Age	hrs	Client Info		6000	3085	
Oil Changed		Client Info		Changed	Not Changd	
Sample Status				ABNORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	<1	<1	
Lead	ppm	ASTM D5185m	>10	0	<1	
Copper	ppm	ASTM D5185m	>50	8	7	
Tin	ppm	ASTM D5185m	>10	0	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	2	0	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		0	<1	
Magnesium	ppm	ASTM D5185m	90	29	46	
Calcium	ppm	ASTM D5185m	2	3	0	
Phosphorus	ppm	ASTM D5185m		3	0	
Zinc	ppm	ASTM D5185m		13	1	
CONTAMINANTS	i	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	2	
Sodium	ppm	ASTM D5185m		10	15	
Potassium	ppm	ASTM D5185m	>20	2	5	
Water	%	ASTM D6304	>0.05	0.012	0.017	
ppm Water	ppm	ASTM D6304	>500	120.8	178.6	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		23489		
Particles >6μm		ASTM D7647	>1300	<u> </u>		
Particles >14μm		ASTM D7647	>80	<u> </u>		
Particles >21µm		ASTM D7647	>20	<u>▲</u> 391		
Particles >38μm		ASTM D7647	>4	<u>^</u> 16		
Particles >71μm		ASTM D7647	>3	1		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>22/21/18</u>		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.27	0.32	



# **OIL ANALYSIS REPORT**

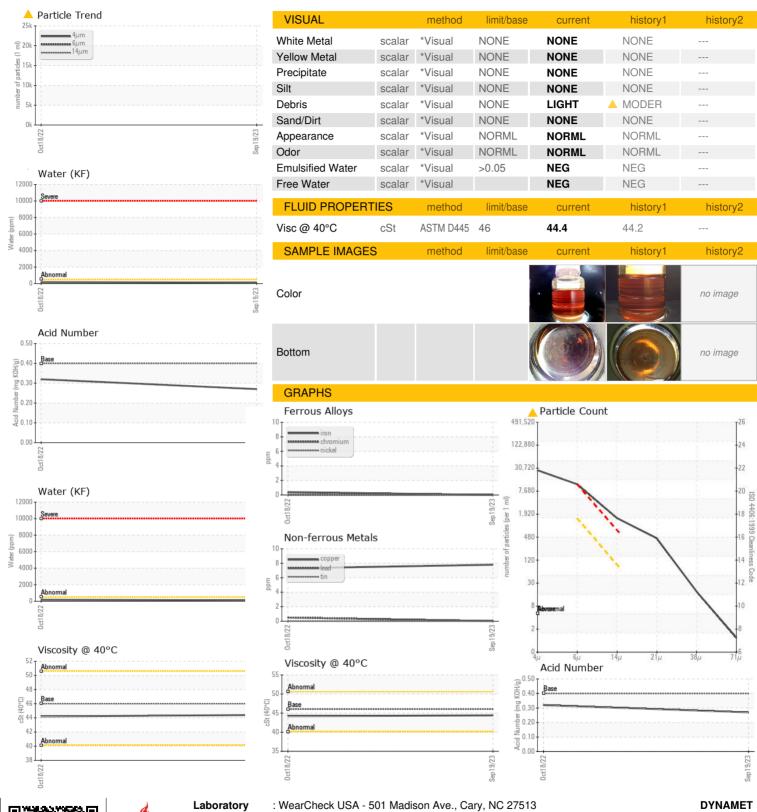



Certificate L2367

Sample No. Lab Number **Unique Number** 

Test Package

: KC110812

: 05964625 : 10671176 Received Diagnosed

: 29 Sep 2023 : 02 Oct 2023 Diagnostician : Don Baldridge

2200 N MAIN ST WASHINGTON, PA US 15301

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

: IND 2

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: