

PROBLEM SUMMARY

Sample Rating Trend

VIS DEBRIS

KAESER BSD 60 7190115 (S/N 1594)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

No relevant graphs to display

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

PROBLEMATIC T	EST RE	SULTS				
Sample Status				ABNORMAL	ATTENTION	ATTENTION
Debris	scalar	*Visual	NONE	▲ MODER	NONE	NONE

Customer Id: DYNWAS Sample No.: KC05964630 Lab Number: 05964630 Test Package: IND 2

To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Alert			?	We were unable to perform a particle count due to a high concentration of particles present in this sample.

HISTORICAL DIAGNOSIS

21 Dec 2022 Diag: Angela Borella





Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.



18 Jan 2022 Diag: Jonathan Hester

ISO



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



07 May 2021 Diag: Don Baldridge

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT

Sample Rating Trend



VIS DEBRIS

Machine Id

KAESER BSD 60 7190115 (S/N 1594)

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

Wear

All component wear rates are normal.

Contamination

Moderate concentration of visible dirt/debris present in the oil.


Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


		May202	1 Jan2022	Dec2022 S	p2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC05964630	KC103312	KC93107
Sample Date		Client Info		19 Sep 2023	21 Dec 2022	18 Jan 2022
Machine Age	hrs	Client Info		14114	11335	7699
Oil Age	hrs	Client Info		0	4000	5000
Oil Changed		Client Info		N/A	Changed	Changed
Sample Status				ABNORMAL	ATTENTION	ATTENTION
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	<1	0	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	3	4	5
Tin	ppm	ASTM D5185m	>10	0	<1	0
Antimony	ppm	ASTM D5185m				
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	1	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	90	51	13	10
Calcium	ppm	ASTM D5185m	2	2	0	0
Phosphorus	ppm	ASTM D5185m		3	4	<1
Zinc	ppm	ASTM D5185m		18	15	11
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	0	0
Sodium	ppm	ASTM D5185m		19	32	10
Potassium	ppm	ASTM D5185m	>20	4	4	0
Water	%	ASTM D6304	>0.05	0.007	0.011	0.008
ppm Water	ppm	ASTM D6304	>500	72.3	118.0	80.3
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647			20961	5263
Particles >6µm		ASTM D7647	>1300		1 989	990
Particles >14μm		ASTM D7647	>80		49	▲ 86
Particles >21µm		ASTM D7647	>20		13	19
Particles >38μm		ASTM D7647	>4		0	1
Particles >71μm		ASTM D7647	>3		0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13		2 2/18/13	▲ 17/14
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.35	0.31	0.37




OIL ANALYSIS REPORT

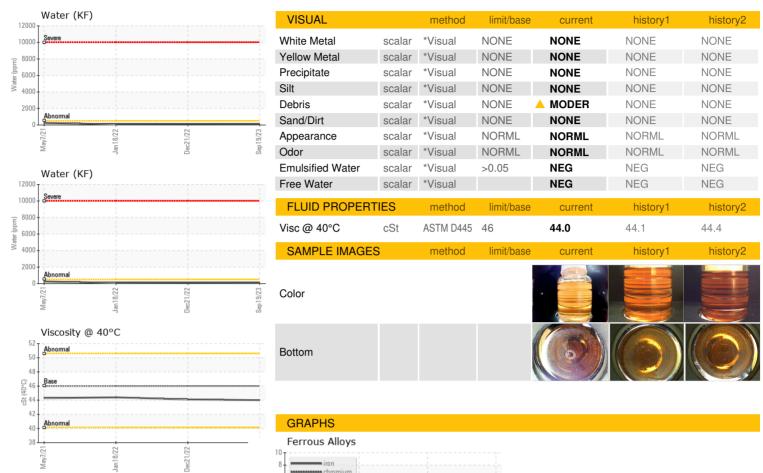











Certificate L2367

Laboratory Sample No. Lab Number **Unique Number** Test Package

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : KC05964630 : 05964630

Received : 10671181

: 29 Sep 2023 Diagnosed : 02 Oct 2023 Diagnostician : Don Baldridge

DYNAMET 2200 N MAIN ST WASHINGTON, PA US 15301

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

: IND 2

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: