

## **PROBLEM SUMMARY**

Sample Rating Trend


ISO

# KAESER ASD 30T 3066386 (S/N 1164)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

#### **COMPONENT CONDITION SUMMARY**

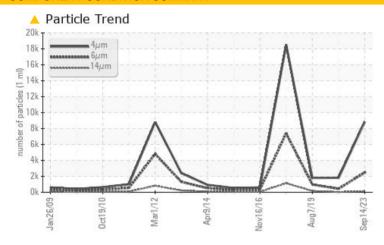

#### RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS									
Sample Status			ATTENTION	NORMAL	ABNORMAL				
Particles >6µm	ASTM D7647	>1300	<b>4</b> 2470	432	977				
Particles >14µm	ASTM D7647	>80	<b>149</b>	25	<u> </u>				
Particles >21µm	ASTM D7647	>20	<b>△</b> 36	6	<b>△</b> 56				
Oil Cleanliness	ISO 4406 (c)	>/17/13	<b>20/18/14</b>	16/12	▲ 17/15				

Customer Id: CVSSOM Sample No.: KC05964635 Lab Number: 05964635 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

#### **RECOMMENDED ACTIONS**

There are no recommended actions for this sample.

#### HISTORICAL DIAGNOSIS

#### 31 Jul 2020 Diag: Angela Borella

#### NORMAL



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



#### 07 Aug 2019 Diag: Jonathan Hester

#### WATER



Oil and filter change at the time of sampling has been noted. We recommend an early resample in 500 hours to monitor this condition. All component wear rates are normal. There is a high amount of particulates present in the oil. Free water present. There is a moderate concentration of water present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



#### 13 Jul 2018 Diag: Jonathan Hester

#### ISO



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





## **OIL ANALYSIS REPORT**

Sample Rating Trend



Machine Id

# KAESER ASD 30T 3066386 (S/N 1164)

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

# DIAGNOSIS

#### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is a moderate amount of particulates present in the oil.

#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Jan2009	Oct2010 Mar2012	Apr2014 Nov2016 Aug2019	Sep 2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC05964635	KC83383	KC72260
Sample Date		Client Info		14 Sep 2023	31 Jul 2020	07 Aug 2019
Machine Age	hrs	Client Info		60734	56579	51499
Oil Age	hrs	Client Info		0	4000	6200
Oil Changed		Client Info		N/A	Changed	Changed
Sample Status				ATTENTION	NORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	2
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	<1	0
Silver	ppm	ASTM D5185m	>2	0	<1	0
Aluminum	ppm	ASTM D5185m	>10	<1	0	1
Lead	ppm	ASTM D5185m	>10	0	0	<1
Copper	ppm	ASTM D5185m	>50	15	16	15
Tin	ppm	ASTM D5185m	>10	0	0	0
Antimony	ppm	ASTM D5185m			0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	13	2
Barium	ppm	ASTM D5185m	90	<1	0	<1
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	<1	<1
Magnesium	ppm	ASTM D5185m	90	9	12	4
Calcium	ppm	ASTM D5185m	2	2	4	0
Phosphorus	ppm	ASTM D5185m		2	2	5
Zinc	ppm	ASTM D5185m		15	21	14
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	1	<1
Sodium	ppm	ASTM D5185m		3	5	1
Potassium	ppm	ASTM D5185m	>20	0	2	0
Water	%	ASTM D6304	>0.05	0.00	0.014	<b>△</b> 0.466
ppm Water	ppm	ASTM D6304	>500	0.00	145.8	<b>▲</b> 4660
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		8837	1811	1794
Particles >6µm		ASTM D7647	>1300	<u> </u>	432	977
Particles >14μm		ASTM D7647	>80	<b>149</b>	25	<u> </u>
Particles >21µm		ASTM D7647	>20	<b>△</b> 36	6	<b>△</b> 56
Particles >38μm		ASTM D7647	>4	2	1	<b>8</b>
Particles >71μm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>^</u> 20/18/14	16/12	<b>△</b> 17/15
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
	1/011/	4 OTM D00 45	0.4	0.40	0.440	0.505

Acid Number (AN)

mg KOH/g ASTM D8045 0.4


0.413

0.40

0.525



### **OIL ANALYSIS REPORT**

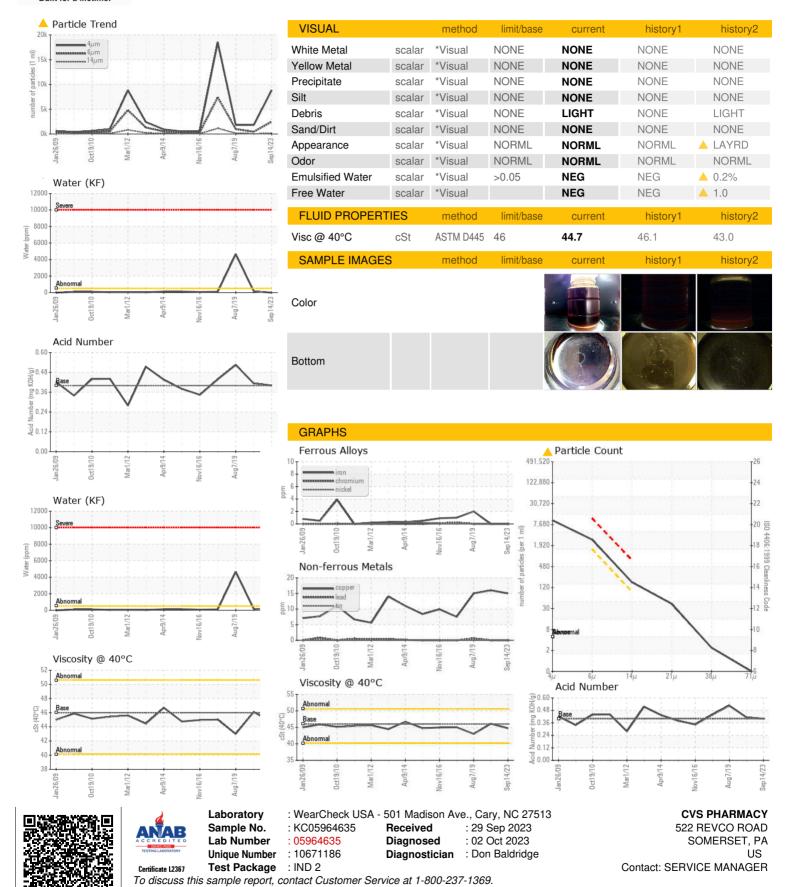

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: