PROBLEM SUMMARY

Sample Rating Trend

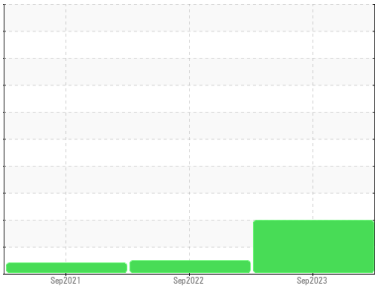

ISO

Machine Id
7888488 (S/N 1907)
Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

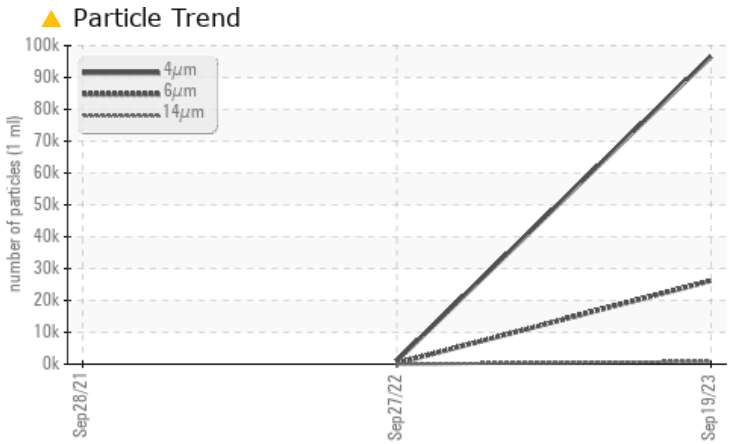

RECOMMENDATION

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	NORMAL	ABNORMAL
Particles >6µm		ASTM D7647	>1300	▲ **26214**	280	---
Particles >14µm		ASTM D7647	>80	▲ **845**	21	---
Particles >21µm		ASTM D7647	>20	▲ **144**	7	---
Particles >38µm		ASTM D7647	>4	▲ **4**	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ **24/22/17**	17/15/12	---

Customer Id: SANWESKC
Sample No.: KC126140
Lab Number: 05964637
Test Package: IND 2

To manage this report scan the QR code

To discuss the diagnosis or test data:
Don Baldridge +1
don.b505@comcast.net

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.

HISTORICAL DIAGNOSIS

27 Sep 2022 Diag: Don Baldridge

NORMAL

Resample at the next service interval to monitor.All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report

28 Sep 2021 Diag: Don Baldridge

VIS DEBRIS

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report

KAESER COMPRESSORS
Built for a lifetime.

OIL ANALYSIS REPORT

Sample Rating Trend

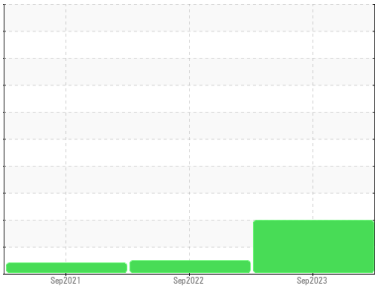

ISO

Machine Id
7888488 (S/N 1907)
Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation
Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear
All component wear rates are normal.

Contamination
There is a high amount of particulates present in the oil.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**KC126140**	KC106577	KC97807
Sample Date		Client Info		**19 Sep 2023**	27 Sep 2022	28 Sep 2021
Machine Age	hrs	Client Info		**9873**	5485	1428
Oil Age	hrs	Client Info		**0**	4057	1428
Oil Changed		Client Info		**Changed**	Changed	Changed
Sample Status				**ABNORMAL**	NORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	**0**	0	0
Chromium	ppm	ASTM D5185m	>10	**0**	0	0
Nickel	ppm	ASTM D5185m	>3	**0**	0	0
Titanium	ppm	ASTM D5185m	>3	**0**	0	0
Silver	ppm	ASTM D5185m	>2	**0**	0	0
Aluminum	ppm	ASTM D5185m	>10	**0**	0	3
Lead	ppm	ASTM D5185m	>10	**0**	0	0
Copper	ppm	ASTM D5185m	>50	**7**	16	11
Tin	ppm	ASTM D5185m	>10	**0**	0	0
Antimony	ppm	ASTM D5185m		**---**	---	0
Vanadium	ppm	ASTM D5185m		**0**	0	0
Cadmium	ppm	ASTM D5185m		**0**	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		**0**	0	<1
Barium	ppm	ASTM D5185m	90	**0**	1	0
Molybdenum	ppm	ASTM D5185m		**0**	0	0
Manganese	ppm	ASTM D5185m		**0**	0	0
Magnesium	ppm	ASTM D5185m	90	**2**	<1	30
Calcium	ppm	ASTM D5185m	2	**2**	0	0
Phosphorus	ppm	ASTM D5185m		**1**	5	2
Zinc	ppm	ASTM D5185m		**5**	0	11

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	**0**	0	0
Sodium	ppm	ASTM D5185m		**0**	0	1
Potassium	ppm	ASTM D5185m	>20	**0**	<1	5
Water	%	ASTM D6304	>0.05	**0.002**	0.005	0.017
ppm Water	ppm	ASTM D6304	>500	**22.0**	57.0	179.8

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		**96572**	1021	---
Particles >6µm	ASTM D7647	>1300	▲ **26214**	280	---
Particles >14µm	ASTM D7647	>80	▲ **845**	21	---
Particles >21µm	ASTM D7647	>20	▲ **144**	7	---
Particles >38µm	ASTM D7647	>4	▲ **4**	0	---
Particles >71µm	ASTM D7647	>3	**0**	0	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ **24/22/17**	17/15/12	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	**0.32**	0.32	0.279

KAESER COMPRESSORS
Built for a lifetime.

OIL ANALYSIS REPORT

Particle Trend

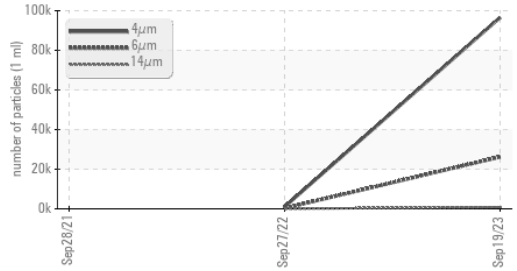

Water (KF)

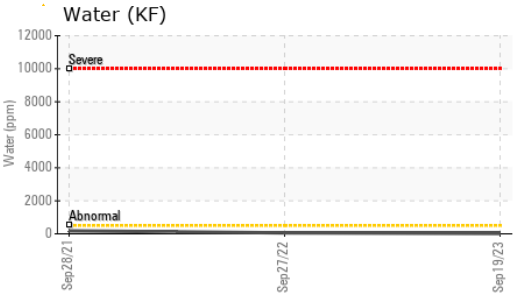

Acid Number

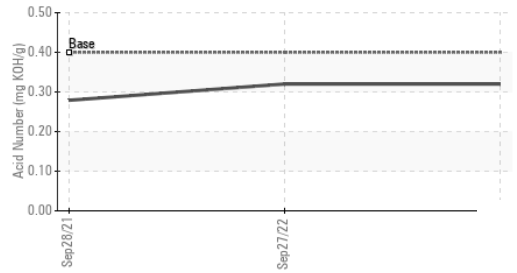

Water (KF)

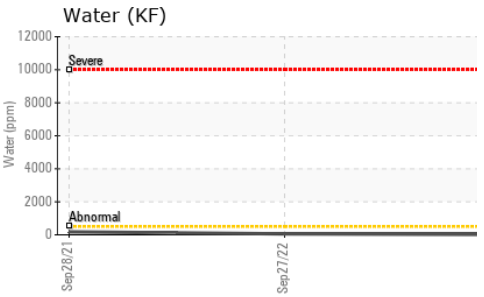

Viscosity @ 40°C

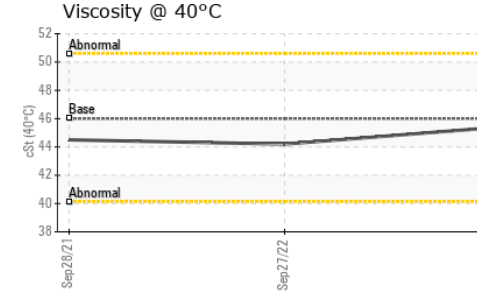

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	NONE
Silt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Debris	scalar	*Visual	NONE	**LIGHT**	LIGHT	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Appearance	scalar	*Visual	NORML	**NORML**	NORML	NORML
Odor	scalar	*Visual	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	**NEG**	NEG	NEG
Free Water	scalar	*Visual		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	**45.4**	44.2	44.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color			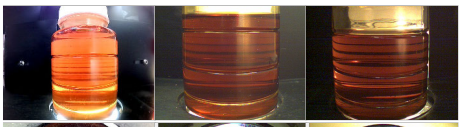		
Bottom			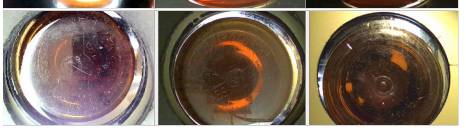		

GRAPHS

Ferrous Alloys

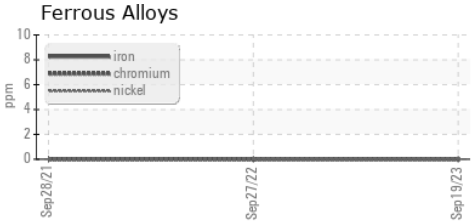

Non-ferrous Metals

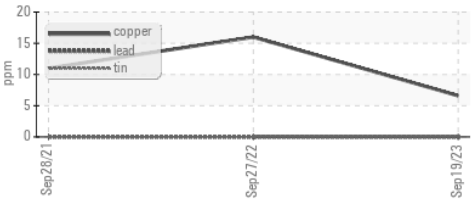

Viscosity @ 40°C

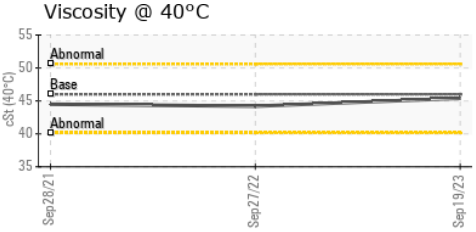

Particle Count

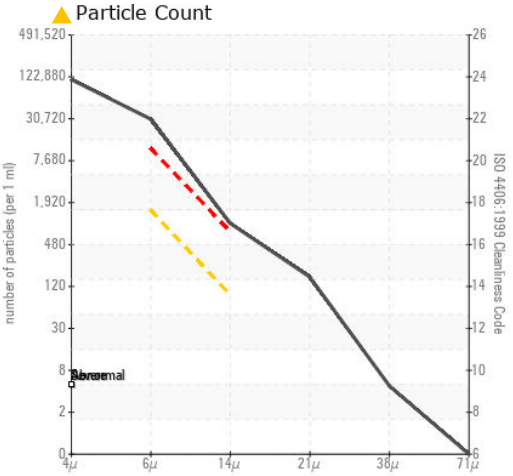

Acid Number

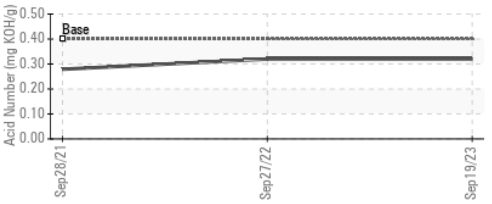

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC126140
Lab Number : 05964637
Unique Number : 10671188
Test Package : IND 2

Received : 29 Sep 2023
Diagnosed : 02 Oct 2023
Diagnostician : Don Baldridge

SANDVIK CUTTING TOOL MFG
2424 SANDIFER BLVD
WESTMINSTER, SC
US 29693
Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: