

PROBLEM SUMMARY

Sample Rating Trend

ISO

Machine Id


KAESER SK 15 3712722 (S/N 1894)

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

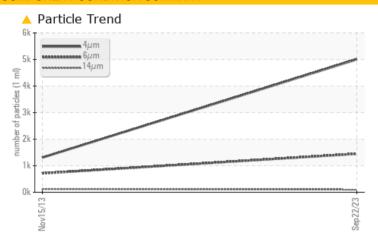

RECOMMENDATION

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS									
Sample Status			ATTENTION	ATTENTION					
Particles >6µm	ASTM D7647	>1300	1450	712					
Particles >14μm	ASTM D7647	>80	99	<u> </u>					
Particles >21µm	ASTM D7647	>20	<u>^</u> 27	4 0					
Oil Cleanliness	ISO 4406 (c)	>/17/13	20/18/14	<u></u> 17/14					

Customer Id: HYTHUN Sample No.: KCP45962 Lab Number: 05964646 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED	ACTIONS			
Action	Status	Date	Done By	Description
Change Fluid			?	Oil and filter change at the time of sampling has been noted.
Change Filter			?	Oil and filter change at the time of sampling has been noted.

HISTORICAL DIAGNOSIS

15 Nov 2013 Diag: Jonathan Hester






Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT

Sample Rating Trend



KAESER SK 15 3712722 (S/N 1894)

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Nov2013	Sep2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCP45962	KC43226	
Sample Date		Client Info		22 Sep 2023	15 Nov 2013	
Machine Age	hrs	Client Info		36244	8389	
Oil Age	hrs	Client Info		0	8389	
Oil Changed		Client Info		Changed	Changed	
Sample Status				ATTENTION	ATTENTION	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	<1	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	0	0	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	2	15	
Tin	ppm	ASTM D5185m	>10	0	0	
Antimony	ppm	ASTM D5185m			0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	90	<1	0	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m	100	14	2	
Calcium	ppm	ASTM D5185m	0	2	0	
Phosphorus	ppm	ASTM D5185m	0	2	1	
Zinc	ppm	ASTM D5185m	0	34	15	
Sulfur	ppm	ASTM D5185m	23500	18644	15174	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	<1	
Sodium	ppm	ASTM D5185m		2	<1	
Potassium	ppm	ASTM D5185m	>20	<1	6	
Water	%	ASTM D6304	>0.05	0.001	0.004	
ppm Water	ppm	ASTM D6304	>500	2.0	40	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		5003	1307	
Particles >6µm		ASTM D7647	>1300	<u> </u>	712	
Particles >14μm		ASTM D7647	>80	<u> </u>	<u> </u>	
Particles >21µm		ASTM D7647	>20	<u> </u>	4 0	
Particles >38µm		ASTM D7647	>4	3	6	
Particles >71µm		ASTM D7647	>3	1	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>^</u> 20/18/14	△ 17/14	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
I LOID DEGITION		Hicthica	minu bacc	Current	Thotory	Thotoly 2



OIL ANALYSIS REPORT

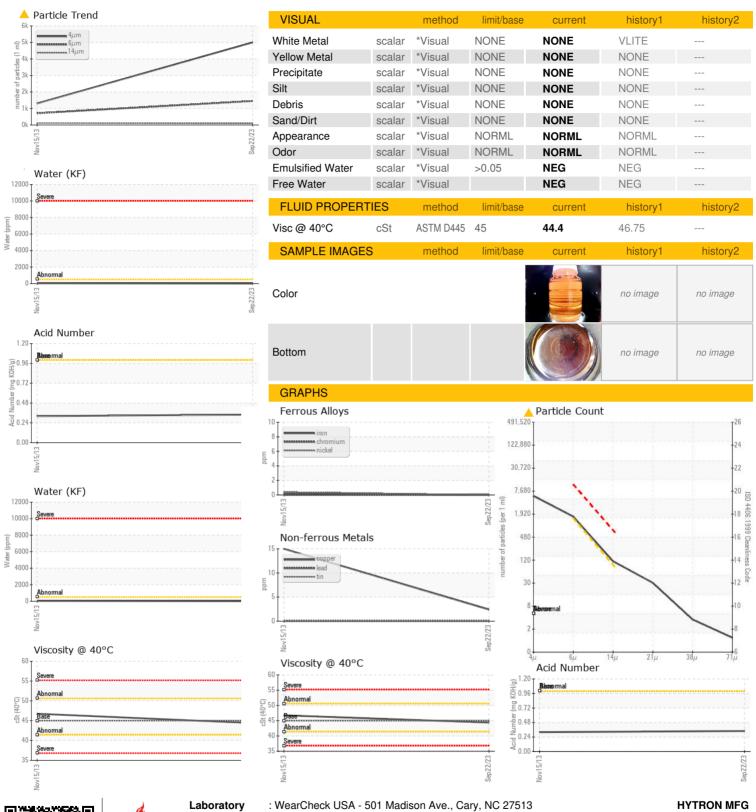



Sample No. Lab Number **Unique Number**

: KCP45962 : 05964646

: 10671197

Received : 29 Sep 2023 Diagnosed

: 02 Oct 2023 Diagnostician : Don Baldridge

15582 CHEMICAL LN HUNTINGTON BEACH, CA US 92649

Contact:

T: F:

Test Package : IND 2 (Additional Tests: KF, PrtCount) Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)