



# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**



Area

**[412]**

Machine Id


## KAESER 1001 - PARRISH TIRE

Component

**Compressor**

Fluid

**NOT GIVEN (1 GAL)**

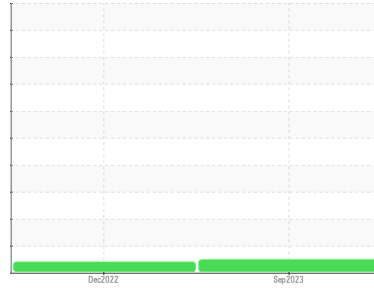

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0825941</b>	WC0758148	---
Sample Date	Client Info		<b>28 Sep 2023</b>	19 Dec 2022	---
Machine Age	hrs	Client Info	<b>0</b>	20091	---
Oil Age	hrs	Client Info	<b>0</b>	3438	---
Oil Changed	Client Info		<b>N/A</b>	Not Changd	---
Sample Status			<b>NORMAL</b>	ABNORMAL	---

### WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	<1	---
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	---
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	---
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m >10	<b>0</b>	0	---
Lead	ppm	ASTM D5185m >10	<b>0</b>	0	---
Copper	ppm	ASTM D5185m >50	<b>0</b>	<1	---
Tin	ppm	ASTM D5185m >10	<b>0</b>	0	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	---

### ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	---
Barium	ppm	ASTM D5185m	<b>&lt;1</b>	0	---
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	---
Manganese	ppm	ASTM D5185m	<b>0</b>	0	---
Magnesium	ppm	ASTM D5185m	<b>2</b>	0	---
Calcium	ppm	ASTM D5185m	<b>2</b>	0	---
Phosphorus	ppm	ASTM D5185m	<b>80</b>	77	---
Zinc	ppm	ASTM D5185m	<b>5</b>	0	---
Sulfur	ppm	ASTM D5185m	<b>553</b>	607	---

### CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>4</b>	4	---
Sodium	ppm	ASTM D5185m	<b>&lt;1</b>	0	---
Potassium	ppm	ASTM D5185m >20	<b>0</b>	0	---

### FLUID DEGRADATION



	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.092</b>	0.079	---

### VISUAL

	method	limit/base	current	history1	history2
White Metal	scalar	*Visual NONE	<b>NONE</b>	NONE	---
Yellow Metal	scalar	*Visual NONE	<b>NONE</b>	NONE	---
Precipitate	scalar	*Visual NONE	<b>NONE</b>	NONE	---
Silt	scalar	*Visual NONE	<b>NONE</b>	NONE	---
Debris	scalar	*Visual NONE	<b>NONE</b>	▲ MODER	---
Sand/Dirt	scalar	*Visual NONE	<b>NONE</b>	NONE	---
Appearance	scalar	*Visual NORML	<b>NORML</b>	NORML	---
Odor	scalar	*Visual NORML	<b>NORML</b>	NORML	---
Emulsified Water	scalar	*Visual >0.05	<b>NEG</b>	NEG	---
Free Water	scalar	*Visual	<b>NEG</b>	NEG	---







# OIL ANALYSIS REPORT

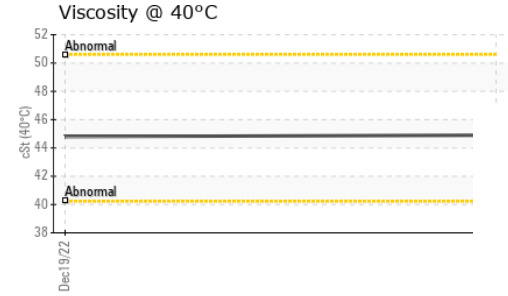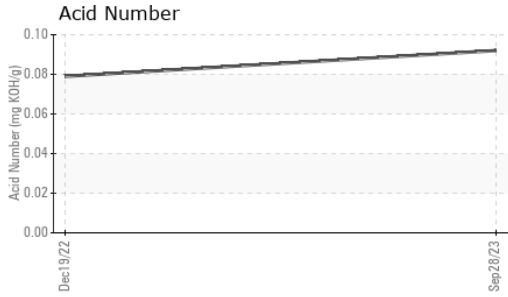

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	44.9	44.8	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					no image
Bottom					no image

## GRAPHS

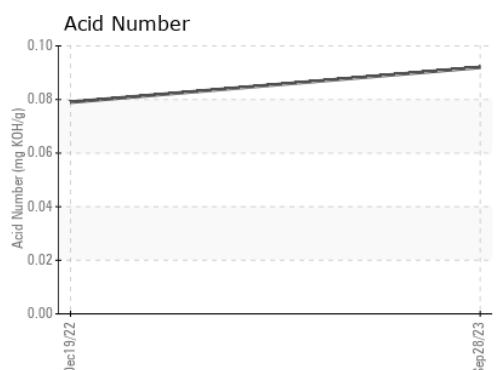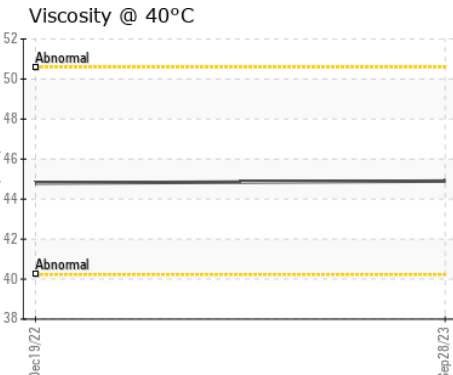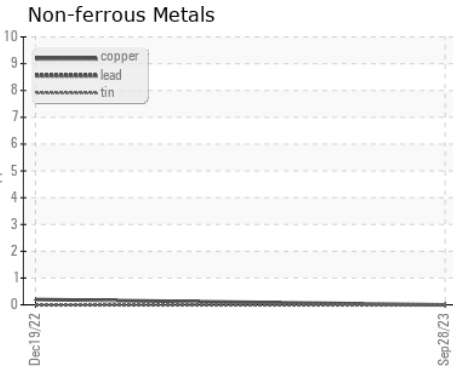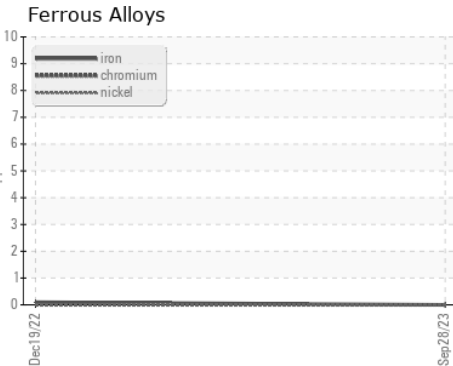

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0825941 **Received** : 29 Sep 2023  
**Lab Number** : 05964715 **Diagnosed** : 02 Oct 2023  
**Unique Number** : 10671266 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2

**ELEVATED INDUSTRIAL SOLUTIONS - EIS**  
 302 HUGHES ST  
 FOUNTAIN INN, SC  
 US 29644  
 Contact: DARRIN WARD  
 dward@elevatedindustrial.com  
 T:  
 F: (864)862-7653

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)