



# OIL ANALYSIS REPORT

Sample Rating Trend


**NORMAL**



Machine Id  
**KAESER 8436914 - HIGH PERFORMANCE CONDOC (S/N 1192)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) S-460 (20 GAL)**

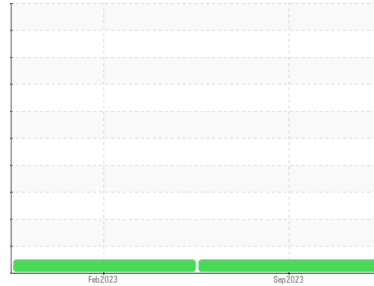

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>WC0845213</b>	WC0763733	---
Sample Date	Client Info	<b>21 Sep 2023</b>	09 Feb 2023	---
Machine Age	hrs Client Info	<b>6754</b>	3853	---
Oil Age	hrs Client Info	<b>6754</b>	1780	---
Oil Changed	Client Info	<b>N/A</b>	Not Changd	---
Sample Status		<b>NORMAL</b>	NORMAL	---

## WEAR METALS

method	limit/base	current	history1	history2
Iron ppm ASTM D5185m	>50	<b>0</b>	0	---
Chromium ppm ASTM D5185m	>10	<b>0</b>	0	---
Nickel ppm ASTM D5185m	>3	<b>&lt;1</b>	<1	---
Titanium ppm ASTM D5185m	>3	<b>0</b>	0	---
Silver ppm ASTM D5185m	>2	<b>0</b>	0	---
Aluminum ppm ASTM D5185m	>10	<b>0</b>	0	---
Lead ppm ASTM D5185m	>10	<b>0</b>	<1	---
Copper ppm ASTM D5185m	>50	<b>10</b>	6	---
Tin ppm ASTM D5185m	>10	<b>0</b>	0	---
Vanadium ppm ASTM D5185m		<b>0</b>	0	---
Cadmium ppm ASTM D5185m		<b>&lt;1</b>	<1	---

## ADDITIVES

method	limit/base	current	history1	history2
Boron ppm ASTM D5185m		<b>0</b>	0	---
Barium ppm ASTM D5185m	90	<b>&lt;1</b>	13	---
Molybdenum ppm ASTM D5185m		<b>0</b>	0	---
Manganese ppm ASTM D5185m		<b>0</b>	0	---
Magnesium ppm ASTM D5185m	90	<b>50</b>	55	---
Calcium ppm ASTM D5185m	2	<b>3</b>	0	---
Phosphorus ppm ASTM D5185m		<b>3</b>	1	---
Zinc ppm ASTM D5185m		<b>13</b>	<1	---
Sulfur ppm ASTM D5185m		<b>18140</b>	20071	---

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm ASTM D5185m	>25	<b>0</b>	<1	---
Sodium ppm ASTM D5185m		<b>25</b>	19	---
Potassium ppm ASTM D5185m	>20	<b>12</b>	10	---

## FLUID DEGRADATION



method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g ASTM D8045	0.4	<b>0.30</b>	0.40	---

## VISUAL

method	limit/base	current	history1	history2
White Metal scalar *Visual	NONE	<b>NONE</b>	NONE	---
Yellow Metal scalar *Visual	NONE	<b>NONE</b>	NONE	---
Precipitate scalar *Visual	NONE	<b>NONE</b>	NONE	---
Silt scalar *Visual	NONE	<b>NONE</b>	NONE	---
Debris scalar *Visual	NONE	<b>LIGHT</b>	NONE	---
Sand/Dirt scalar *Visual	NONE	<b>NONE</b>	NONE	---
Appearance scalar *Visual	NORML	<b>NORML</b>	NORML	---
Odor scalar *Visual	NORML	<b>NORML</b>	NORML	---
Emulsified Water scalar *Visual	>0.05	<b>NEG</b>	NEG	---
Free Water scalar *Visual		<b>NEG</b>	NEG	---







# OIL ANALYSIS REPORT

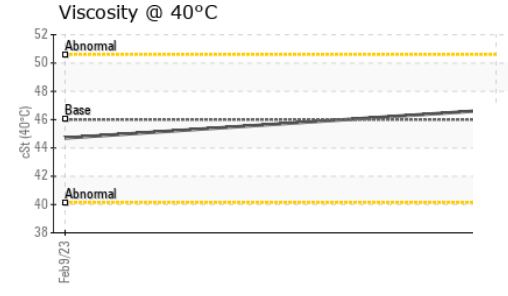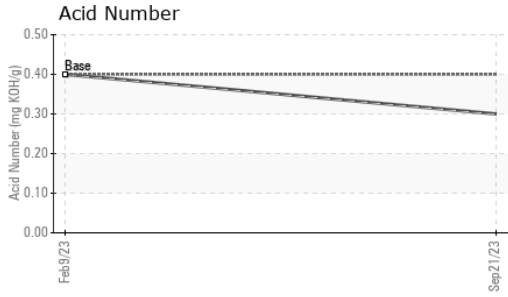

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	46.7	44.7	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					no image
Bottom					no image

## GRAPHS

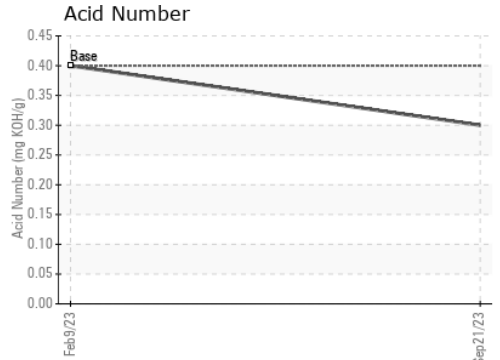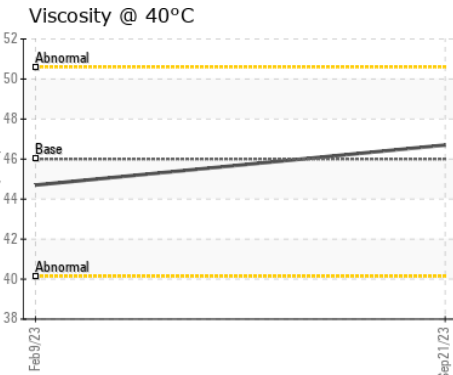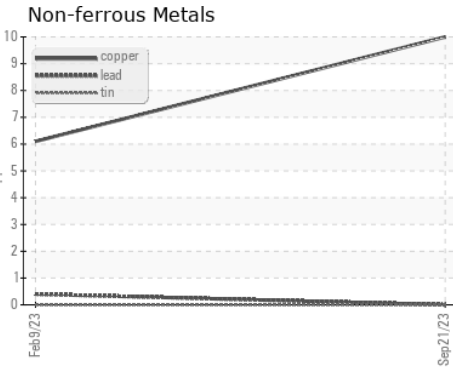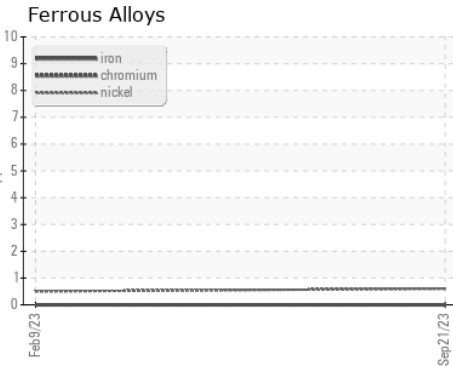

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0845213     **Received** : 29 Sep 2023  
**Lab Number** : 05964716     **Diagnosed** : 02 Oct 2023  
**Unique Number** : 10671267     **Diagnostician** : Doug Bogart  
**Test Package** : IND 2

**ELEVATED INDUSTRIAL SOLUTIONS - EIS**  
 302 HUGHES ST  
 FOUNTAIN INN, SC  
 US 29644  
 Contact: DARRIN WARD  
 dward@elevatedindustrial.com  
 T:  
 F: (864)862-7653

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)