




OIL ANALYSIS REPORT

Sample Rating Trend

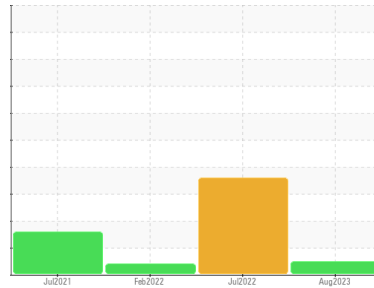

NORMAL



Machine Id
INGERSOLL RAND CBV522945 - AURORA TECH

Component
Compressor

Fluid
INGERSOLL-RAND ULTRA PLUS COOLANT (3 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	WC0826036	WC0705743	WC0637790
Sample Date	Client Info	31 Aug 2023	19 Jul 2022	01 Feb 2022
Machine Age	hrs	21824	19851	17489
Oil Age	hrs	0	4829	2467
Oil Changed	Client Info	N/A	Changed	Not Chngd
Sample Status		NORMAL	SEVERE	ABNORMAL

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	0	<1	2
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m	0	<1	0
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >25	0	16	0
Lead	ppm	ASTM D5185m >25	<1	<1	2
Copper	ppm	ASTM D5185m >50	15	2	27
Tin	ppm	ASTM D5185m >15	<1	1	<1
Antimony	ppm	ASTM D5185m	---	---	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	<1	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	14	1
Barium	ppm	ASTM D5185m	555	57	155
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	<1	0
Magnesium	ppm	ASTM D5185m	5	7	0
Calcium	ppm	ASTM D5185m	8	4	3
Phosphorus	ppm	ASTM D5185m	6	10	9
Zinc	ppm	ASTM D5185m	346	17	322
Sulfur	ppm	ASTM D5185m	344	310	187

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	2	<1	9
Sodium	ppm	ASTM D5185m	41	28	51
Potassium	ppm	ASTM D5185m >20	6	5	4

FLUID DEGRADATION



method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045	1.15	4.133	1.62

VISUAL

method	limit/base	current	history1	history2	
White Metal	scalar	*Visual NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual NONE	NONE	NONE	NONE
Silt	scalar	*Visual NONE	NONE	NONE	NONE
Debris	scalar	*Visual NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual NONE	NONE	NONE	NONE
Appearance	scalar	*Visual NORML	NORML	NORML	NORML
Odor	scalar	*Visual NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual >0.1	NEG	NEG	NEG
Free Water	scalar	*Visual	NEG	NEG	NEG




OIL ANALYSIS REPORT



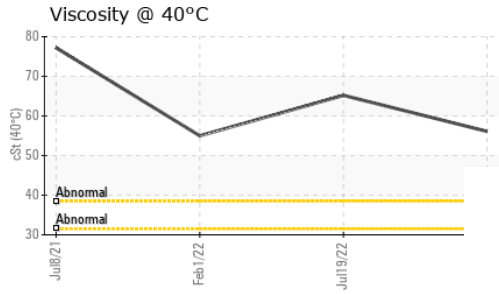
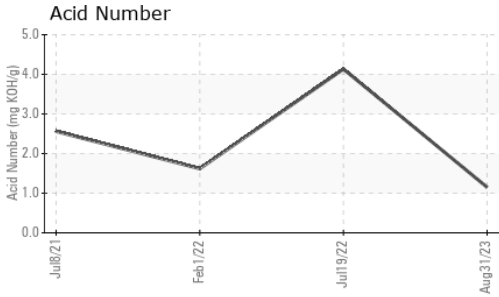


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	56.1	▲ 65.2	▲ 55.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

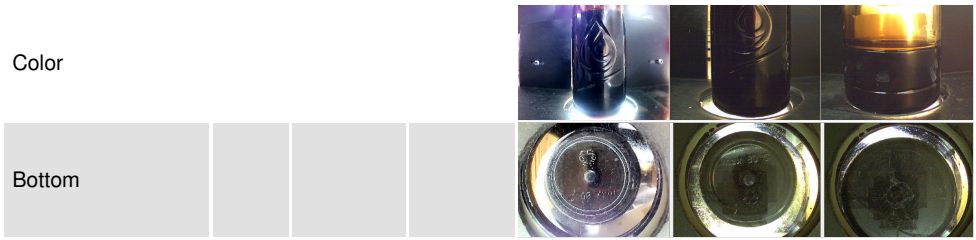

GRAPHS

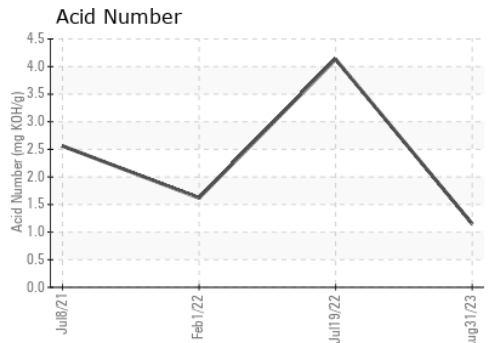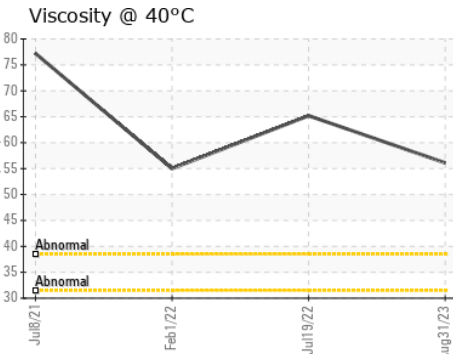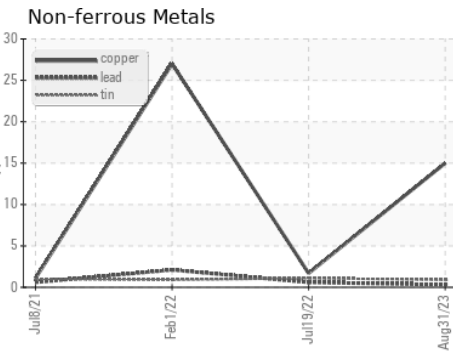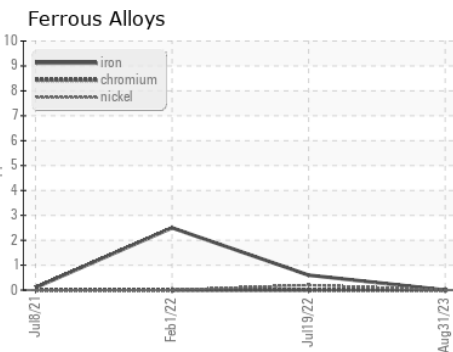

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0826036 **Received** : 29 Sep 2023
Lab Number : 05964718 **Diagnosed** : 02 Oct 2023
Unique Number : 10671269 **Diagnostician** : Doug Bogart
Test Package : IND 2

ELEVATED INDUSTRIAL SOLUTIONS - EIS
 302 HUGHES ST
 FOUNTAIN INN, SC
 US 29644
 Contact: DARRIN WARD
 dward@elevatedindustrial.com
 T:
 F: (864)862-7653

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)