




# OIL ANALYSIS REPORT

Sample Rating Trend

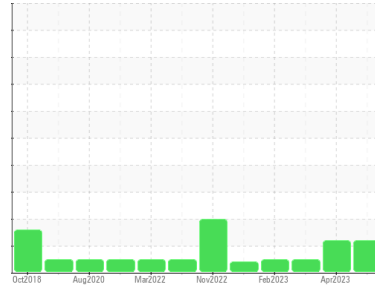

ISO



Area  
**GUAY SON [CONHER]**  
 Machine Id  
**PERKINS IBACO COZAR VII AUX-1**  
 Component  
**Diesel Engine**  
 Fluid  
**XTRA REV 15W40 (8 LTR)**

## DIAGNOSIS

### Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a moderate amount of particulates present in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KL0012870</b>	KL0011403	KL0010262
Sample Date	Client Info		<b>20 Sep 2023</b>	06 Apr 2023	26 Feb 2023
Machine Age	hrs	Client Info	<b>19791</b>	19786	19042
Oil Age	hrs	Client Info	<b>5</b>	129	10
Oil Changed	Client Info		<b>Changed</b>	Not Changd	Not Changd
Sample Status			<b>ATTENTION</b>	ATTENTION	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>5	<b>&lt;1.0</b>	<1.0	<1.0
Glycol	WC Method		<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>250	<b>12</b>	18	2
Chromium	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	<1
Nickel	ppm	ASTM D5185m	>5	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>35	<b>4</b>	<1	2
Lead	ppm	ASTM D5185m	>100	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>60	<b>&lt;1</b>	0	<1
Tin	ppm	ASTM D5185m	>5	<b>1</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		<b>0</b>	0	<1
Barium	ppm	ASTM D5185m		<b>0</b>	0	1
Molybdenum	ppm	ASTM D5185m		<b>&lt;1</b>	3	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m		<b>5</b>	16	6
Calcium	ppm	ASTM D5185m		<b>2647</b>	2899	2663
Phosphorus	ppm	ASTM D5185m		<b>1134</b>	1121	1056
Zinc	ppm	ASTM D5185m		<b>1404</b>	1449	1229
Sulfur	ppm	ASTM D5185m		<b>3853</b>	4460	3746

## CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>35	<b>9</b>	10	8
Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	21	2
Potassium	ppm	ASTM D5185m	>20	<b>3</b>	3	3


## INFRA-RED

	method	limit/base	current	history1	history2	
Soot %	%	*ASTM D7844	>3	<b>0.1</b>	0.1	0.1
Nitration	Abs/cm	*ASTM D7624	>20	<b>4.7</b>	7.6	4.2
Sulfation	Abs./1mm	*ASTM D7415	>30	<b>12.8</b>	16.0	12.8




# OIL ANALYSIS REPORT


▲ Particle Trend

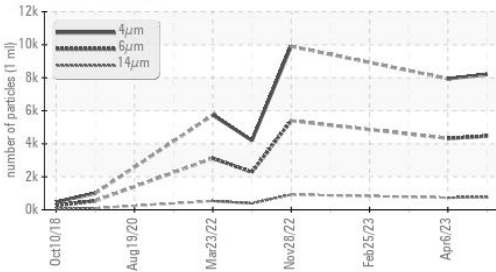


▲ Particle Trend

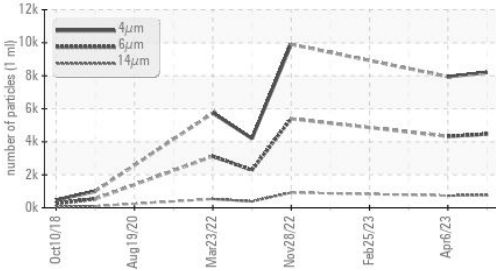

Base Number

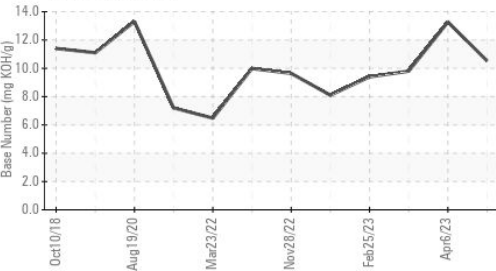

Viscosity @ 100°C

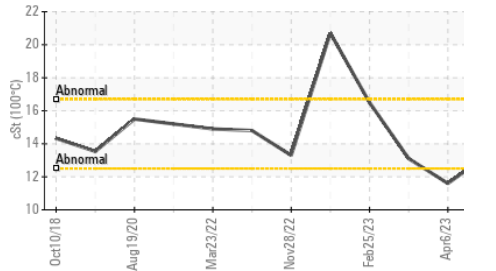

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>8195</b>	7943	---
Particles >6µm	ASTM D7647	>5000	<b>4464</b>	4327	---
Particles >14µm	ASTM D7647	>640	▲ <b>760</b>	▲ 736	---
Particles >21µm	ASTM D7647	>160	▲ <b>256</b>	▲ 248	---
Particles >38µm	ASTM D7647	>40	<b>40</b>	38	---
Particles >71µm	ASTM D7647	>10	<b>4</b>	4	---
Oil Cleanliness	ISO 4406 (c)	>19/16	▲ <b>19/17</b>	▲ 19/17	---


FLUID DEGRADATION	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm *ASTM D7414	>25	<b>6.9</b>	10.4	5.6
Base Number (BN)	mg KOH/g ASTM D2896		<b>10.52</b>	13.27	9.8

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar *Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar *Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar *Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar *Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar *Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar *Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar *Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar *Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar *Visual	>0.2	<b>NEG</b>	NEG	NEG
Free Water	scalar *Visual		<b>NEG</b>	NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt ASTM D445		<b>13.3</b>	11.6	13.1

### GRAPHS


Ferrous Alloys

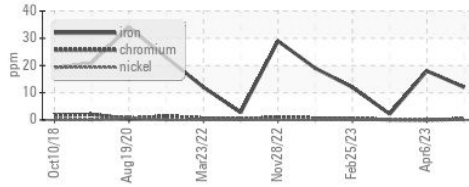


Non-ferrous Metals

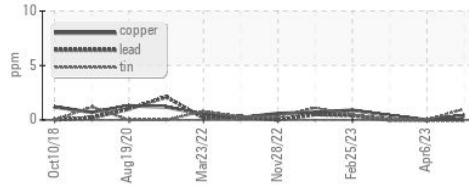


Viscosity @ 100°C

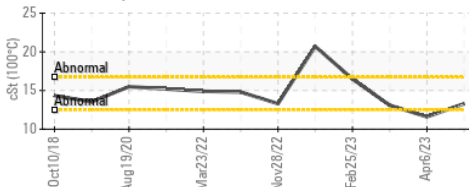

▲ Particle Count

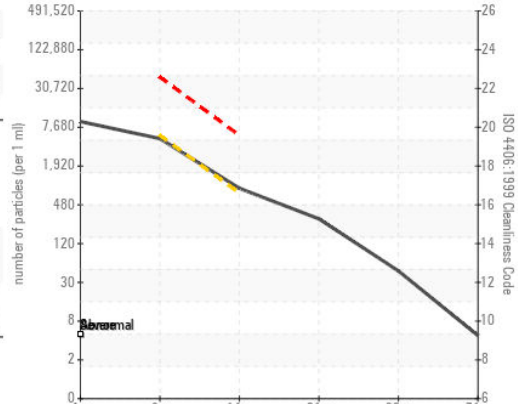

Base Number

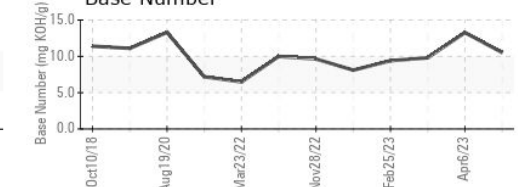

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KL0012870 **Received** : 29 Sep 2023  
**Lab Number** : 05964771 **Diagnosed** : 02 Oct 2023  
**Unique Number** : 10671322 **Diagnostician** : Don Baldrige  
**Test Package** : MOB 2 ( Additional Tests: PrtCount )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**CONOR**  
 JUAREZ 348  
 HERMOSILLO,  
 MX 83140  
 Contact: EDUARDO GARCIA  
 egarcia.comsa@gmail.com  
 T: (526)622-1581 x:81  
 F: x: