

OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



302 F EXT

Component **Gearbox**

NOT GIVEN (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

Wear

All component wear rates are normal.


Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		,		Sep2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		PH0001268		
Sample Date		Client Info		27 Sep 2023		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>200	8		
Chromium	ppm	ASTM D5185m	>15	0		
Nickel	ppm	ASTM D5185m	>15	0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	<1		
Lead	ppm	ASTM D5185m	>100	0		
Copper	ppm	ASTM D5185m	>200	0		
Tin	ppm	ASTM D5185m	>25	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		26		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m		2		
Calcium	ppm	ASTM D5185m		15		
Phosphorus	ppm	ASTM D5185m		254		
Zinc	ppm	ASTM D5185m		0		
Sulfur	ppm	ASTM D5185m		7646		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	<1		
Sodium	ppm	ASTM D5185m		0		
Potassium	ppm	ASTM D5185m	>20	0		
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>20000	14540		
Particles >6µm		ASTM D7647	>5000	1118		
Particles >14µm		ASTM D7647	>640	21		
Particles >21µm		ASTM D7647	>160	3		
Particles >38µm		ASTM D7647	>40	0		
Particles >71μm		ASTM D7647	>10	0		
Oil Cleanliness		ISO 4406 (c)	>21/19/16	21/17/12		



Report Id: PLAADR [WUSCAR] 05965369 (Generated: 10/20/2023 11:58:03) Rev: 1

mg KOH/g ASTM D8045


FLUID DEGRADATION

Acid Number (AN)

0.53



OIL ANALYSIS REPORT

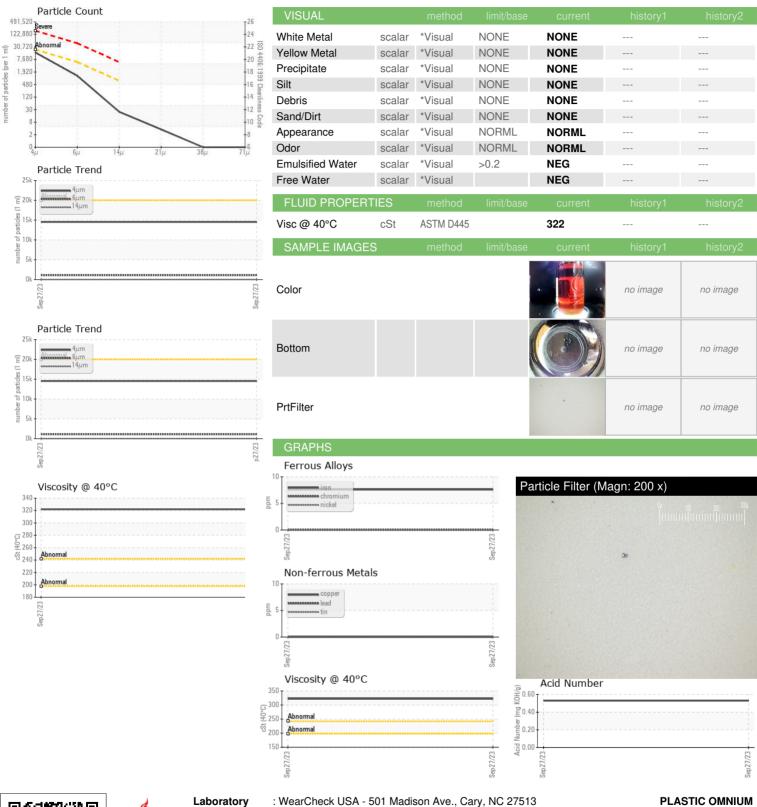





Certificate L2367

Laboratory Sample No. Lab Number Unique Number

: 05965369

: PH0001268 : 10671920

Received Diagnosed

: 04 Oct 2023 : Jonathan Hester Diagnostician

: 29 Sep 2023

Test Package : PLANT (Additional Tests: PrtFilter) To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) 1549 W BEECHER RD ADRIAN, MI

US 49221

Contact: Service Manager

T: F: