




PROBLEM SUMMARY


Sample Rating Trend

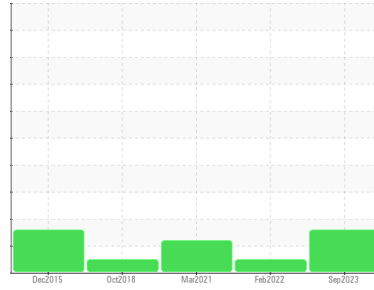

Machine Id
KAESER CSD 125 5126552 (S/N 1028)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

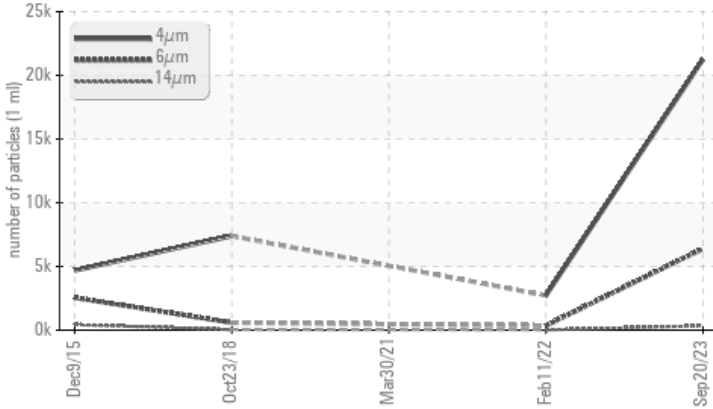

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	NORMAL	ABNORMAL
Particles >6µm	ASTM D7647	>1300	▲ 6400	353	---
Particles >14µm	ASTM D7647	>80	▲ 339	21	---
Particles >21µm	ASTM D7647	>20	▲ 87	7	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 22/20/16	16/12	---

Customer Id: ATRDAL
 Sample No.: KCPA000835
 Lab Number: 05965387
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

11 Feb 2022 Diag: Angela Borella

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



30 Mar 2021 Diag: Don Baldrige

WEAR



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample. The tin level is abnormal. All other component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



23 Oct 2018 Diag: Don Baldrige

NORMAL




Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



OIL ANALYSIS REPORT

Sample Rating Trend

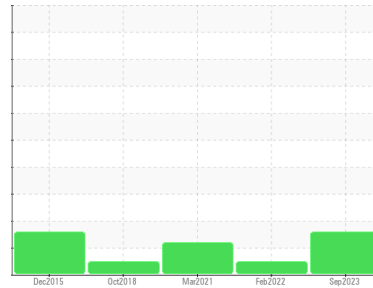

ISO



Machine Id
KAESER CSD 125 5126552 (S/N 1028)

Component
Compressor

Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KCPA000835	KCP41249	KCP37205
Sample Date	Client Info	20 Sep 2023	11 Feb 2022	30 Mar 2021
Machine Age	hrs	0	6426	0
Oil Age	hrs	0	1076	0
Oil Changed	Client Info	N/A	Not Changd	Changed
Sample Status		ABNORMAL	NORMAL	ABNORMAL

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	<1	0	0
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	0	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	<1
Aluminum	ppm	ASTM D5185m >10	5	0	0
Lead	ppm	ASTM D5185m >10	0	0	0
Copper	ppm	ASTM D5185m >50	<1	5	9
Tin	ppm	ASTM D5185m >10	3	2	▲ 27
Antimony	ppm	ASTM D5185m	---	0	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	<1	0
Barium	ppm	ASTM D5185m 90	50	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	0	0
Magnesium	ppm	ASTM D5185m 90	60	0	<1
Calcium	ppm	ASTM D5185m 2	1	0	0
Phosphorus	ppm	ASTM D5185m	2	<1	<1
Zinc	ppm	ASTM D5185m	0	0	0
Sulfur	ppm	ASTM D5185m	18006	11285	13771

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	<1	<1	2
Sodium	ppm	ASTM D5185m	6	0	0
Potassium	ppm	ASTM D5185m >20	3	<1	<1
Water	%	ASTM D6304 >0.05	0.022	0.007	0.009
ppm Water	ppm	ASTM D6304 >500	222.3	75.4	94.9






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	21247	2713	---
Particles >6µm	ASTM D7647 >1300	▲ 6400	353	---
Particles >14µm	ASTM D7647 >80	▲ 339	21	---
Particles >21µm	ASTM D7647 >20	▲ 87	7	---
Particles >38µm	ASTM D7647 >4	2	1	---
Particles >71µm	ASTM D7647 >3	0	0	---
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ 22/20/16	16/12	---

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.41	0.403	0.364

OIL ANALYSIS REPORT

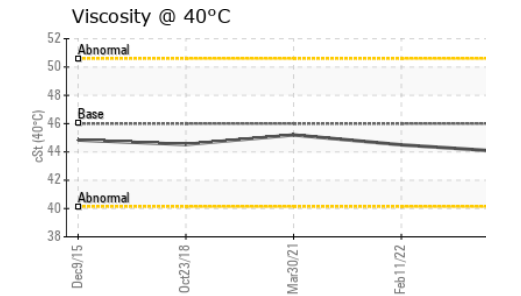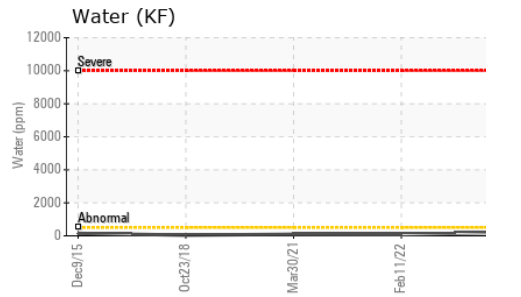
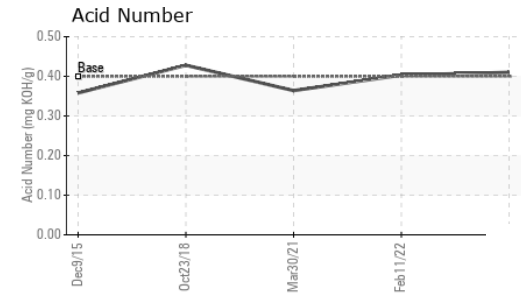
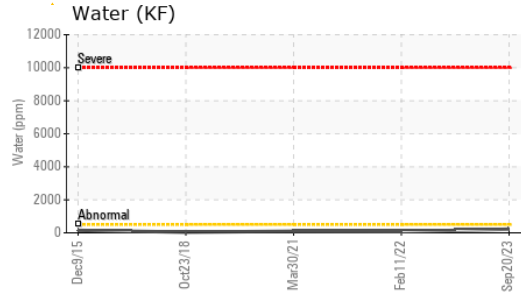
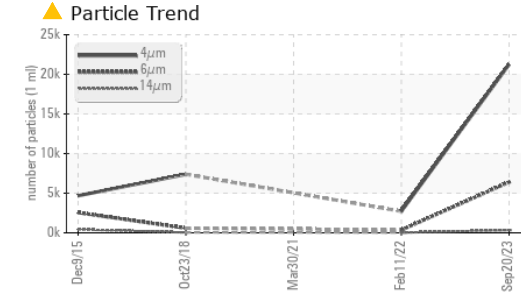


PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	44.0	44.5	45.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

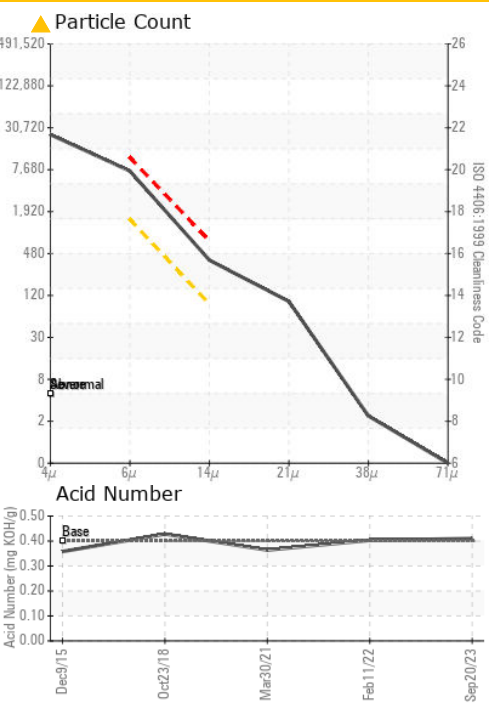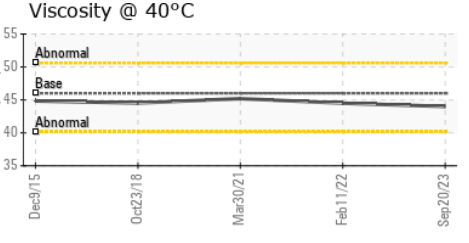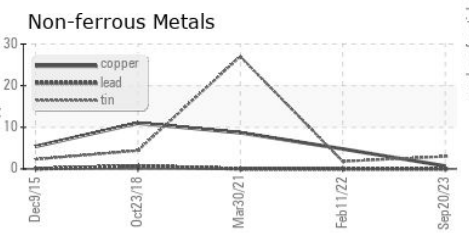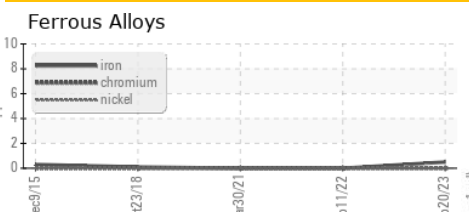

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA000835 **Received** : 29 Sep 2023
Lab Number : 05965387 **Diagnosed** : 02 Oct 2023
Unique Number : 10671938 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

ATRIUM WINDOW AND DOOR
 9001 AMBASSADOR ROW
 DALLAS, TX
 US 75247
 Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)