




PROBLEM SUMMARY

Sample Rating Trend

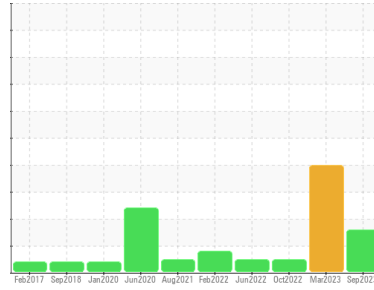

WATER




Machine Id
KAESER ASD 40T 4769597 (S/N 1167)

Component
Compressor

Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Water (KF)

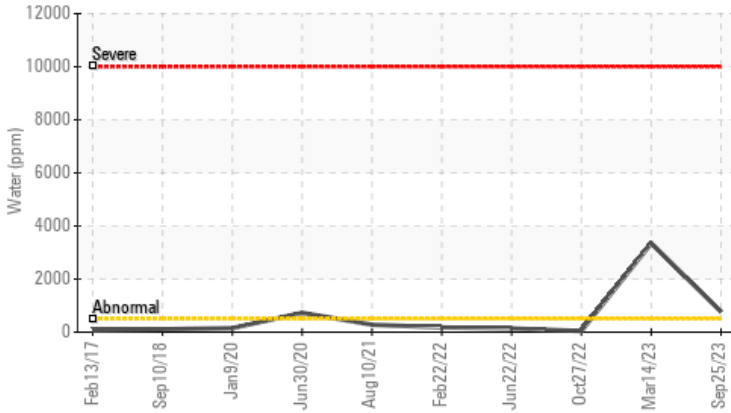

RECOMMENDATION

The filter change at the time of sampling has been noted. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	ABNORMAL	NORMAL
Water	%	ASTM D6304	>0.05	▲ 0.077	▲ 0.335	0.004
ppm Water	ppm	ASTM D6304	>500	▲ 770	▲ 3350	43.6
Emulsified Water	scalar	*Visual	>0.05	▲ 0.2%	▲ 0.2%	NEG

Customer Id: SPXCAR
 Sample No.: KCPA000962
 Lab Number: 05965390
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Jonathan Hester +1 919-379-4092 x4092
jhester@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

14 Mar 2023 Diag: Angela Borella

WATER



The filter change at the time of sampling has been noted. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. There is a light concentration of water present in the oil. Free water present. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

[view report](#)



27 Oct 2022 Diag: Don Baldrige

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



22 Jun 2022 Diag: Don Baldrige

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


[view report](#)





OIL ANALYSIS REPORT

Sample Rating Trend

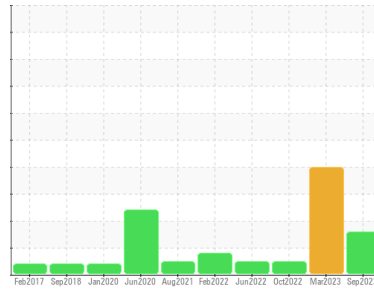

WATER



Machine Id
KAESER ASD 40T 4769597 (S/N 1167)

Component
Compressor
Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

The filter change at the time of sampling has been noted. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

Wear

All component wear rates are normal.

▲ Contamination

There is a light concentration of water present in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KCPA000962	KCPA001455	KCP46881D
Sample Date	Client Info	25 Sep 2023	14 Mar 2023	27 Oct 2022
Machine Age	hrs	31357	29231	27433
Oil Age	hrs	0	0	0
Oil Changed	Client Info	Not Chngd	N/A	Not Chngd
Sample Status		ABNORMAL	ABNORMAL	NORMAL

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	0	3	<1
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	2	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	1	0
Aluminum	ppm	ASTM D5185m >10	4	<1	0
Lead	ppm	ASTM D5185m >10	0	0	0
Copper	ppm	ASTM D5185m >50	17	10	10
Tin	ppm	ASTM D5185m >10	0	0	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m 0	0	0	0
Barium	ppm	ASTM D5185m 90	0	6	0
Molybdenum	ppm	ASTM D5185m 0	0	<1	0
Manganese	ppm	ASTM D5185m	0	1	<1
Magnesium	ppm	ASTM D5185m 100	3	16	7
Calcium	ppm	ASTM D5185m 0	0	7	0
Phosphorus	ppm	ASTM D5185m 0	1	0	2
Zinc	ppm	ASTM D5185m 0	0	21	11
Sulfur	ppm	ASTM D5185m 23500	12758	19203	19905

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	0	<1	<1
Sodium	ppm	ASTM D5185m	0	3	2
Potassium	ppm	ASTM D5185m >20	0	0	1
Water	%	ASTM D6304 >0.05	▲ 0.077	▲ 0.335	0.004
ppm Water	ppm	ASTM D6304 >500	▲ 770	▲ 3350	43.6






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	1464	---	3163
Particles >6µm	ASTM D7647 >1300	173	---	509
Particles >14µm	ASTM D7647 >80	18	---	21
Particles >21µm	ASTM D7647 >20	6	---	4
Particles >38µm	ASTM D7647 >4	1	---	0
Particles >71µm	ASTM D7647 >3	0	---	0
Oil Cleanliness	ISO 4406 (c) >--/17/13	18/15/11	---	19/16/12

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.33	0.37	0.32


OIL ANALYSIS REPORT

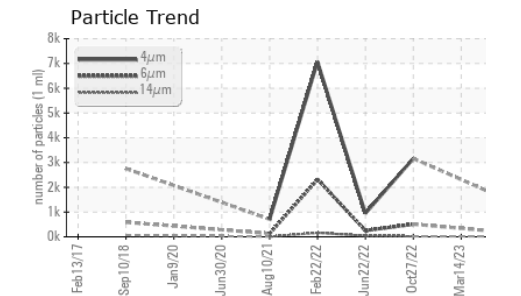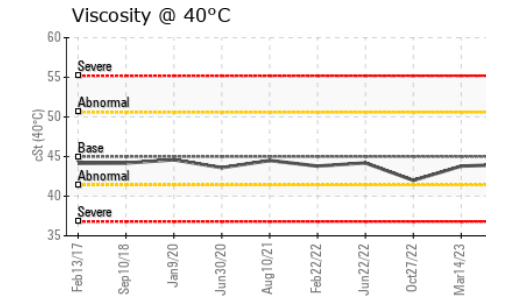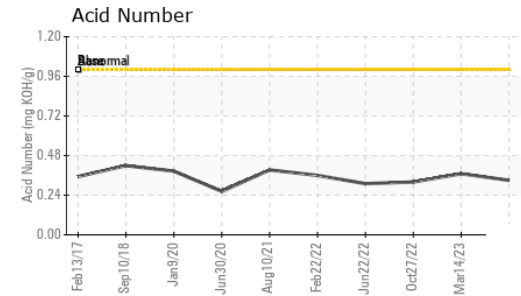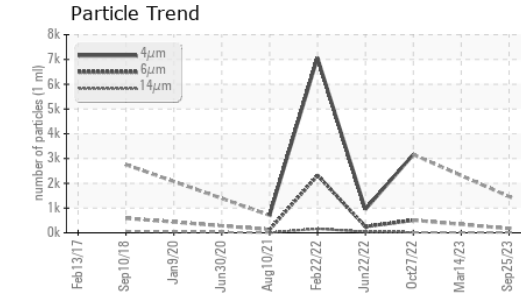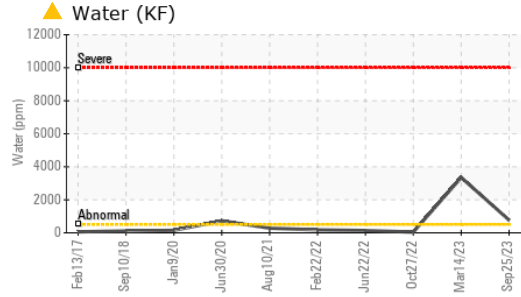






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	▲ HAZY	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	▲ 0.2%	NEG
Free Water	scalar	*Visual		▲ 1.0	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 45	44.0	43.8	42.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

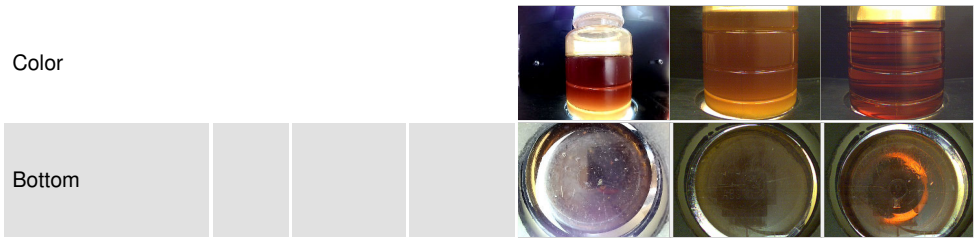

GRAPHS

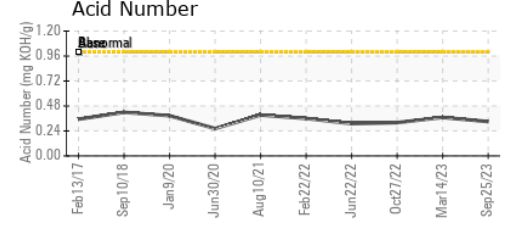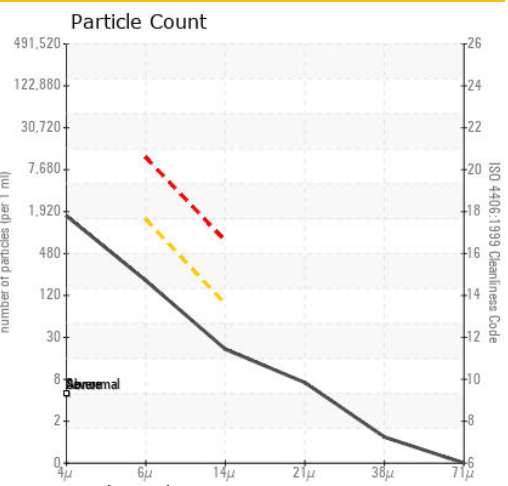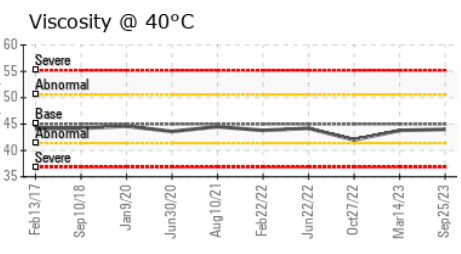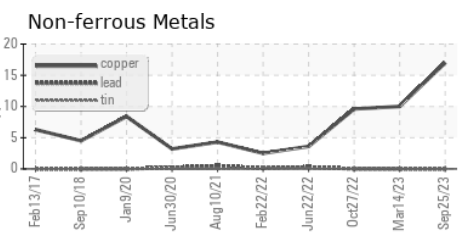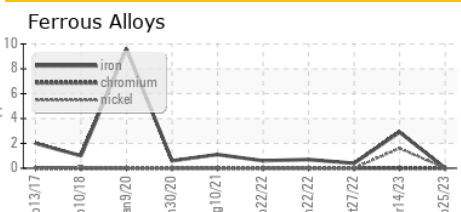

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA000962
Lab Number : 05965390
Unique Number : 10671941
Test Package : IND 2 (Additional Tests: KF, PrtCount)

4 FRONT
 1612 HUTTON DR. #140
 CARROLLTON, TX
 US 75006
 Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: