




PROBLEM SUMMARY

Sample Rating Trend

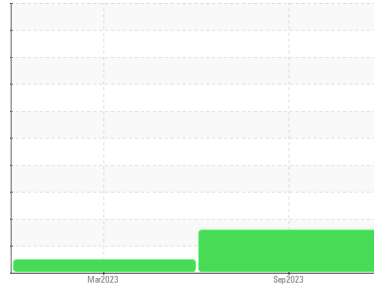

ISO




Machine Id
7978284 (S/N 1132)

Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- QTS)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

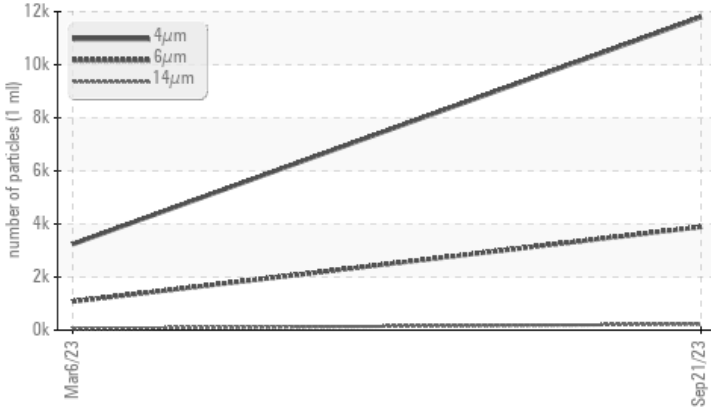

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

| Sample Status | | | ABNORMAL | NORMAL | --- |
|-----------------|--------------|-----------|-------------------|----------|-----|
| Particles >6µm | ASTM D7647 | >1300 | ▲ 3889 | 1079 | --- |
| Particles >14µm | ASTM D7647 | >80 | ▲ 226 | 62 | --- |
| Particles >21µm | ASTM D7647 | >20 | ▲ 36 | 10 | --- |
| Oil Cleanliness | ISO 4406 (c) | >--/17/13 | ▲ 21/19/15 | 19/17/13 | --- |

Customer Id: DOOFOR
Sample No.: KCPA000822
Lab Number: 05965392
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

06 Mar 2023 Diag: Don Baldrige

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

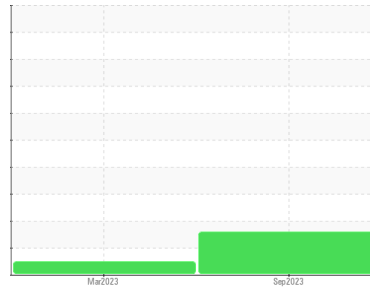

ISO



Machine Id
7978284 (S/N 1132)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- QTS)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

| | method | limit/base | current | history1 | history2 |
|---------------|-------------|-------------|--------------------|-------------|----------|
| Sample Number | Client Info | | KCPA000822 | KCPA000169 | --- |
| Sample Date | Client Info | | 21 Sep 2023 | 06 Mar 2023 | --- |
| Machine Age | hrs | Client Info | 1204 | 725 | --- |
| Oil Age | hrs | Client Info | 0 | 0 | --- |
| Oil Changed | Client Info | | Not Chngd | N/A | --- |
| Sample Status | | | ABNORMAL | NORMAL | --- |

WEAR METALS

| | method | limit/base | current | history1 | history2 |
|----------|--------|-----------------|----------|----------|----------|
| Iron | ppm | ASTM D5185m >50 | 0 | <1 | --- |
| Chromium | ppm | ASTM D5185m >10 | 0 | 0 | --- |
| Nickel | ppm | ASTM D5185m >3 | 0 | 0 | --- |
| Titanium | ppm | ASTM D5185m >3 | 0 | 0 | --- |
| Silver | ppm | ASTM D5185m >2 | 0 | 0 | --- |
| Aluminum | ppm | ASTM D5185m >10 | 4 | <1 | --- |
| Lead | ppm | ASTM D5185m >10 | 0 | 0 | --- |
| Copper | ppm | ASTM D5185m >50 | 2 | 3 | --- |
| Tin | ppm | ASTM D5185m >10 | 0 | 0 | --- |
| Vanadium | ppm | ASTM D5185m | 0 | 0 | --- |
| Cadmium | ppm | ASTM D5185m | 0 | 0 | --- |

ADDITIVES

| | method | limit/base | current | history1 | history2 |
|------------|--------|----------------|--------------|----------|----------|
| Boron | ppm | ASTM D5185m | 0 | 0 | --- |
| Barium | ppm | ASTM D5185m 90 | 11 | 12 | --- |
| Molybdenum | ppm | ASTM D5185m | 0 | 0 | --- |
| Manganese | ppm | ASTM D5185m | 0 | <1 | --- |
| Magnesium | ppm | ASTM D5185m 90 | 67 | 54 | --- |
| Calcium | ppm | ASTM D5185m 2 | 0 | 1 | --- |
| Phosphorus | ppm | ASTM D5185m | 7 | 0 | --- |
| Zinc | ppm | ASTM D5185m | 7 | 8 | --- |
| Sulfur | ppm | ASTM D5185m | 17892 | 19673 | --- |

CONTAMINANTS

| | method | limit/base | current | history1 | history2 |
|-----------|--------|------------------|--------------|----------|----------|
| Silicon | ppm | ASTM D5185m >25 | <1 | <1 | --- |
| Sodium | ppm | ASTM D5185m | 16 | 12 | --- |
| Potassium | ppm | ASTM D5185m >20 | 6 | 11 | --- |
| Water | % | ASTM D6304 >0.05 | 0.026 | 0.021 | --- |
| ppm Water | ppm | ASTM D6304 >500 | 263.2 | 215.6 | --- |






FLUID CLEANLINESS

| | method | limit/base | current | history1 | history2 |
|-----------------|------------------|------------|-------------------|----------|----------|
| Particles >4µm | ASTM D7647 | | 11793 | 3237 | --- |
| Particles >6µm | ASTM D7647 >1300 | | ▲ 3889 | 1079 | --- |
| Particles >14µm | ASTM D7647 >80 | | ▲ 226 | 62 | --- |
| Particles >21µm | ASTM D7647 >20 | | ▲ 36 | 10 | --- |
| Particles >38µm | ASTM D7647 >4 | | 1 | 0 | --- |
| Particles >71µm | ASTM D7647 >3 | | 0 | 0 | --- |
| Oil Cleanliness | ISO 4406 (c) | >--/17/13 | ▲ 21/19/15 | 19/17/13 | --- |

FLUID DEGRADATION

| | method | limit/base | current | history1 | history2 |
|------------------|----------|----------------|-------------|----------|----------|
| Acid Number (AN) | mg KOH/g | ASTM D8045 0.4 | 0.12 | 0.34 | --- |


OIL ANALYSIS REPORT

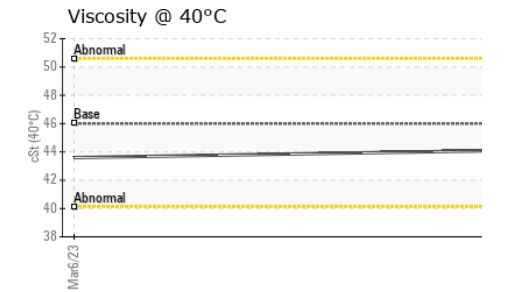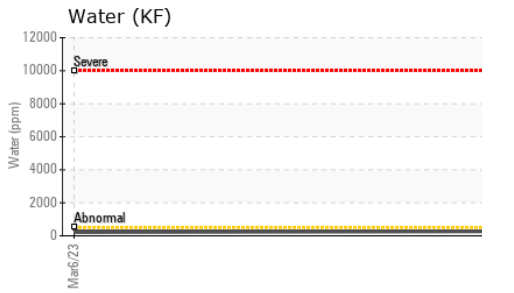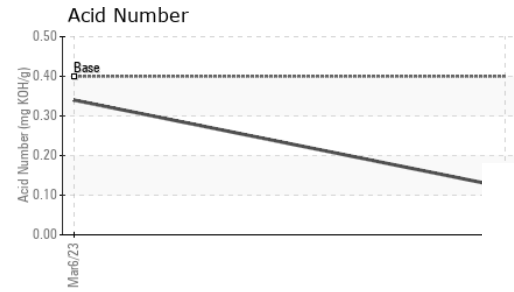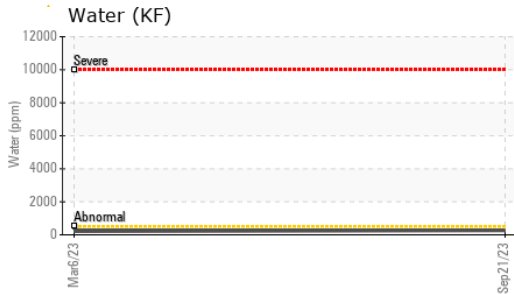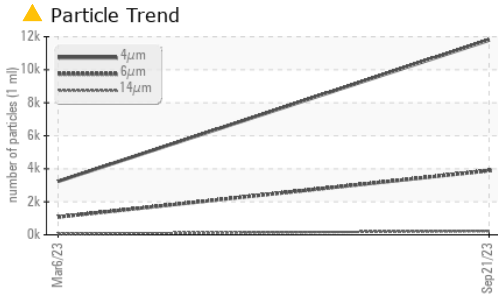






| PARAMETER | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal | scalar | *Visual | NONE | NONE | --- |
| Yellow Metal | scalar | *Visual | NONE | NONE | --- |
| Precipitate | scalar | *Visual | NONE | NONE | --- |
| Silt | scalar | *Visual | NONE | NONE | --- |
| Debris | scalar | *Visual | NONE | NONE | --- |
| Sand/Dirt | scalar | *Visual | NONE | NONE | --- |
| Appearance | scalar | *Visual | NORML | NORML | --- |
| Odor | scalar | *Visual | NORML | NORML | --- |
| Emulsified Water | scalar | *Visual | >0.05 | NEG | --- |
| Free Water | scalar | *Visual | | NEG | --- |

| PARAMETER | method | limit/base | current | history1 | history2 |
|-------------|--------|------------|---------|----------|----------|
| Visc @ 40°C | cSt | ASTM D445 | 46 | 43.6 | --- |

SAMPLE IMAGES

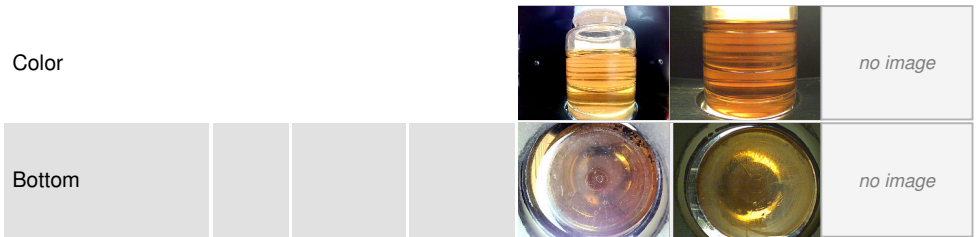

GRAPHS

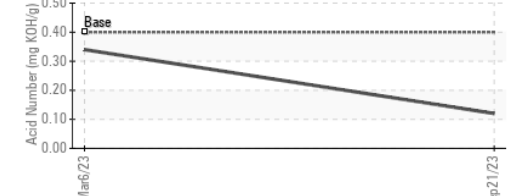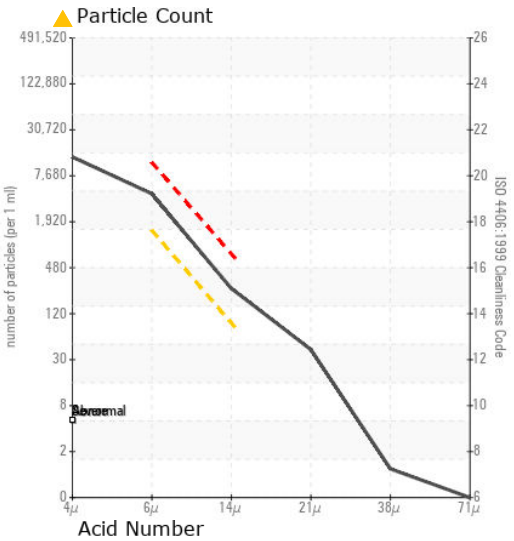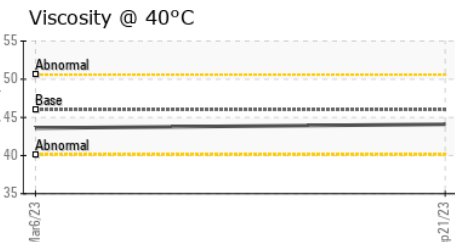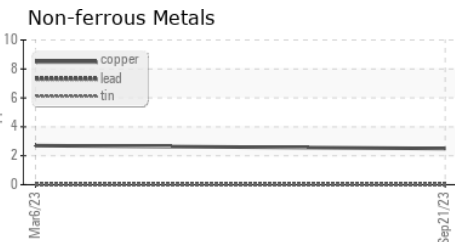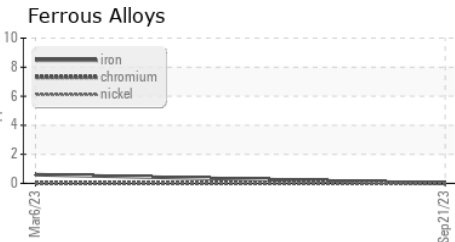

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA000822 **Received** : 29 Sep 2023
Lab Number : 05965392 **Diagnosed** : 02 Oct 2023
Unique Number : 10671943 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

DOOR COMPONENTS
 8300 S FWY
 FORT WORTH, TX
 US 76134
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: