


# PROBLEM SUMMARY

## Sample Rating Trend



ISO

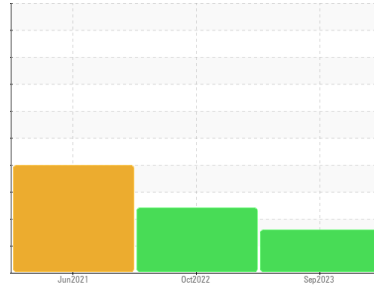


Machine Id  
**4922827 (S/N 1139)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

## COMPONENT CONDITION SUMMARY

### ▲ Particle Trend

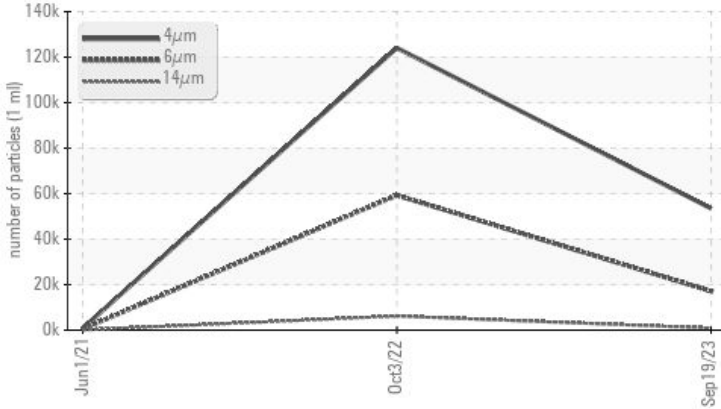

## RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ABNORMAL	ABNORMAL
Particles >6µm	ASTM D7647	>1300	▲ <b>17111</b>	▲ 59292	443
Particles >14µm	ASTM D7647	>80	▲ <b>884</b>	▲ 6173	75
Particles >21µm	ASTM D7647	>20	▲ <b>137</b>	▲ 1205	25
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ <b>23/21/17</b>	▲ 24/23/20	16/13

Customer Id: SCHFTWTX  
Sample No.: KCPA000600  
Lab Number: 05965393  
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
Don Baldrige +1  
[don.b505@comcast.net](mailto:don.b505@comcast.net)

To change component or sample information:  
Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

*There are no recommended actions for this sample.*

## HISTORICAL DIAGNOSIS

### 03 Oct 2022 Diag: Doug Bogart

ISO



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 01 Jun 2021 Diag: Jonathan Hester

WATER




Oil and filter change at the time of sampling has been noted. We recommend an early resample in 500 hours to monitor this condition. The copper level is abnormal. All other component wear rates are normal. Free water present. There is a moderate concentration of water present in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



# OIL ANALYSIS REPORT

Sample Rating Trend

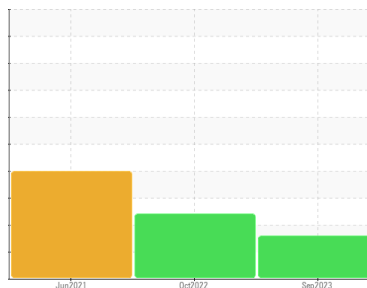

Machine Id  
**4922827 (S/N 1139)**

Component  
**Compressor**  
Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

## DIAGNOSIS

### ▲ Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### ▲ Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA000600</b>	KCP50188	KCP32780
Sample Date	Client Info			<b>19 Sep 2023</b>	03 Oct 2022	01 Jun 2021
Machine Age	hrs	Client Info		<b>4342</b>	3946	3529
Oil Age	hrs	Client Info		<b>0</b>	417	3000
Oil Changed	Client Info			<b>N/A</b>	Changed	Changed
Sample Status				<b>ABNORMAL</b>	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>1</b>	<1	3
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	<1	<1
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>4</b>	0	0
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>7</b>	16	▲ 74
Tin	ppm	ASTM D5185m	>10	<b>0</b>	<1	0
Antimony	ppm	ASTM D5185m		<b>---</b>	---	4
Vanadium	ppm	ASTM D5185m		<b>0</b>	<1	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<b>0</b>	0	12
Barium	ppm	ASTM D5185m	90	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	<1	0
Manganese	ppm	ASTM D5185m		<b>0</b>	1	<1
Magnesium	ppm	ASTM D5185m	100	<b>37</b>	7	<1
Calcium	ppm	ASTM D5185m	0	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	0	<b>4</b>	16	52
Zinc	ppm	ASTM D5185m	0	<b>36</b>	36	6
Sulfur	ppm	ASTM D5185m	23500	<b>18480</b>	19614	10639

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	<1	<1
Sodium	ppm	ASTM D5185m		<b>23</b>	6	1
Potassium	ppm	ASTM D5185m	>20	<b>4</b>	0	0
Water	%	ASTM D6304	>0.05	<b>0.013</b>	0.037	▲ 0.367
ppm Water	ppm	ASTM D6304	>500	<b>137.4</b>	376.6	▲ 3670

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>53508</b>	124071	813
Particles >6µm		ASTM D7647	>1300	▲ <b>17111</b>	▲ 59292	443
Particles >14µm		ASTM D7647	>80	▲ <b>884</b>	▲ 6173	75
Particles >21µm		ASTM D7647	>20	▲ <b>137</b>	▲ 1205	25
Particles >38µm		ASTM D7647	>4	<b>1</b>	▲ 102	4
Particles >71µm		ASTM D7647	>3	<b>0</b>	▲ 8	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ <b>23/21/17</b>	▲ 24/23/20	16/13

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	<b>0.24</b>	0.26	0.262


# OIL ANALYSIS REPORT

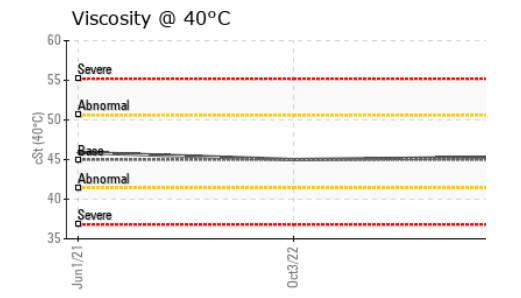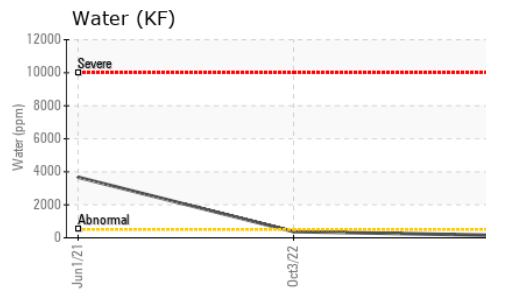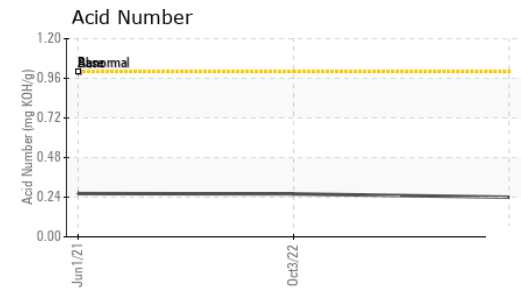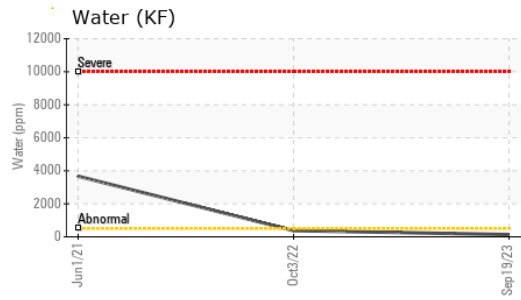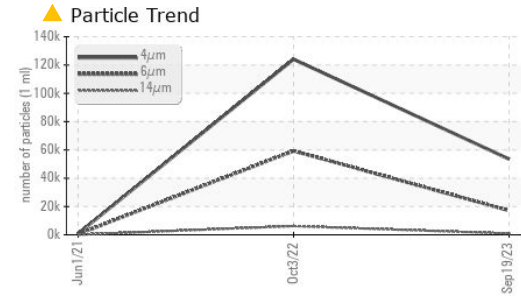





PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	▲ 1.0

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 45	45.3	45.0	45.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

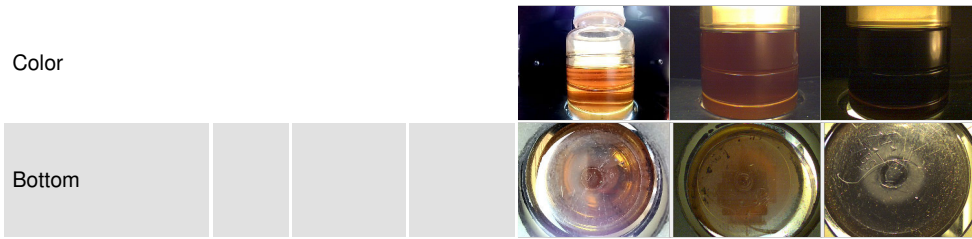

## GRAPHS

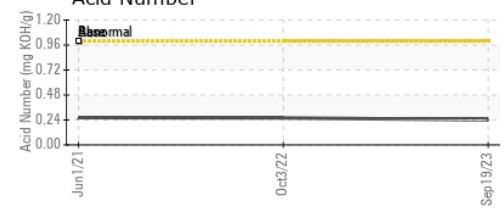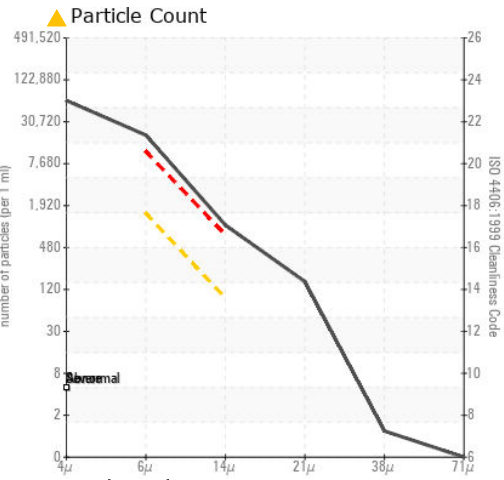

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA000600 **Received** : 29 Sep 2023  
**Lab Number** : 05965393 **Diagnosed** : 02 Oct 2023  
**Unique Number** : 10671944 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**SCHUMACHER ELECTRIC**  
 14200 FAA BLVD  
 FT WORTH, TX  
 US 76155  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)