

# **PROBLEM SUMMARY**

Sample Rating Trend

ISO

Machine Id


# KAESER ASD 40T 4772848 (S/N 1169)

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

### **COMPONENT CONDITION SUMMARY**

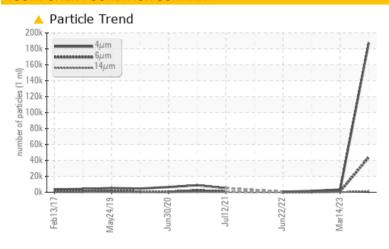

### RECOMMENDATION

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS									
Sample Status			ABNORMAL	ATTENTION	NORMAL				
Particles >6µm	ASTM D7647	>1300	<b>43897</b>	1024	400				
Particles >14µm	ASTM D7647	>80	<b>1480</b>	<u>▲</u> 122	27				
Particles >21µm	ASTM D7647	>20	<b>550</b>	<b>^</b> 30	10				
Particles >38µm	ASTM D7647	>4	<u> </u>	1	1				
Oil Cleanliness	ISO 4406 (c)	>/17/13	<b>25/23/18</b>	<b>1</b> 9/17/14	18/16/12				

Customer Id: SPXCAR Sample No.: KCPA001034 Lab Number: 05965397 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Jonathan Hester +1 919-379-4092 x4092 jhester@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

### **RECOMMENDED ACTIONS**

There are no recommended actions for this sample.

### HISTORICAL DIAGNOSIS

### 14 Mar 2023 Diag: Angela Borella

ISO



The oil change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.



### 27 Oct 2022 Diag: Don Baldridge

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



### 22 Jun 2022 Diag: Don Baldridge

NORMAL




Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





# **OIL ANALYSIS REPORT**

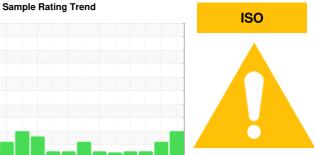

# KAESER ASD 40T 4772848 (S/N 1169)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

## **DIAGNOSIS**

### Recommendation

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Feb2017	May2019 Jun2020	Jul2021 Jun2022 Ma	w2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA001034	KCPA001532	KCP46882D
Sample Date		Client Info		25 Sep 2023	14 Mar 2023	27 Oct 2022
Machine Age	hrs	Client Info		38993	37088	35910
Oil Age	hrs	Client Info		0	0	5032
Oil Changed		Client Info		Not Changd	Changed	Not Changd
Sample Status				ABNORMAL	ATTENTION	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	7	1	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	4	<1	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	8	5	5
Tin	ppm	ASTM D5185m	>10	0	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	<1	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	1	0
Magnesium	ppm	ASTM D5185m	90	3	24	<1
Calcium	ppm	ASTM D5185m	2	0	0	0
Phosphorus	ppm	ASTM D5185m		1	13	2
Zinc	ppm	ASTM D5185m		0	15	0
Sulfur	ppm	ASTM D5185m		14219	15967	14750
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	<1	<1
Sodium	ppm	ASTM D5185m		<1	3	0
Potassium	ppm	ASTM D5185m	>20	0	1	<1
Water	%	ASTM D6304	>0.05	0.005	0.017	0.003
ppm Water	ppm	ASTM D6304	>500	57.8	179.5	38.2
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		187488	3399	1666
Particles >6µm		ASTM D7647	>1300	<b>43897</b>	1024	400
Particles >14µm		ASTM D7647	>80	<u> </u>	<u>▲</u> 122	27
Particles >21µm		ASTM D7647	>20	<u></u> 550	<b>△</b> 30	10
Particles >38µm		ASTM D7647	>4	<u> </u>	1	1
Particles >71µm		ASTM D7647	>3	1	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>\$\text{\Delta}\$ 25/23/18</u>	<u> </u>	18/16/12
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.33	0.38	0.38



## **OIL ANALYSIS REPORT**

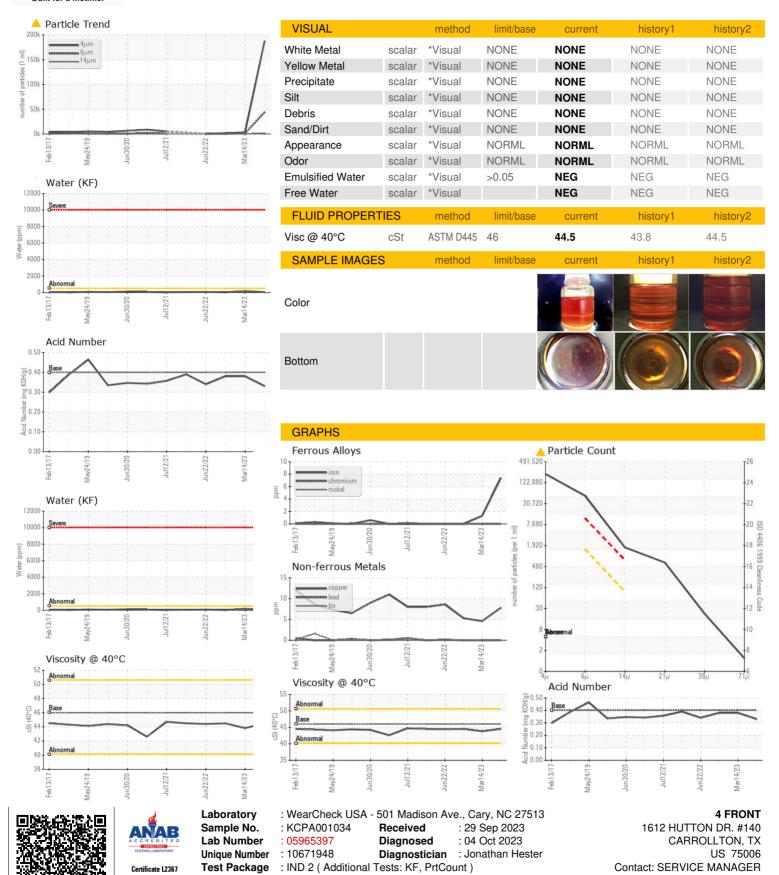

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: