


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Machine Id **1855182 (S/N 1167)**

Component

Compressor Fluid

KAESER SIGMA (OEM) M-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

CANADI E INICODA	AATION		Nov2021	Sep2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA006410	KCP39967	
Sample Date		Client Info		25 Sep 2023	10 Nov 2021	
Machine Age	hrs	Client Info		42841	39484	
Oil Age	hrs	Client Info		0	0	
Oil Changed		Client Info		N/A	Changed	
Sample Status				NORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	<1	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	4	<1	
Lead	ppm	ASTM D5185m	>10	0	1	
Copper	ppm	ASTM D5185m	>50	2	4	
Tin	ppm	ASTM D5185m	>10	0	0	
Antimony	ppm	ASTM D5185m			0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	15	
Barium	ppm	ASTM D5185m	90	0	0	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m	100	9	<1	
Calcium	ppm	ASTM D5185m	0	0	10	
Phosphorus	ppm	ASTM D5185m	0	<1	2	
Zinc	ppm	ASTM D5185m	0	4	<1	
Sulfur	ppm	ASTM D5185m	23500	18439	24327	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	2	
Sodium	ppm	ASTM D5185m		1	1	
Potassium	ppm	ASTM D5185m	>20	0	10	
Water	%	ASTM D6304	>0.05	0.005	0.010	
ppm Water	ppm	ASTM D6304	>500	58.8	109.0	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		2458		
Particles >6µm		ASTM D7647	>1300	592		
Particles >14µm		ASTM D7647	>80	48		
Particles >21µm		ASTM D7647	>20	13		
Particles >38μm		ASTM D7647	>4	1		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/16/13		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2


Acid Number (AN)

mg KOH/g ASTM D8045 1.0

0.433 Contact/Location: Service Manager - AZIUNI



OIL ANALYSIS REPORT

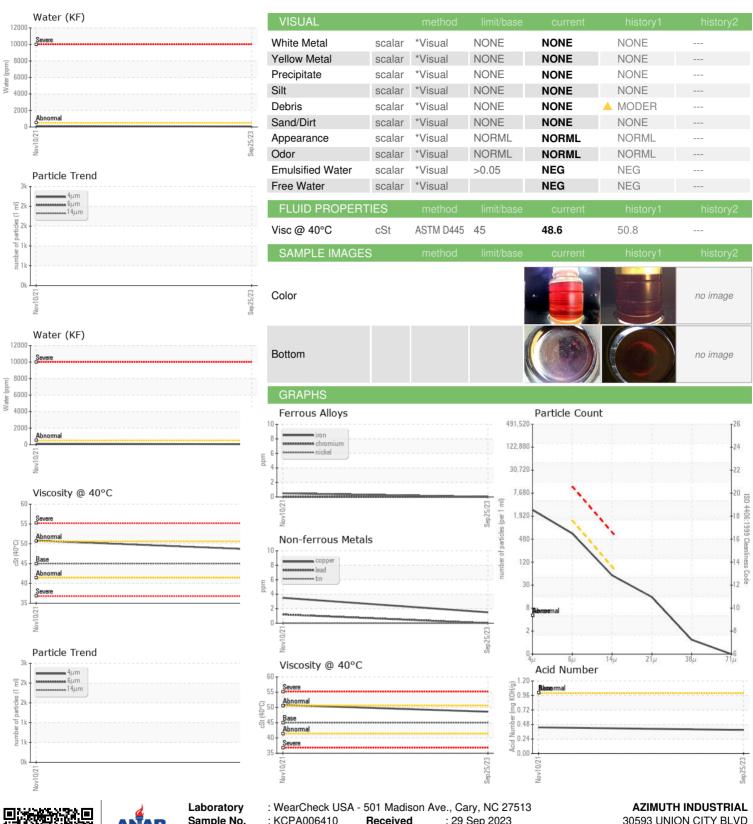



Sample No. Lab Number **Unique Number**

: KCPA006410 : 05965403

: 10671954

Received : 29 Sep 2023 : 04 Oct 2023 Diagnosed

Diagnostician : Jonathan Hester

Test Package : IND 2 (Additional Tests: KF, PrtCount) Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) 30593 UNION CITY BLVD UNION CITY, CA

US 94587 Contact: Service Manager

STSENG@AZIMUTHSEMI.COM

T: F: