

PROBLEM SUMMARY

Sample Rating Trend


VISCOSITY


Machine Id **6675792 (S/N 1263)**

Component Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

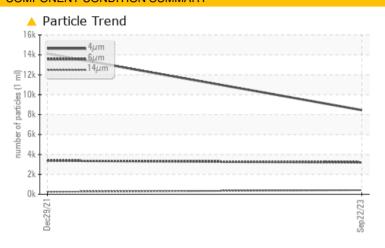

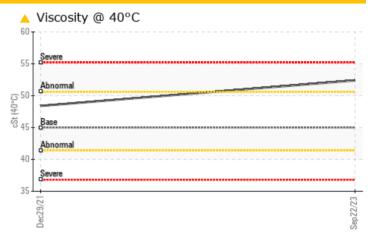

RECOMMENDATION

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS										
Sample Status				ABNORMAL	ABNORMAL					
Particles >6µm		ASTM D7647	>1300	△ 3199	<u>▲</u> 3371					
Particles >14µm		ASTM D7647	>80	419	<u>4</u> 249					
Particles >21µm		ASTM D7647	>20	126	△ 65					
Particles >38µm		ASTM D7647	>4	<u> </u>	2					
Particles >71µm		ASTM D7647	>3	<u>^</u> 2	0					
Oil Cleanliness		ISO 4406 (c)	>/17/13	20/19/16	<u> </u>					
Visc @ 40°C	cSt	ASTM D445	45	△ 52.4	48.4					

Customer Id: MONSOU Sample No.: KCPA000798 Lab Number: 05965404 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Jonathan Hester +1 919-379-4092 x4092 ihester@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

29 Dec 2021 Diag: Don Baldridge

ISO



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service





OIL ANALYSIS REPORT

Sample Rating Trend



VISCOSITY

6675792 (S/N 1263)

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The oil viscosity is higher than normal. The AN level is acceptable for this fluid.

			Dec2021	Sep2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA000798	KCP35275	
Sample Date		Client Info		22 Sep 2023	29 Dec 2021	
Machine Age	hrs	Client Info		24421	14944	
Oil Age	hrs	Client Info		0	6843	
Oil Changed		Client Info		N/A	Changed	
Sample Status				ABNORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	<1	
Aluminum	ppm	ASTM D5185m	>10	4	<1	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	6	7	
Tin	ppm	ASTM D5185m	>10	0	0	
Antimony	ppm	ASTM D5185m			0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	23	
Barium	ppm	ASTM D5185m	90	0	30	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m	100	4	33	
Calcium	ppm	ASTM D5185m	0	0	<1	
Phosphorus	ppm	ASTM D5185m	0	0	<1	
Zinc	ppm	ASTM D5185m	0	0	3	
Sulfur	ppm	ASTM D5185m	23500	16366	18567	
CONTAMINANTS	1	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	1	
Sodium	ppm	ASTM D5185m		0	1	
Potassium	ppm	ASTM D5185m	>20	0	0	
Water	%	ASTM D6304	>0.05	0.004	0.012	
ppm Water	ppm	ASTM D6304	>500	46.6	124.8	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		8453	14102	
Particles >6µm		ASTM D7647	>1300	△ 3199	<u>▲</u> 3371	
Particles >14μm		ASTM D7647	>80	419	<u>4</u> 249	
Particles >21μm		ASTM D7647	>20	<u> </u>	△ 65	
Particles >38μm		ASTM D7647	>4	<u> </u>	2	
Particles >71μm		ASTM D7647	>3	<u>^</u> 2	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>^</u> 20/19/16	△ 19/15	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	ma K∩∐/a	VSTM D804E	1.0	0.38	0.459	



OIL ANALYSIS REPORT







Certificate L2367

Sample No. Lab Number **Unique Number**

: KCPA000798 : 05965404

: 10671955

Received

Diagnosed

: 29 Sep 2023 : 05 Oct 2023 Diagnostician : Jonathan Hester

Test Package : IND 2 (Additional Tests: KF, PrtCount) To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

345 OYSTER POINT BLVD SOUTH SAN FRANCISCO, CA

US 94080

Contact: Service Manager

T:

F: