

PROBLEM SUMMARY

Sample Rating Trend

ISO

FRICK TYSNEWP2 5-H (S/N 1707E)


Refrigeration Compressor

USPI ALT-68 SC (--- GAL)





COMPONENT CONDITION SUMMARY

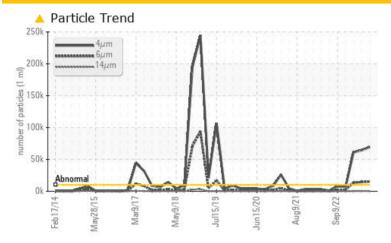

RECOMMENDATION

Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS								
Sample Status		Α	BNORMAL	ABNORMAL	ABNORMAL			
Particles >4µm	ASTM D7647	>10000	69233	<u>▲</u> 64341	<u>^</u> 61099			
Particles >6µm	ASTM D7647	>2500	15203	<u> </u>	<u> </u>			
Oil Cleanliness	ISO 4406 (c)	>20/18/15	23/21/15	23/21/16	<u>\$\Delta\$ 23/21/15</u>			

Customer Id: TYSNHOLP2 Sample No.: USP0001793 Lab Number: 05965452 Test Package: IND 2

To manage this report scan the QR code

To discuss the diagnosis or test data: Doug Bogart +1 (800)237-1369 x4016 dougb@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

16 Jun 2023 Diag: Doug Bogart

ISO



We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



22 Mar 2023 Diag: Doug Bogart

150



Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



13 Dec 2022 Diag: Doug Bogart

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

FRICK TYSNEWP2 5-H (S/N 1707E)

Component

Refrigeration Compressor

USPI ALT-68 SC (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

3/2014 May/2015 Mar/2017 May/2018 Jus/2019 Jus/2020 Aug/2021 Sag/2022								
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2		
Sample Number		Client Info		USP0001793	USP243419	USP246431		
Sample Date		Client Info		22 Sep 2023	16 Jun 2023	22 Mar 2023		
Machine Age	hrs	Client Info		158680	156838	154569		
Oil Age	hrs	Client Info		12796	101974	109068		
Oil Changed		Client Info		N/A	Not Changd	N/A		
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2		
Iron	ppm	ASTM D5185m	>8	<1	1	<1		
Chromium	ppm	ASTM D5185m	>2	0	0	0		
Nickel	ppm	ASTM D5185m		0	0	<1		
Titanium	ppm	ASTM D5185m		0	0	0		
Silver	ppm	ASTM D5185m	>2	0	0	<1		
Aluminum	ppm	ASTM D5185m	>3	1	0	<1		
Lead	ppm	ASTM D5185m	>2	0	0	0		
Copper	ppm	ASTM D5185m	>8	0	0	0		
Tin	ppm	ASTM D5185m	>4	0	0	0		
Vanadium	ppm	ASTM D5185m		0	0	0		
Cadmium	ppm	ASTM D5185m		0	0	0		
ADDITIVES		method	limit/base	current	history1	history2		
Boron	ppm	ASTM D5185m		0	0	0		
Barium	ppm	ASTM D5185m		0	0	0		
Molybdenum	ppm	ASTM D5185m		0	0	0		
Manganese	ppm	ASTM D5185m		<1	0	0		
Magnesium	ppm	ASTM D5185m		0	0	<1		
Calcium	ppm	ASTM D5185m		1	0	0		
Phosphorus	ppm	ASTM D5185m		0	1	1		
Zinc	ppm	ASTM D5185m		0	0	1		
Sulfur	ppm	ASTM D5185m	50	15	20	22		
CONTAMINANTS		method	limit/base	current	history1	history2		
Silicon	ppm	ASTM D5185m	>15	<1	0	1		
Sodium	ppm	ASTM D5185m		<1	0	<1		
Potassium	ppm	ASTM D5185m		1	0	<1		
Water	%	ASTM D6304	>0.01	0.004	0.007	0.002		
ppm Water	ppm	ASTM D6304	>100	41.1	71.5	24.9		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2		
Particles >4µm		ASTM D7647	>10000	△ 69233	<u>▲</u> 64341	△ 61099		
Particles >6µm		ASTM D7647	>2500	15203	<u>▲</u> 14564	<u>▲</u> 13436		
Particles >14µm		ASTM D7647	>320	198	▲ 383	274		
Particles >21µm		ASTM D7647	>80	15	53	14		
Particles >38µm		ASTM D7647	>20	1	0	0		
Particles >71µm		ASTM D7647	>4	0	0	0		
Oil Cleanliness		ISO 4406 (c)	>20/18/15	<u>23/21/15</u>	<u>\$\rightarrow\$ 23/21/16</u>	<u>\$\rightarrow\$ 23/21/15</u>		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2		
Acid Number (AN)	mg KOH/g	ASTM D974	0.005	0.041	0.015	0.014		



OIL ANALYSIS REPORT

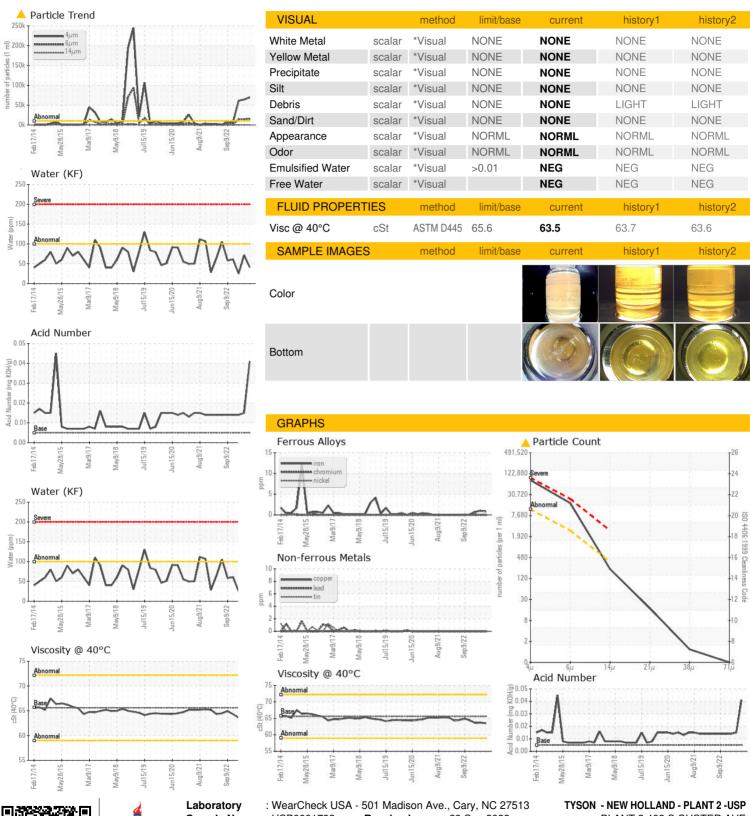



Certificate L2367

Sample No. Lab Number

Unique Number Test Package

: USP0001793 : 05965452 : 10672003 : IND 2

: 29 Sep 2023 Received

: 02 Oct 2023 Diagnosed Diagnostician : Doug Bogart PLANT 2 403 S CUSTER AVE

NEW HOLLAND, PA US 17557

Contact: RICK DUVALL

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (402)423-6661 Contact/Location: RICK DUVALL - TYSNHOLP2

T: (800)755-4572