




PROBLEM SUMMARY


Area
ULTRACLEAN
 Machine Id
SULLAIR 003-105918 - SPINNAKER COATING
 Component
Compressor

Sample Rating Trend

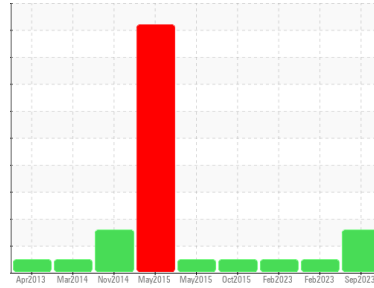

COMPONENT CONDITION SUMMARY

▲ Silicon (ppm)

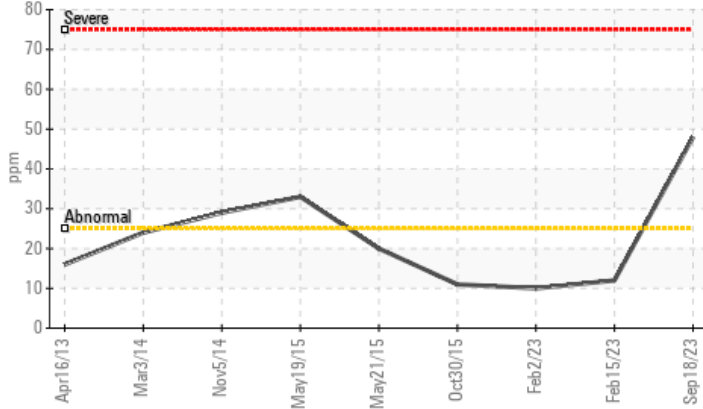

RECOMMENDATION

No corrective action is recommended at this time.
 Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status				ATTENTION	NORMAL	NORMAL
Silicon	ppm	ASTM D5185m	>25	▲ 48	12	10

Customer Id: UCAIRSID
 Sample No.: UCH05965477
 Lab Number: 05965477
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

15 Feb 2023 Diag: Doug Bogart

NORMAL



No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



02 Feb 2023 Diag: Don Baldrige

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the component. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



30 Oct 2015 Diag: Doug Bogart

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the component. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

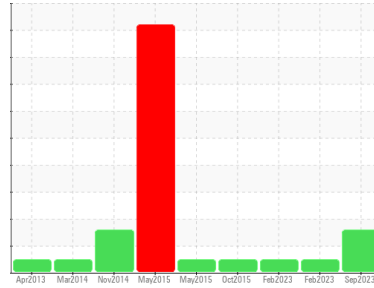

Area
ULTRACLEAN
 Machine Id
SULLAIR 003-105918 - SPINNAKER COATING
 Component
Compressor

DIAGNOSIS

Recommendation
 No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear
 All component wear rates are normal.

Contamination
 Elemental level of silicon (Si) above normal.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		UCH05965477	UCH05776162	UCH05774930
Sample Date	Client Info		18 Sep 2023	15 Feb 2023	02 Feb 2023
Machine Age	hrs	Client Info	43492	41465	41373
Oil Age	hrs	Client Info	0	164	71
Oil Changed	Client Info		Not Chngd	Not Chngd	Not Chngd
Sample Status			ATTENTION	NORMAL	NORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	2	<1	<1
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m	0	0	0
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >25	1	<1	0
Lead	ppm	ASTM D5185m >25	0	0	0
Copper	ppm	ASTM D5185m >50	5	8	8
Tin	ppm	ASTM D5185m >15	<1	<1	<1
Antimony	ppm	ASTM D5185m	---	---	---
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m	0	<1	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	<1	0	0
Magnesium	ppm	ASTM D5185m	2	0	0
Calcium	ppm	ASTM D5185m	1	<1	0
Phosphorus	ppm	ASTM D5185m 287	34	46	44
Zinc	ppm	ASTM D5185m	0	6	4
Sulfur	ppm	ASTM D5185m 270	322	278	279

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	▲ 48	12	10
Sodium	ppm	ASTM D5185m	<1	6	4
Potassium	ppm	ASTM D5185m >20	<1	0	0

FLUID DEGRADATION




	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.296	1.30	1.19	1.23

VISUAL

	method	limit/base	current	history1	history2
White Metal	scalar	*Visual NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual NONE	NONE	NONE	NONE
Silt	scalar	*Visual NONE	NONE	NONE	NONE
Debris	scalar	*Visual NONE	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual NONE	NONE	NONE	NONE
Appearance	scalar	*Visual NORML	NORML	NORML	NORML
Odor	scalar	*Visual NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual >0.1	NEG	NEG	NEG
Free Water	scalar	*Visual	NEG	NEG	NEG




OIL ANALYSIS REPORT


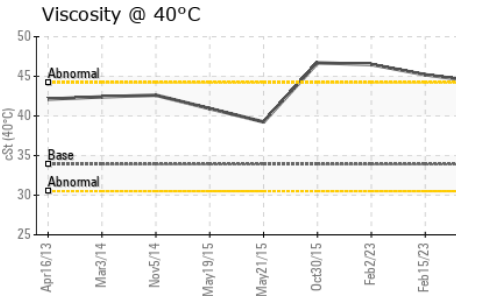
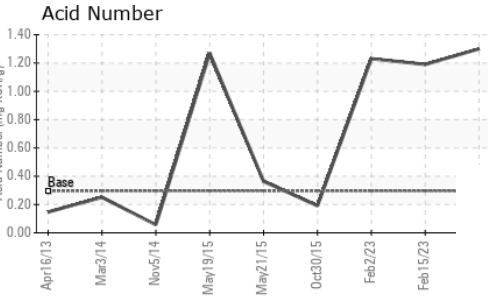
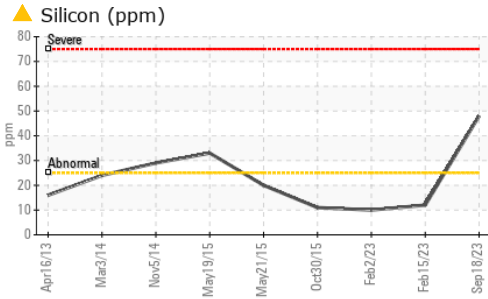


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	33.9	44.3	45.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

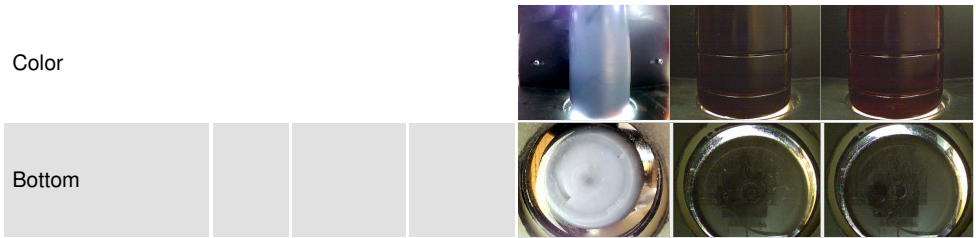

GRAPHS

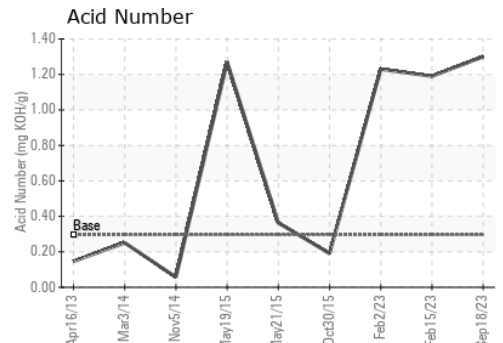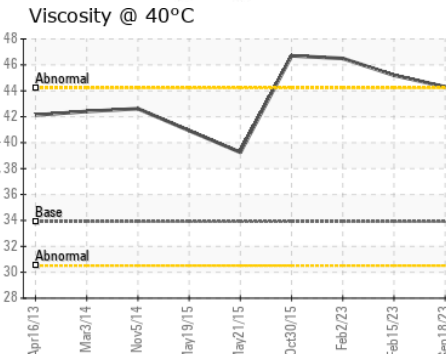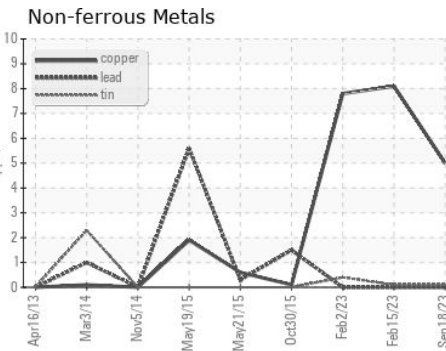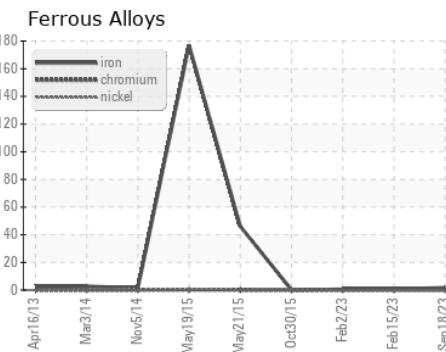

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : UCH05965477
 Lab Number : 05965477
 Unique Number : 10672028
 Test Package : IND 2

AIR HANDLING EQUIPMENT INC
 1389 RIVERSIDE DR
 SIDNEY, OH
 US 45365
 Contact: CRISTI CURL
 cristi@ahequip.net
 T:
 F: (937)492-3147

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)