



FUEL REPORT

Sample Rating Trend

NORMAL



Machine Id
HWY BULK PLANT LOADING ARM

Component
Diesel Fuel
Fluid
NOT GIVEN (--- GAL)

DIAGNOSIS

Recommendation



This is a baseline read-out on the submitted sample. PMCC Flash Point acceptable at 58C.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC05965860	---	---
Sample Date	Client Info			27 Sep 2023	---	---
Machine Age	hrs	Client Info		0	---	---
Sample Status				NORMAL	---	---

PHYSICAL PROPERTIES		method	limit/base	current	history1	history2
Pensky-Martens Flash Point	°C	*PMCC Calculated		58	---	---

SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur (UVF)	ppm	ASTM D5453		9	---	---



CONTAMINANTS		method	limit/base	current	history1	history2
% Gasoline	%	*In-House	<0.50	0.0	---	---
% Biodiesel	%	*In-House	<20.0	0.0	---	---

SAMPLE IMAGES		method	limit/base	current	history1	history2
Color					no image	no image
Bottom					no image	no image



FUEL REPORT

GRAPHS

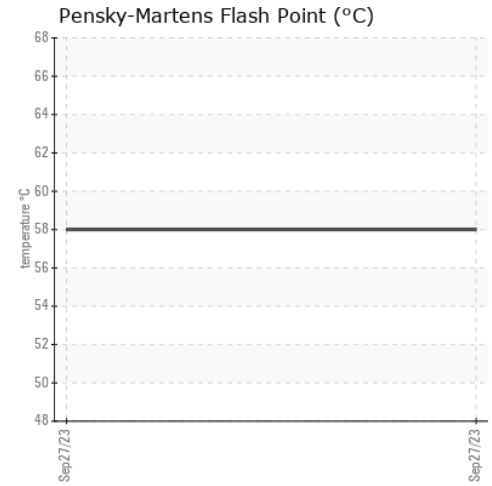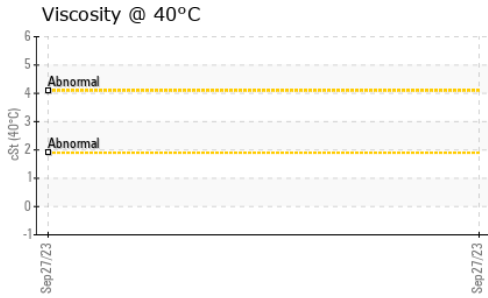

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC05965860 **Received** : 29 Sep 2023
Lab Number : 05965860 **Diagnosed** : 09 Oct 2023
Unique Number : 10672411 **Diagnostician** : Doug Bogart
Test Package : DF-5 (Additional Tests: CC Flash)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

RICHARDS OIL CO INC
 2063 NC HWY 39 NORTH
 LOUISBURG, NC
 US 27549
 Contact: JAEY YOUNG
 richardsoil@aol.com
 T: (919)496-3381
 F: (919)496-3416