




# PROBLEM SUMMARY


Area  
**Utility**  
 Machine Id  
**FEH85AH05 Cooling Tower, Cell / Fan**  
 Component  
**Gearbox**  
 Fluid  
**JAX FGG-AW ISO 220 (---**)

Sample Rating Trend

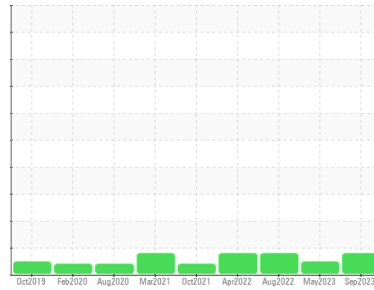

## COMPONENT CONDITION SUMMARY

▲ Particle Trend

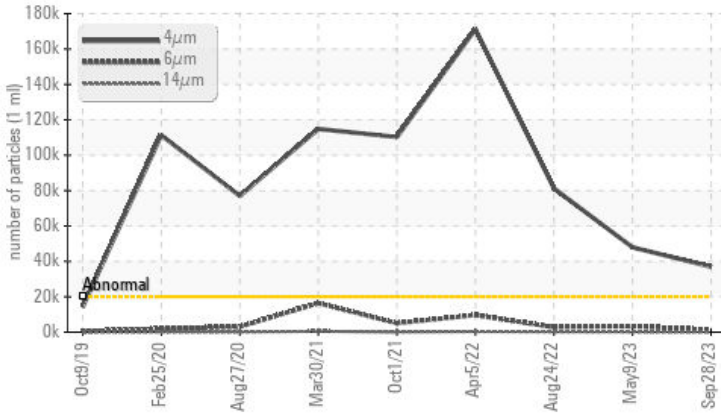

## RECOMMENDATION

No corrective action is recommended at this time.  
 Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status		ATTENTION	NORMAL	ABNORMAL
Particles >4µm	ASTM D7647 >20000	▲ 36950	47966	▲ 81197
Oil Cleanliness	ISO 4406 (c) >21/19/16	▲ 22/17/12	23/19/14	▲ 24/19/15

Customer Id: NOVFRANC  
 Sample No.: WC0822449  
 Lab Number: 05966267  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Don Baldrige +1  
[don.b505@comcast.net](mailto:don.b505@comcast.net)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

*There are no recommended actions for this sample.*

## HISTORICAL DIAGNOSIS

### 09 May 2023 Diag: Doug Bogart

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 24 Aug 2022 Diag: Doug Bogart

ISO



No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of silt (particulates < 6 microns in size) present in the oil. The AN level is acceptable for this fluid.

view report



### 05 Apr 2022 Diag: Angela Borella

ISO



No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of silt (particulates < 6 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





# OIL ANALYSIS REPORT

Sample Rating Trend

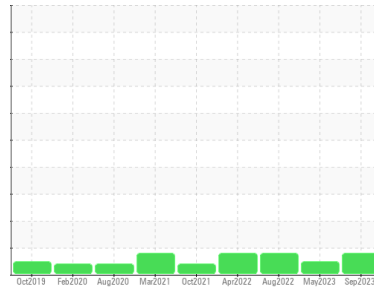

ISO



Area  
**Utility**

Machine Id  
**FEH85AH05 Cooling Tower, Cell / Fan**

Component  
**Gearbox**

Fluid  
**JAX FGG-AW ISO 220 (---)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0822449</b>	WC0795878	WC0726025
Sample Date	Client Info		<b>28 Sep 2023</b>	09 May 2023	24 Aug 2022
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>ATTENTION</b>	NORMAL	ABNORMAL

## WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>200	<b>9</b>	12	11
Chromium	ppm	ASTM D5185m	>15	<b>0</b>	<1	0
Nickel	ppm	ASTM D5185m	>15	<b>&lt;1</b>	<1	0
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185m	>25	<b>0</b>	0	0
Lead	ppm	ASTM D5185m	>100	<b>0</b>	<1	0
Copper	ppm	ASTM D5185m	>200	<b>&lt;1</b>	0	<1
Tin	ppm	ASTM D5185m	>25	<b>0</b>	<1	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		<b>1</b>	4	4
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	<1	<1
Magnesium	ppm	ASTM D5185m		<b>&lt;1</b>	3	0
Calcium	ppm	ASTM D5185m		<b>3</b>	3	0
Phosphorus	ppm	ASTM D5185m		<b>618</b>	655	579
Zinc	ppm	ASTM D5185m		<b>38</b>	31	29
Sulfur	ppm	ASTM D5185m		<b>1643</b>	2014	1574

## CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>50	<b>9</b>	6	8
Sodium	ppm	ASTM D5185m		<b>0</b>	4	0
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	2	0
Water	%	ASTM D6304	>0.2	<b>0.002</b>	0.002	0.006
ppm Water	ppm	ASTM D6304	>2000	<b>16.8</b>	21.9	63.3






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>20000	<b>▲ 36950</b>	47966	<b>▲ 81197</b>
Particles >6µm	ASTM D7647	>5000	<b>1240</b>	3358	2837
Particles >14µm	ASTM D7647	>640	<b>38</b>	133	170
Particles >21µm	ASTM D7647	>160	<b>11</b>	82	47
Particles >38µm	ASTM D7647	>40	<b>1</b>	23	2
Particles >71µm	ASTM D7647	>10	<b>1</b>	4	0
Oil Cleanliness	ISO 4406 (c)	>21/19/16	<b>▲ 22/17/12</b>	23/19/14	<b>▲ 24/19/15</b>

## FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.61</b>	0.60	0.63


# OIL ANALYSIS REPORT

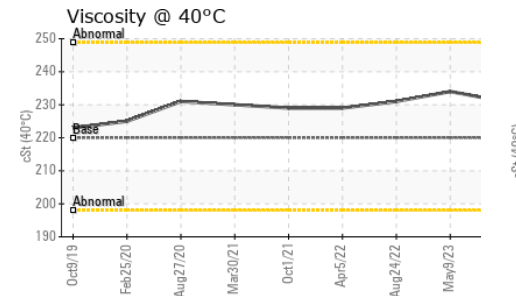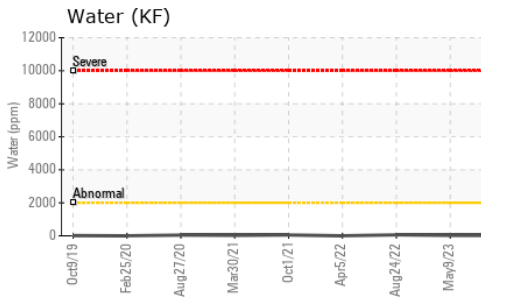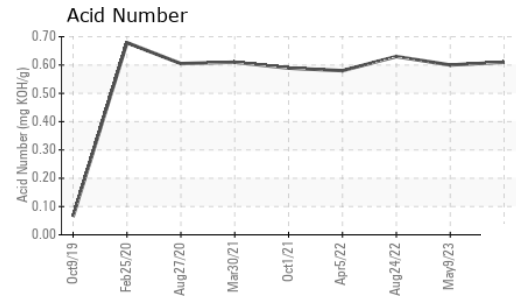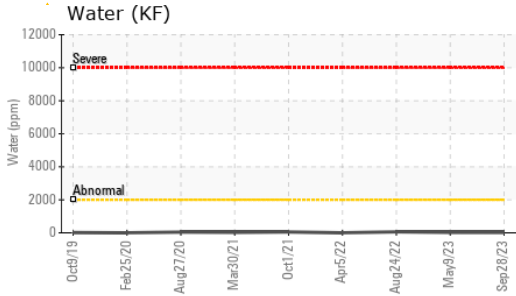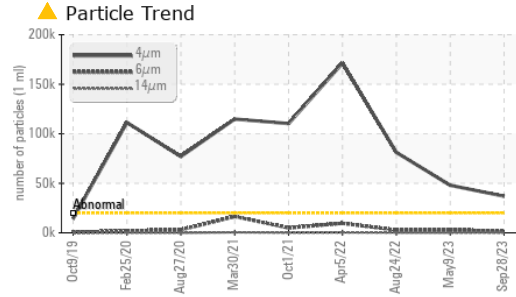






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	VLITE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	220	231	234

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

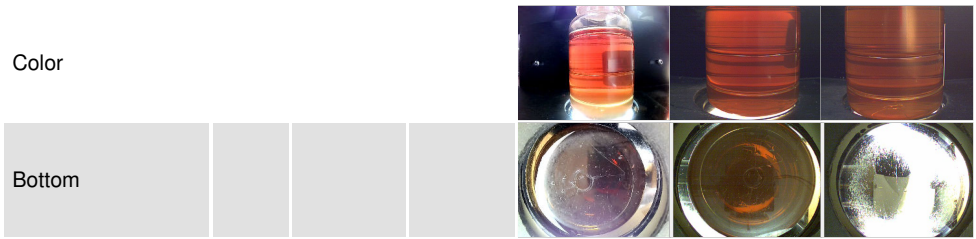

## GRAPHS

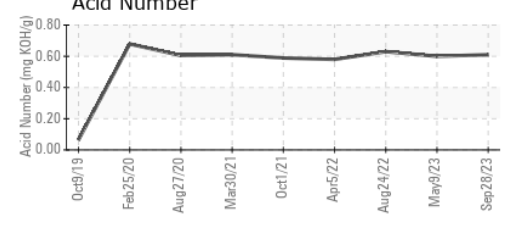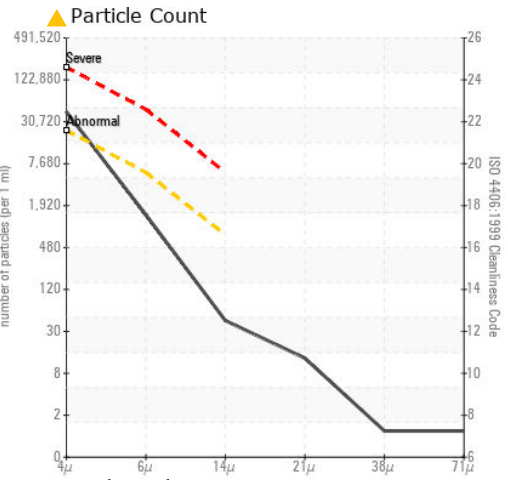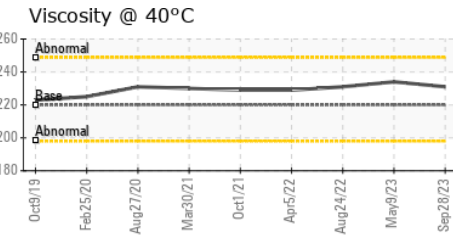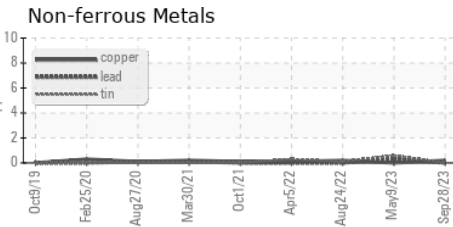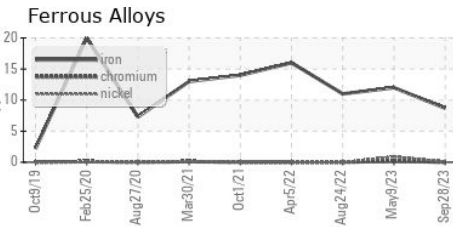

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0822449 **Received** : 02 Oct 2023  
**Lab Number** : 05966267 **Diagnosed** : 03 Oct 2023  
**Unique Number** : 10672818 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**NOVOZYMES**  
 P.O. BOX 576, 77 PERRY CHAPEL CHURCH ROAD  
 FRANKLINTON, NC  
 US 27525  
 Contact: BRUCE THOMAS  
 brct@novozymes.com  
 T: (919)494-3146  
 F: (919)494-3456

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)