




# OIL ANALYSIS REPORT

Sample Rating Trend

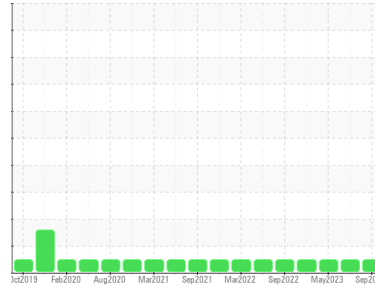

**NORMAL**



Area  
**Fermentation**  
 Machine Id  
**Lightnin FFG35MB01 Main Fermentor, Agitator**  
 Component  
**Gearbox**  
 Fluid  
**JAX FGG-AW ISO 220 (28 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>WC0822456</b>	WC0793893	WC0774917
Sample Date	Client Info	<b>28 Sep 2023</b>	16 Jun 2023	03 May 2023
Machine Age	hrs	Client Info	<b>0</b>	0
Oil Age	hrs	Client Info	<b>0</b>	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

method	limit/base	current	history1	history2		
Iron	ppm	ASTM D5185m	>200	<b>0</b>	7	4
Chromium	ppm	ASTM D5185m	>15	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>15	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>0</b>	<1	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>25	<b>0</b>	<1	0
Lead	ppm	ASTM D5185m	>100	<b>0</b>	0	4
Copper	ppm	ASTM D5185m	>200	<b>0</b>	<1	0
Tin	ppm	ASTM D5185m	>25	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	<1	0

## ADDITIVES

method	limit/base	current	history1	history2		
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	<1	1
Magnesium	ppm	ASTM D5185m		<b>0</b>	<1	4
Calcium	ppm	ASTM D5185m		<b>0</b>	6	18
Phosphorus	ppm	ASTM D5185m		<b>463</b>	475	429
Zinc	ppm	ASTM D5185m		<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m		<b>664</b>	710	414

## CONTAMINANTS

method	limit/base	current	history1	history2		
Silicon	ppm	ASTM D5185m	>50	<b>3</b>	5	4
Sodium	ppm	ASTM D5185m		<b>0</b>	<1	0
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	0	0
Water	%	ASTM D6304	>0.2	<b>0.001</b>	0.003	0.006
ppm Water	ppm	ASTM D6304	>2000	<b>0.6</b>	38.9	63.3

## FLUID CLEANLINESS






method	limit/base	current	history1	history2	
Particles >4µm	ASTM D7647	>20000	<b>1926</b>	4923	8220
Particles >6µm	ASTM D7647	>5000	<b>268</b>	766	541
Particles >14µm	ASTM D7647	>640	<b>25</b>	81	11
Particles >21µm	ASTM D7647	>160	<b>5</b>	21	2
Particles >38µm	ASTM D7647	>40	<b>0</b>	1	0
Particles >71µm	ASTM D7647	>10	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>21/19/16	<b>18/15/12</b>	19/17/14	20/16/11

## FLUID DEGRADATION

method	limit/base	current	history1	history2		
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.41</b>	0.44	0.51




# OIL ANALYSIS REPORT

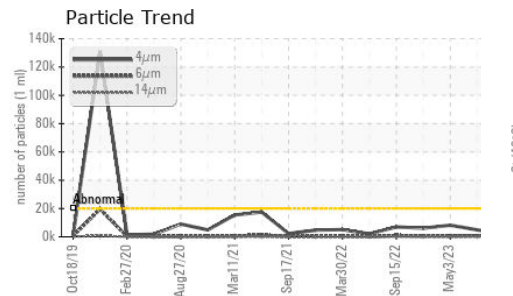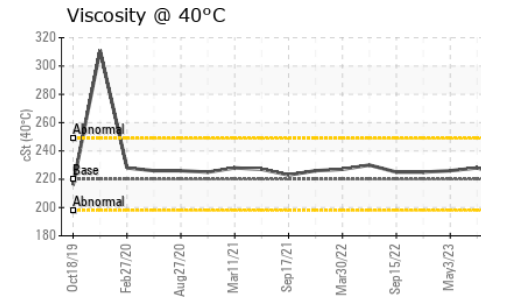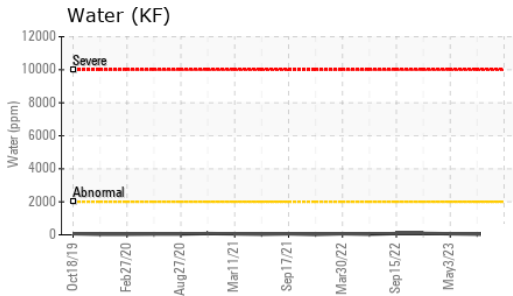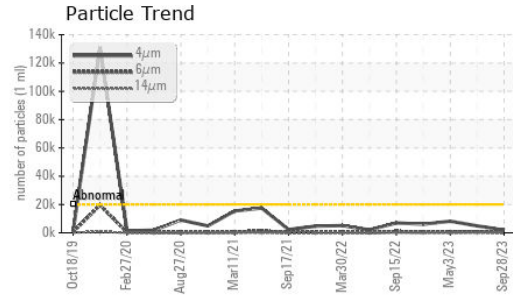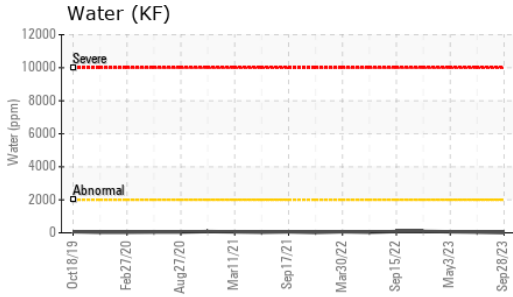






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	220	223	228

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

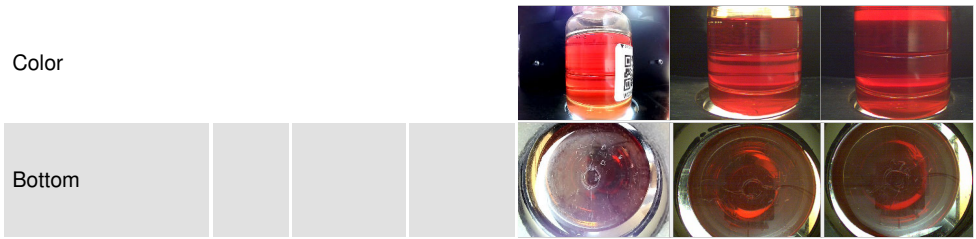

## GRAPHS

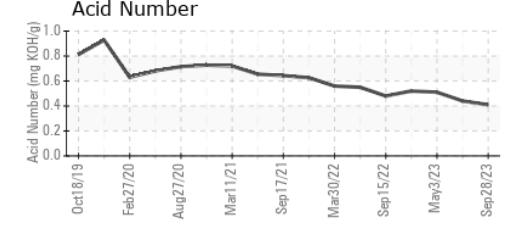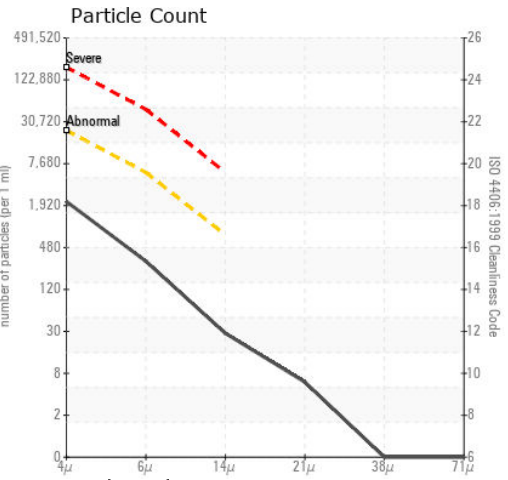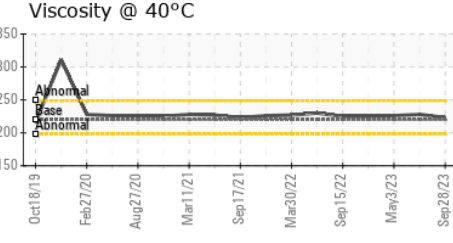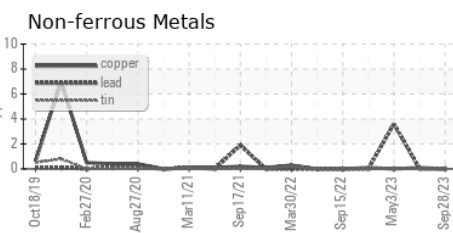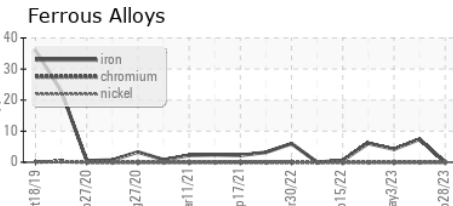

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0822456 **Received** : 02 Oct 2023  
**Lab Number** : 05966278 **Diagnosed** : 03 Oct 2023  
**Unique Number** : 10672829 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**NOVOZYMES**  
 P.O. BOX 576, 77 PERRY CHAPEL CHURCH ROAD  
 FRANKLINTON, NC  
 US 27525  
 Contact: BRUCE THOMAS  
 brct@novozymes.com  
 T: (919)494-3146  
 F: (919)494-3456

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)