

OIL ANALYSIS REPORT

Sample Rating Trend







Machine Id North Component Heat Transfer Fluid Fluid PARATHERM HE (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the fluid. The amount and size of particulates present in the system are acceptable.


Fluid Condition


The AN level is acceptable for this fluid. The condition of the fluid is suitable for further service.


SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		TO10002570		
Sample Date		Client Info		22 Sep 2023		
Machine Age	yrs	Client Info		3		
Oil Age	yrs	Client Info		0		
Oil Changed		Client Info		Not Changd		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>200	7		
Chromium	ppm	ASTM D5185m	>21	0		
Nickel	ppm	ASTM D5185m	>21	0		
Titanium	ppm	ASTM D5185m	>21	0		
Silver	ppm	ASTM D5185m	>21	0		
Aluminum	ppm	ASTM D5185m	>21	0		
Lead	ppm	ASTM D5185m	>21	0		
Copper	ppm	ASTM D5185m	>21	<1		
Tin	ppm	ASTM D5185m	>21	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	0	0		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m	0	<1		
Magnesium	ppm	ASTM D5185m	0	0		
Calcium	ppm	ASTM D5185m	0	<1		
Phosphorus	ppm	ASTM D5185m	0	0		
Zinc	ppm	ASTM D5185m	0	0		
Sulfur	ppm	ASTM D5185m	0	0		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m	>21	0		
Potassium	ppm	ASTM D5185m	>20	<1		
Water	%	ASTM D6304	>0.0601	0.004		
ppm Water	ppm	ASTM D6304	>601	44.1		
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		260424		
Particles >6µm		ASTM D7647	>10240000	141868		
Particles >14µm		ASTM D7647	>10240000	24144		
Particles >21µm		ASTM D7647	>2560000	8133		
Particles >38µm		ASTM D7647	>640000	1256		
Particles >71µm		ASTM D7647	>160000	128		
Oil Cleanliness		ISO 4406 (c)	>/30/30	25/24/22		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.004	0.18		



OIL ANALYSIS REPORT





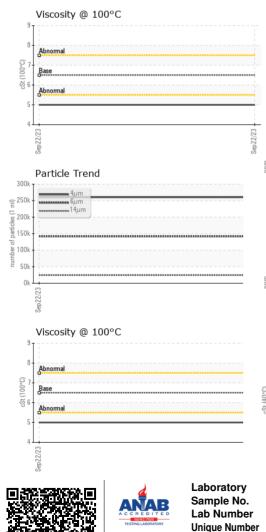

	'ISUAL		method	limit/base	current	history1	history2
		scalar	*Visual	NONE	NONE		
		scalar	*Visual	NONE	NONE		
	ecipitate	scalar	*Visual	NONE	NONE		
Silt		scalar	*Visual	NONE	NONE		
	bris	scalar	*Visual	NONE	NONE		
	nd/Dirt	scalar	*Visual	NONE	NONE		
	pearance	scalar	*Visual	NORML	NORML		
Od		scalar	*Visual	NORML	NORML		
Em	ulsified Water	scalar	*Visual	>0.0601	NEG		
Fre	e Water	scalar	*Visual		NEG		
F	LUID PROPERTI	ES	method	limit/base	current	history1	history2
Vis	sc @ 40°C	cSt	ASTM D445	45	28.4		
		cSt	ASTM D445	6.5	5		
	cosity Index (VI)	Scale	ASTM D2270	100	100		
S	AMPLE IMAGES		method	limit/base	current	history1	history2
Col	lor					no image	no image
Bot	ttom					no image	no image
G	RAPHS						
	errous Alloys				Particle Count	t	
	iron			491,520			T ²
u 6 -	nickel			122,880			-2
2				30,720	-		-2
0					1		-2
Sep 22/23				Sep22/23 (per 1 ml)			
Sep				2da 1,920 sa 1,920	1		
	lon-ferrous Metals			pitted 480	•		
10 8	copper			ES21254 8 100 100 100 100 100 100 100 100 100 1			
E 6-	tin			humb			
a 4-				- 30	[·····†'
2				8	Abnormal		-10
				2/23	-		-8
Sep22/23				Sep22/2:			c.
	íscosity @ 40°C			0	ہوں۔ Acid Number	14μ 21μ	38µ 71µ
70 T s	Severe			(^B ⊈0.80			
	Abnormal Base		*****	9_0.60	Severe		
(0-0+) tso	Sase Abnormal			ළ දු 0.40	Abnormal		
30 - 5	Severe			0.80 0.00 0.00 0.00 0.00 0.00 0.00	Abnormal		
20				Sep 22/23	Sep 22/23		
20 22/23							

Contact: NATHAN SWEARINGEN Nathan.Swearingen@ergon.com * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

Certificate L2367

Т:

F: