


KAESER COMPRESSORS Built for a lifetime."


KAESER 5048330

Compressor

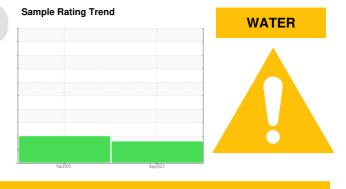

KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

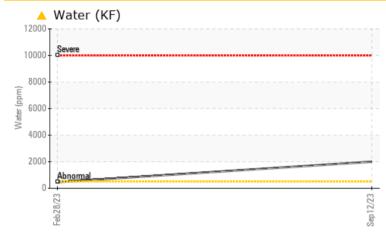

RECOMMENDATION

We were unable to perform a particle count on this sample. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

PROBLEMATIC TEST RESULTS								
Sample Status				ABNORMAL	ABNORMAL			
Water	%	ASTM D6304	>0.05	A 0.200	0.047			
ppm Water	ppm	ASTM D6304	>500	<u> </u>	470			
Emulsified Water	scalar	*Visual	>0.05	A 0.2%	0.2%			

Customer Id: CONSTHCA Sample No.: KCP40056 Lab Number: 05966312 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Don Baldridge +1 <u>don.b505@comcast.net</u>

To change component or sample information: Customer Service +1 1-800-237-1369 <u>customerservice@wearcheck.com</u>

RECOMMENDED	ACTIONS			
Action	Status	Date	Done By	Des
Alert			?	We v parti

Description

We were unable to perform a particle count due to a high concentration of particles present in this sample.

HISTORICAL DIAGNOSIS

VISCOSITY



28 Feb 2023 Diag: Doug Bogart

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of particulates present in the oil. The oil viscosity is higher than normal. Confirm oil type. The AN level is acceptable for this fluid.





OIL ANALYSIS REPORT

Sample Rating Trend



KAESER 5048330

Compressor Fluid KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

We were unable to perform a particle count on this sample. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

Wear

All component wear rates are normal.

Contamination

There is a light concentration of water present in the oil.


Fluid Condition


The AN level is acceptable for this fluid.


SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCP40056	KCP55152	
Sample Date		Client Info		12 Sep 2023	28 Feb 2023	
Machine Age	hrs	Client Info		21120	20313	
Oil Age	hrs	Client Info		20313	0	
Oil Changed		Client Info		Not Changd	Changed	
Sample Status				ABNORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	<1	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	<1	<1	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	5	15	
Tin	ppm	ASTM D5185m	>10	0	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	90	13	0	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m	100	43	1	
Calcium	ppm	ASTM D5185m	0	2	0	
Phosphorus	ppm	ASTM D5185m	0	13	4	
Zinc	ppm	ASTM D5185m	0	9	27	
Sulfur	ppm	ASTM D5185m	23500	19945	21059	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	7	<1	
Sodium	ppm	ASTM D5185m		8	2	
Potassium	ppm	ASTM D5185m	>20	2	0	
Water	%	ASTM D6304	>0.05	A 0.200	0.047	
ppm Water	ppm	ASTM D6304	>500	A 2000	470	
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647			57577	
Particles >6µm		ASTM D7647	>1300		1 6976	
Particles >14µm		ASTM D7647	>80		3 20	
Particles >21µm		ASTM D7647	>20		<u> </u>	
Particles >38µm		ASTM D7647	>4		2	
Particles >71µm		ASTM D7647	>3		0	
Oil Cleanliness		ISO 4406 (c)	>/17/13		▲ 23/21/15	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.37	0.38	




OIL ANALYSIS REPORT







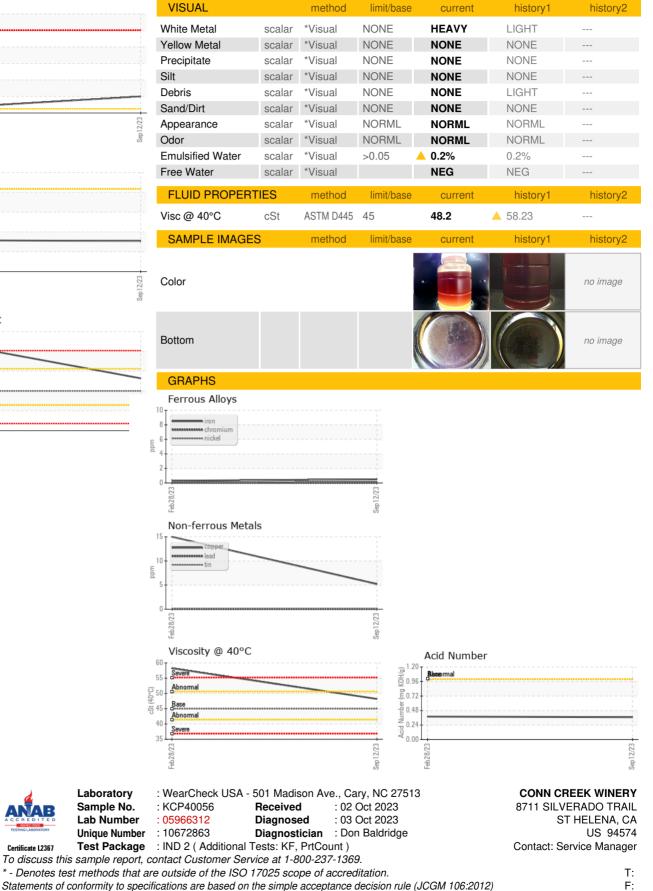

Certificate L2367

E.