




PROBLEM SUMMARY


Sample Rating Trend

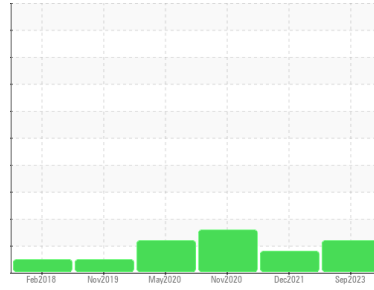

Machine Id
KAESER ASD 25T 3130336 (S/N 1136)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- QTS)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

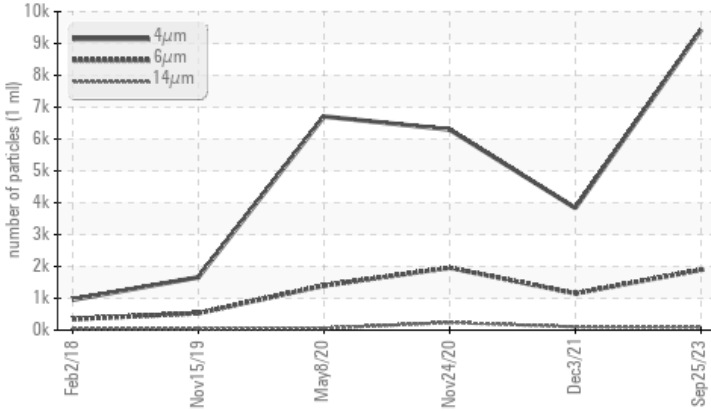

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ATTENTION	ATTENTION	ABNORMAL
Particles >6µm	ASTM D7647	>1300	▲ 1890	1151	▲ 1957
Particles >14µm	ASTM D7647	>80	▲ 87	▲ 103	▲ 239
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 20/18/14	▲ 17/14	▲ 18/15

Customer Id: IMACLI
 Sample No.: KC125907
 Lab Number: 05966317
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

03 Dec 2021 Diag: Jonathan Hester

ISO



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



24 Nov 2020 Diag: Don Baldrige

ISO



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



08 May 2020 Diag: Angela Borella

ISO




The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



OIL ANALYSIS REPORT

Sample Rating Trend

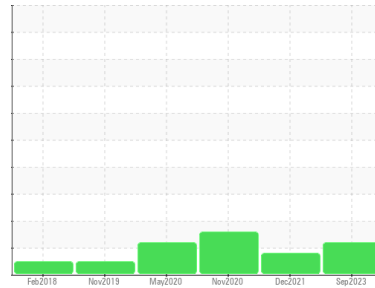

ISO



Machine Id
KAESER ASD 25T 3130336 (S/N 1136)

Component

Compressor

Fluid

KAESER SIGMA (OEM) S-460 (--- QTS)

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KC125907	KC95074	KC91275
Sample Date	Client Info		25 Sep 2023	03 Dec 2021	24 Nov 2020
Machine Age	hrs	Client Info	69527	61174	56528
Oil Age	hrs	Client Info	0	4646	4642
Oil Changed	Client Info		N/A	Changed	Changed
Sample Status			ATTENTION	ATTENTION	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	0	0
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	<1	<1	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	<1	0
Aluminum	ppm	ASTM D5185m >10	0	0	0
Lead	ppm	ASTM D5185m >10	0	0	0
Copper	ppm	ASTM D5185m >50	35	21	24
Tin	ppm	ASTM D5185m >10	0	0	<1
Antimony	ppm	ASTM D5185m	---	<1	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	11	11
Barium	ppm	ASTM D5185m 90	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	0	0
Magnesium	ppm	ASTM D5185m 90	<1	6	2
Calcium	ppm	ASTM D5185m 2	0	0	0
Phosphorus	ppm	ASTM D5185m	0	5	0
Zinc	ppm	ASTM D5185m	92	115	99

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<1	<1	<1
Sodium	ppm	ASTM D5185m	0	2	<1
Potassium	ppm	ASTM D5185m >20	1	0	0
Water	%	ASTM D6304 >0.05	0.007	0.004	0.007
ppm Water	ppm	ASTM D6304 >500	77.9	43.5	71.4

FLUID CLEANLINESS


	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		9431	3833	6296
Particles >6µm	ASTM D7647 >1300		▲ 1890	1151	▲ 1957
Particles >14µm	ASTM D7647 >80		▲ 87	▲ 103	▲ 239
Particles >21µm	ASTM D7647 >20		18	▲ 28	▲ 79
Particles >38µm	ASTM D7647 >4		1	0	▲ 6
Particles >71µm	ASTM D7647 >3		0	0	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 20/18/14	▲ 17/14	▲ 18/15

FLUID DEGRADATION


	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.38	0.455	0.396

OIL ANALYSIS REPORT


▲ Particle Trend

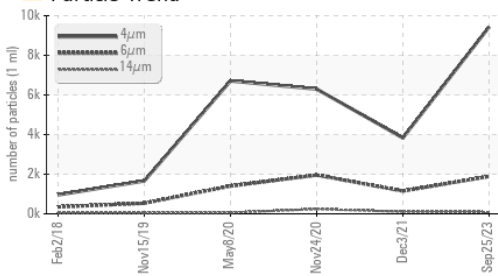


Water (KF)

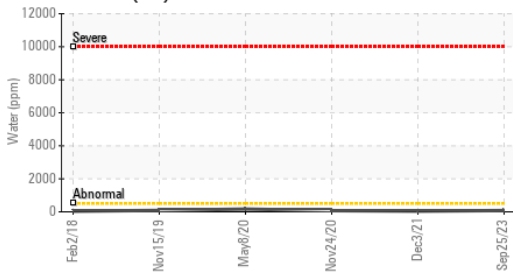


Acid Number

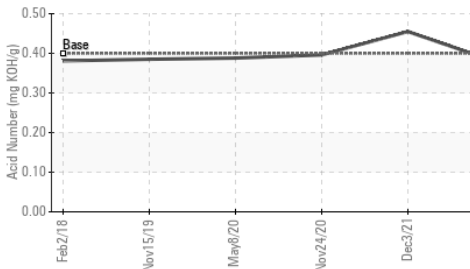

Water (KF)

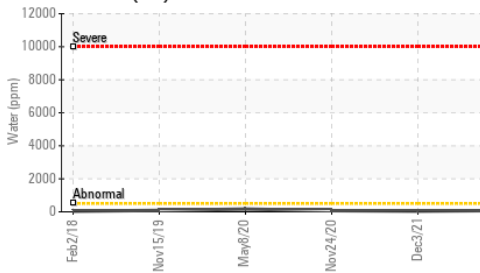

Viscosity @ 40°C

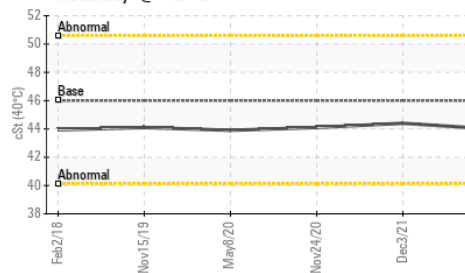


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.0	44.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color




Bottom




GRAPHS


Ferrous Alloys

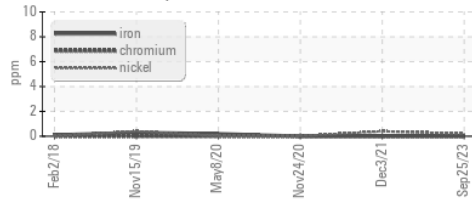


Non-ferrous Metals

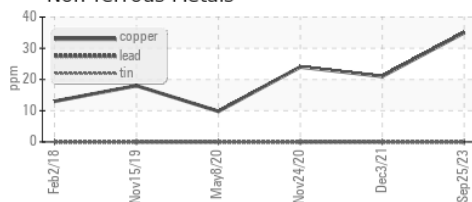


Viscosity @ 40°C

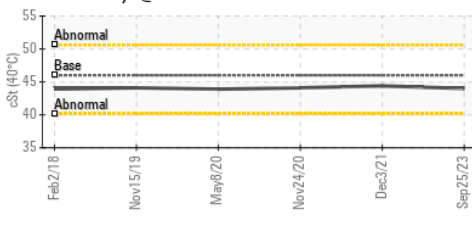

▲ Particle Count

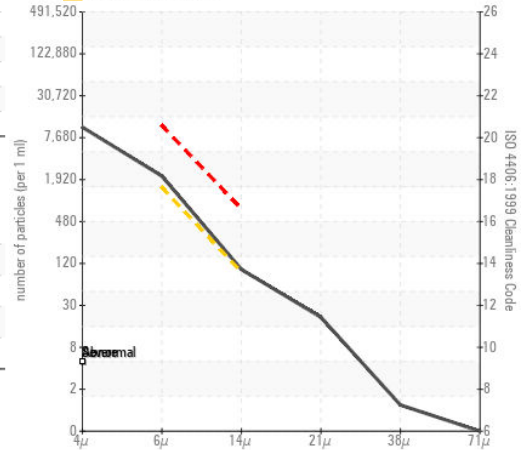

Acid Number

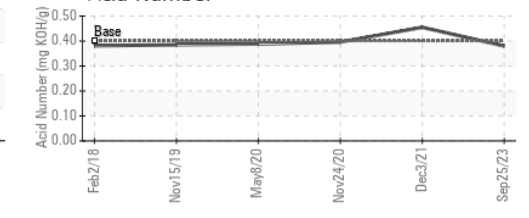

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : KC125907
 Lab Number : 05966317
 Unique Number : 10672868
 Test Package : IND 2
 Received : 02 Oct 2023
 Diagnosed : 03 Oct 2023
 Diagnostician : Don Baldrige

IMAGE FIRST
 310 KULLER RD
 CLIFTON, NJ
 US 07011
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: