


PROBLEM SUMMARY

KAESER ASD 40 7917216 (S/N 1362)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

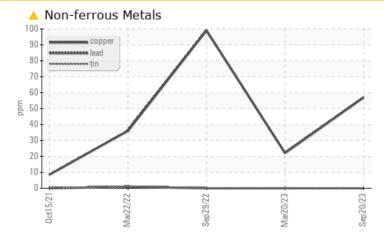

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

PROBLEMATIC TEST RESULTS							
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL	
Copper	ppm	ASTM D5185m	>50	<u> </u>	22	<u> </u>	
Debris	scalar	*Visual	NONE	🔺 MODER	🔺 MODER	LIGHT	


Customer Id: PURBET Sample No.: KC126112 Lab Number: 05966334 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 <u>customerservice@wearcheck.com</u>

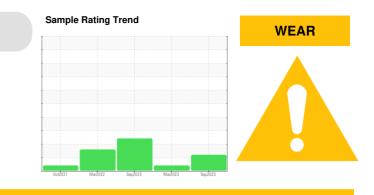

RECOMMENDED ACTIONS						
Action	Status	Date	Done By			
Alert			?			

Description

We were unable to perform a particle count due to a high concentration of particles present in this sample.

HISTORICAL DIAGNOSIS

20 Mar 2023 Diag: Jonathan Hester



No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

iew report

view report

29 Sep 2022 Diag: Don Baldridge



Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor. The copper level is abnormal. All other component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

22 Mar 2022 Diag: Don Baldridge

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.







OIL ANALYSIS REPORT

KAESER ASD 40 7917216 (S/N 1362)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

📥 Wear


The copper level is abnormal. All other component wear rates are normal.

Contamination

Moderate concentration of visible dirt/debris present in the oil.

Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

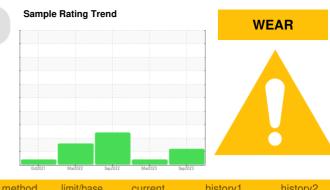



SAMPLE INFORM	ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC126112	KC110986	KC104584
Sample Date		Client Info		20 Sep 2023	20 Mar 2023	29 Sep 2022
Machine Age	hrs	Client Info		18216	14159	10406
Oil Age	hrs	Client Info		0	3744	4000
Oil Changed		Client Info		N/A	Not Changd	Changed
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	<1	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	<1	<1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m		<u> </u>	22	<u>▲</u> 99
Tin	ppm	ASTM D5185m	>10	0	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
	ppm				-	-
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	2	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m	90	<1	19	0
Calcium	ppm	ASTM D5185m	2	0	<1	0
Phosphorus	ppm	ASTM D5185m		0	2	3
Zinc	ppm	ASTM D5185m		34	41	1
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm		>25	0	1	0
Sodium	ppm	ASTM D5185m		0	2	0
Potassium	ppm	ASTM D5185m	>20	<1	2	0
Water	%	ASTM D6304	>0.05	0.003	0.010	0.006
ppm Water	ppm	ASTM D6304	>500	30.0	103.4	66.5
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647				5098
Particles >6µm		ASTM D7647	>1300			<u> </u>
Particles >14µm		ASTM D7647	>80			1 89
Particles >21µm		ASTM D7647	>20			▲ 54
Particles >38µm		ASTM D7647	>4			3
Particles >71µm		ASTM D7647	>3			0
Oil Cleanliness		ISO 4406 (c)	>/17/13			2 0/18/15
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.36	0.38	0.33



OIL ANALYSIS REPORT






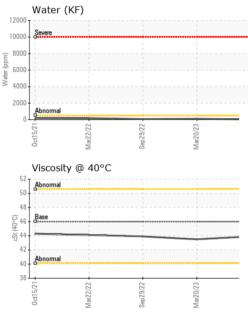


VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	🔺 MODER	A MODER	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT	IES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	43.9	43.5	43.9
SAMPLE IMAGES		method	limit/base	current	history1	history2

Color



Bottom

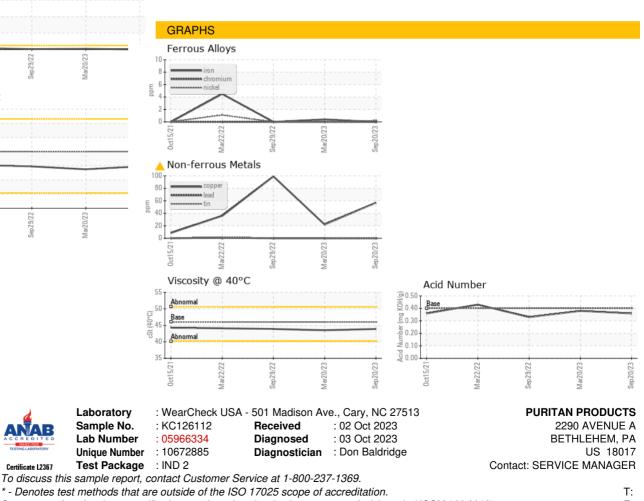

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Certificate L2367

Contact/Location: SERVICE MANAGER - PURBET