

PROBLEM SUMMARY

Sample Rating Trend

ISO


7429516 (S/N 1512)

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

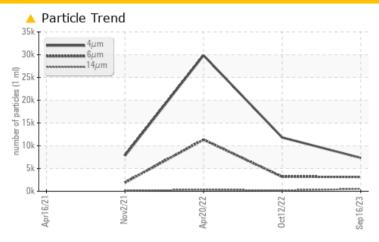

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS									
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL				
Particles >6µm	ASTM D7647	>1300	△ 3150	▲ 3180	<u>▲</u> 11347				
Particles >14μm	ASTM D7647	>80	504	1 93	△ 313				
Particles >21µm	ASTM D7647	>20	162	4 8	<u>42</u>				
Particles >38μm	ASTM D7647	>4	<u>^</u> 6	3	0				
Oil Cleanliness	ISO 4406 (c)	>/17/13	<u>^</u> 20/19/16	<u>\</u> 21/19/15	<u>^</u> 21/15				

Customer Id: BATKUT Sample No.: KC124294 Lab Number: 05966343 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

12 Oct 2022 Diag: Don Baldridge

ISO



Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



20 Apr 2022 Diag: Angela Borella

ISO



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



02 Nov 2021 Diag: Don Baldridge

ISO




The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.





OIL ANALYSIS REPORT



ISO

7429516 (S/N 1512)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Apr2021	Nov2021	Apr2022 Oct2022	Sep.2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC124294	KC104861	KC103200
Sample Date		Client Info		16 Sep 2023	12 Oct 2022	20 Apr 2022
Machine Age	hrs	Client Info		17111	10508	7521
Oil Age	hrs	Client Info		0	3000	5730
Oil Changed		Client Info		N/A	Changed	Changed
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	<1
Aluminum	ppm	ASTM D5185m	>10	0	<1	<1
Lead	ppm	ASTM D5185m	>10	0	<1	<1
Copper	ppm	ASTM D5185m	>50	16	6	10
Tin	ppm	ASTM D5185m	>10	0	0	<1
Antimony	ppm	ASTM D5185m				
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	2	12	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	90	<1	38	29
Calcium	ppm	ASTM D5185m	2	0	<1	0
Phosphorus	ppm	ASTM D5185m		3	5	7
Zinc	ppm	ASTM D5185m		5	8	1
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	0	0
Sodium	ppm	ASTM D5185m		0	14	10
Potassium	ppm	ASTM D5185m	>20	<1	7	7
Water	%	ASTM D6304	>0.05	0.003	0.018	0.008
ppm Water	ppm	ASTM D6304	>500	32.1	182.0	83.8
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		7335	11826	29859
Particles >6µm		ASTM D7647	>1300	4 3150	▲ 3180	<u>▲</u> 11347
Particles >14μm		ASTM D7647	>80	504	1 93	▲ 313
Particles >21µm		ASTM D7647	>20	<u> </u>	▲ 48	<u>▲</u> 42
Particles >38μm		ASTM D7647	>4	<u>^</u> 6	3	0
Particles >71µm		ASTM D7647	>3	1	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>^</u> 20/19/16	<u>\$\text{\Delta}\$ 21/19/15</u>	<u>▲</u> 21/15
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.33	0.31	0.39



OIL ANALYSIS REPORT

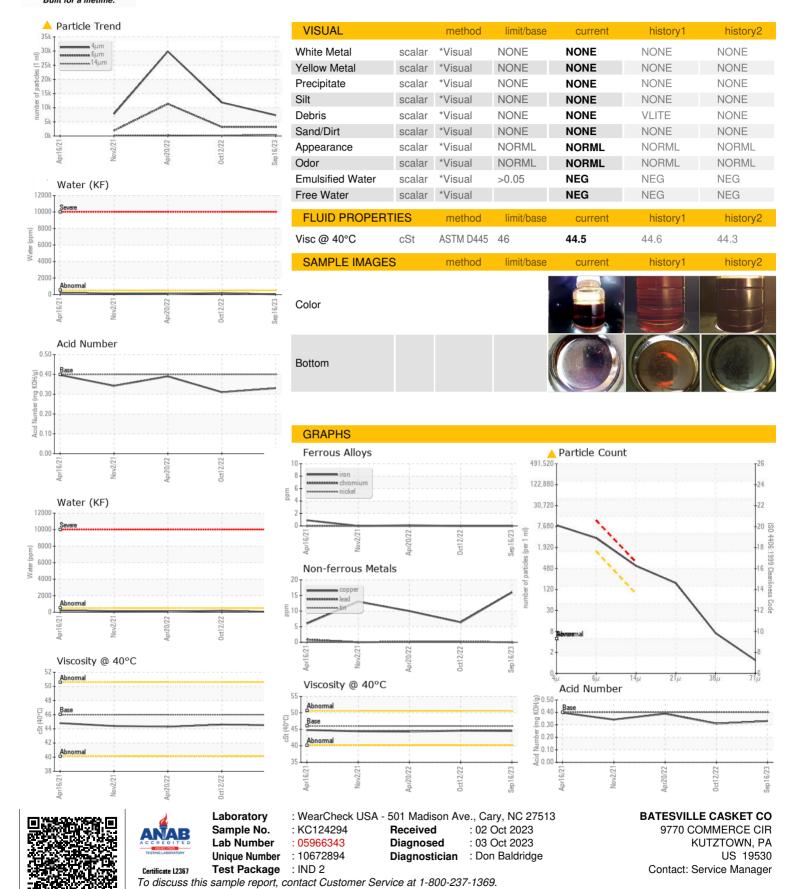

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: