

PROBLEM SUMMARY

Sample Rating Trend


ISO

Machine Id KAESER ASD 25T 3168736 (S/N 1140)

Compressor

KAESER SIGMA (OEM) S-460 (--- QTS)

COMPONENT CONDITION SUMMARY

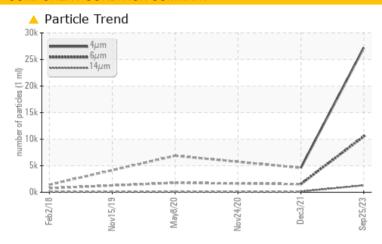

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS										
Sample Status			ABNORMAL	ATTENTION	ABNORMAL					
Particles >6µm	ASTM D7647	>1300	10507	<u>▲</u> 1532						
Particles >14μm	ASTM D7647	>80	1299	<u> </u>						
Particles >21µm	ASTM D7647	>20	△ 369	△ 31						
Particles >38µm	ASTM D7647	>4	18	3						
Oil Cleanliness	ISO 4406 (c)	>/17/13	<u>22/21/17</u>	<u>▲</u> 18/14						

Customer Id: IMACLI Sample No.: KC125911 Lab Number: 05966347 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

03 Dec 2021 Diag: Angela Borella

ISO



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



24 Nov 2020 Diag: Angela Borella

VIS DEBRIS



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



08 May 2020 Diag: Angela Borella

150




No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT

Sample Rating Trend



KAESER ASD 25T 3168736 (S/N 1140)

Compressor

KAESER SIGMA (OEM) S-460 (--- QTS)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Feb2018	Nov2019 May2020	Nov2020 Dec2021	Sep 2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC125911	KC95073	KC91271
Sample Date		Client Info		25 Sep 2023	03 Dec 2021	24 Nov 2020
Machine Age	hrs	Client Info		69069	61278	56712
Oil Age	hrs	Client Info		0	4567	4413
Oil Changed		Client Info		N/A	Changed	Changed
Sample Status				ABNORMAL	ATTENTION	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	<1	0
Aluminum	ppm	ASTM D5185m	>10	0	1	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	45	35	22
Tin	ppm	ASTM D5185m	>10	0	0	0
Antimony	ppm	ASTM D5185m			0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	2	11
Barium	ppm	ASTM D5185m	90	2	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	90	0	4	<1
Calcium	ppm	ASTM D5185m	2	0	0	0
Phosphorus	ppm	ASTM D5185m		3	6	0
Zinc	ppm	ASTM D5185m		51	81	83
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	<1
Sodium	ppm	ASTM D5185m		0	0	1
Potassium	ppm	ASTM D5185m	>20	<1	<1	0
Water	%	ASTM D6304	>0.05	0.003	0.005	0.006
ppm Water	ppm	ASTM D6304	>500	35.7	50.4	60.9
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		27212	4591	
Particles >6µm		ASTM D7647	>1300	10507	<u>▲</u> 1532	
Particles >14µm		ASTM D7647	>80	<u> </u>	<u> </u>	
Particles >21μm		ASTM D7647	>20	^ 369	△ 31	
Particles >38µm		ASTM D7647	>4	<u> </u>	3	
Particles >71μm		ASTM D7647	>3	1	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>22/21/17</u>	▲ 18/14	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.34	0.323	0.390



OIL ANALYSIS REPORT

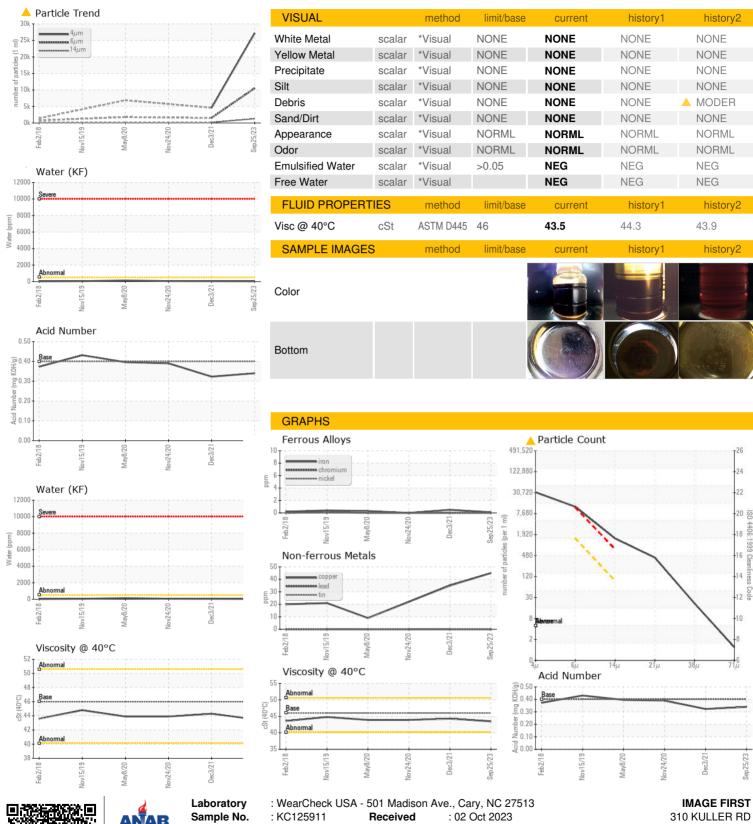



Certificate L2367

Lab Number **Unique Number** Test Package

: 05966347

: 10672898 : IND 2

: 03 Oct 2023 Diagnosed Diagnostician : Don Baldridge

CLIFTON, NJ US 07011 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: