

PROBLEM SUMMARY

Sample Rating Trend

ISO


Machine Id

KAESER CSD 125 7528529 (S/N 1062)


Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)



COMPONENT CONDITION SUMMARY

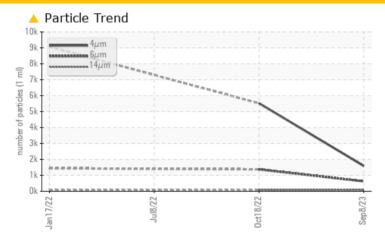

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS										
Sample Status			ATTENTION	ATTENTION	ABNORMAL					
Particles >14μm	ASTM D7647	>80	<u></u> ▲ 85	▲ 83						
Oil Cleanliness	ISO 4406 (c)	>/17/13	18/16/14	2 0/18/14						

Customer Id: MEGEAT Sample No.: KC05966357 Lab Number: 05966357 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

18 Oct 2022 Diag: Don Baldridge

ISO



Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



08 Jul 2022 Diag: Angela Borella

VIS DEBRIS



The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.



17 Jan 2022 Diag: Jonathan Hester

ISO




No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT

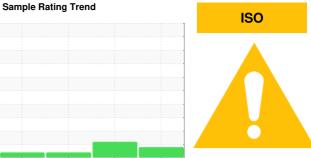

KAESER CSD 125 7528529 (S/N 1062)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Jan202	Jul2022	Jui2022 0ct2022 Sep-2023			
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2	
Sample Number		Client Info		KC05966357	KC102385	KC103926	
Sample Date		Client Info		08 Sep 2023	18 Oct 2022	08 Jul 2022	
Machine Age	hrs	Client Info		17340	11240	9014	
Oil Age	hrs	Client Info		0	5400	1952	
Oil Changed		Client Info		N/A	Changed	Not Changd	
Sample Status				ATTENTION	ATTENTION	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>50	<1	0	0	
Chromium	ppm	ASTM D5185m	>10	0	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	0	
Aluminum	ppm	ASTM D5185m	>10	0	0	<1	
Lead	ppm	ASTM D5185m	>10	0	<1	1	
Copper	ppm	ASTM D5185m	>50	8	10	6	
Tin	ppm	ASTM D5185m	>10	0	0	<1	
Antimony	ppm	ASTM D5185m					
Vanadium	ppm	ASTM D5185m		0	0	0	
Cadmium	ppm	ASTM D5185m		0	0	0	
ADDITIVES		method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		0	0	0	
Barium	ppm	ASTM D5185m	90	2	<1	20	
Molybdenum	ppm	ASTM D5185m		0	0	0	
Manganese	ppm	ASTM D5185m		0	0	0	
Magnesium	ppm	ASTM D5185m	90	28	30	47	
Calcium	ppm	ASTM D5185m	2	0	0	<1	
Phosphorus	ppm	ASTM D5185m		2	4	1	
Zinc	ppm	ASTM D5185m		12	14	9	
CONTAMINANTS		method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>25	<1	<1	<1	
Sodium	ppm	ASTM D5185m		14	12	18	
Potassium	ppm	ASTM D5185m	>20	3	5	7	
Water	%	ASTM D6304	>0.05	0.016	0.016	0.027	
ppm Water	ppm	ASTM D6304	>500	168.0	161.7	272.8	
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2	
Particles >4µm		ASTM D7647		1591	5524		
Particles >6µm		ASTM D7647	>1300	625	<u>▲</u> 1377		
Particles >14µm		ASTM D7647	>80	<u> </u>	8 3		
Particles >21µm		ASTM D7647	>20	20	14		
Particles >38μm		ASTM D7647	>4	0	0		
Particles >71µm		ASTM D7647	>3	0	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/16/14	2 0/18/14		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2	
Acid Number (AN)	ma K∩⊔/a	ASTM D8045	0.4	0.33	0.33	0.29	

Acid Number (AN)

mg KOH/g ASTM D8045 0.4


0.33

0.33

0.29



OIL ANALYSIS REPORT

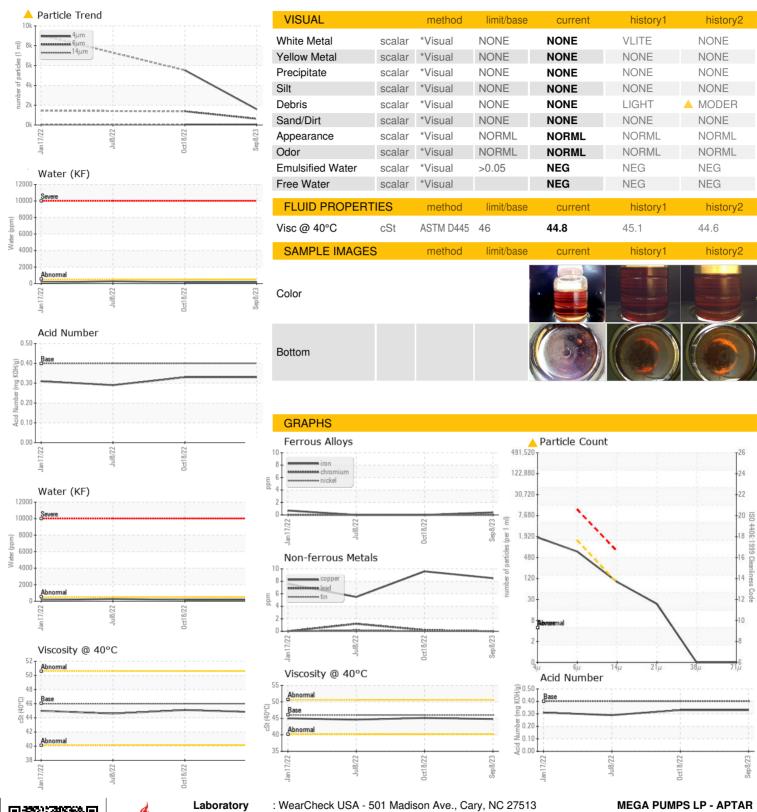



Certificate L2367

Sample No. Lab Number **Unique Number**

Test Package

: KC05966357 : 05966357

: 10672908 : IND 2

: 02 Oct 2023 Received Diagnosed Diagnostician

: 03 Oct 2023 : Don Baldridge 611 INDUSTRIAL WAY WEST EATONTOWN, NJ

US 07724

Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: