




PROBLEM SUMMARY

Sample Rating Trend

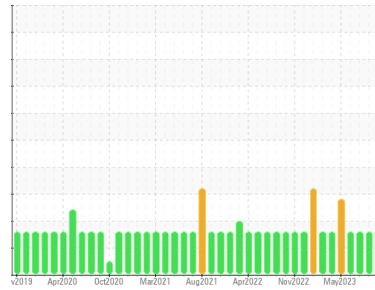

WATER




Machine Id
CF6202 (S/N 00881-003-1-01-01)

Component
Gearbox

Fluid
MOBIL GLYGOYLE 100 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Water (KF)

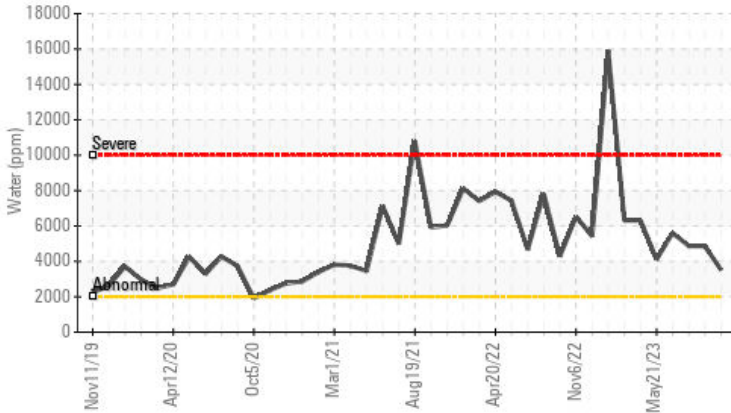

RECOMMENDATION

We advise that you check for the source of water entry. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status				ATTENTION	ATTENTION	ATTENTION
Water	%	ASTM D6304	>0.2	▲ 0.352	▲ 0.486	▲ 0.487
ppm Water	ppm	ASTM D6304	>2000	▲ 3520	▲ 4860	▲ 4870

Customer Id: FLIFAI
Sample No.: USP0001760
Lab Number: 05966367
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Doug Bogart +1 (800)237-1369 x4016
dougb@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Check Water Access	---	---	?	We advise that you check for the source of water entry.

HISTORICAL DIAGNOSIS

23 Aug 2023 Diag: Doug Bogart

WATER



We advise that you check for the source of water entry. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate concentration of water present in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



13 Aug 2023 Diag: Doug Bogart

WATER



We advise that you check for the source of water entry. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate concentration of water present in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



22 Jun 2023 Diag: Doug Bogart

WATER



We advise that you check for the source of water entry. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate concentration of water present in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


[view report](#)





OIL ANALYSIS REPORT

Sample Rating Trend

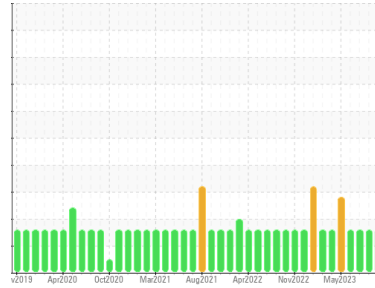

WATER



Machine Id
CF6202 (S/N 00881-003-1-01-01)

Component
Gearbox
Fluid
MOBIL GLYGOYLE 100 (--- GAL)

DIAGNOSIS

Recommendation

We advise that you check for the source of water entry. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a light concentration of water present in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		USP0001760	USP0000416	USP246090
Sample Date	Client Info		01 Oct 2023	23 Aug 2023	13 Aug 2023
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ATTENTION	ATTENTION	ATTENTION

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >200	1	2	3
Chromium	ppm	ASTM D5185m >15	0	0	0
Nickel	ppm	ASTM D5185m >15	0	<1	0
Titanium	ppm	ASTM D5185m	<1	0	<1
Silver	ppm	ASTM D5185m	0	0	<1
Aluminum	ppm	ASTM D5185m >25	<1	0	<1
Lead	ppm	ASTM D5185m >100	<1	0	0
Copper	ppm	ASTM D5185m >200	0	<1	<1
Tin	ppm	ASTM D5185m >25	<1	<1	<1
Vanadium	ppm	ASTM D5185m	0	<1	<1
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m	0	0	<1
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	0	<1
Magnesium	ppm	ASTM D5185m	0	2	7
Calcium	ppm	ASTM D5185m	0	4	8
Phosphorus	ppm	ASTM D5185m	632	570	541
Zinc	ppm	ASTM D5185m	0	5	16
Sulfur	ppm	ASTM D5185m	865	888	866

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	<1	<1	<1
Sodium	ppm	ASTM D5185m	0	3	2
Potassium	ppm	ASTM D5185m >20	4	2	3
Water	%	ASTM D6304 >0.2	▲ 0.352	▲ 0.486	▲ 0.487
ppm Water	ppm	ASTM D6304 >2000	▲ 3520	▲ 4860	▲ 4870






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>20000	6258	5093	5240
Particles >6µm	ASTM D7647	>5000	1633	1393	1404
Particles >14µm	ASTM D7647	>640	100	91	118
Particles >21µm	ASTM D7647	>160	30	19	35
Particles >38µm	ASTM D7647	>40	3	2	1
Particles >71µm	ASTM D7647	>10	1	0	0
Oil Cleanliness	ISO 4406 (c)	>21/19/16	20/18/14	20/18/14	20/18/14

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.23	0.20	0.26


OIL ANALYSIS REPORT

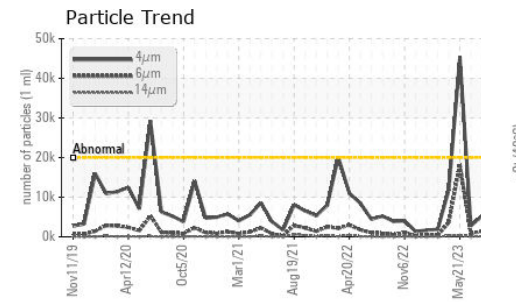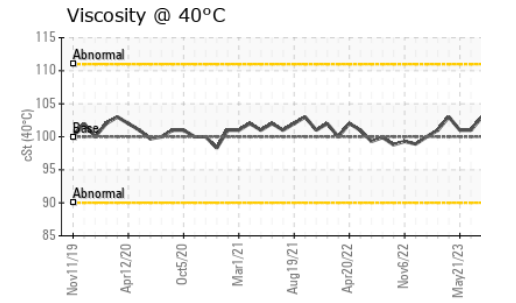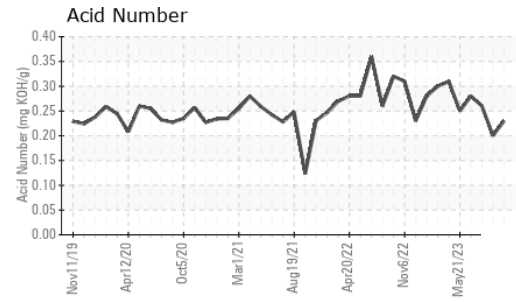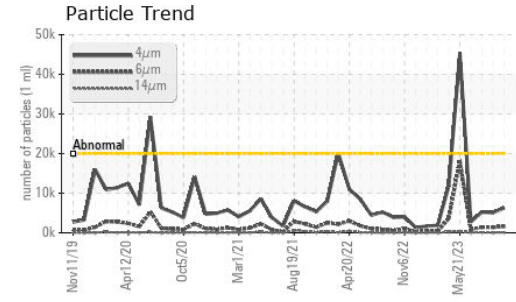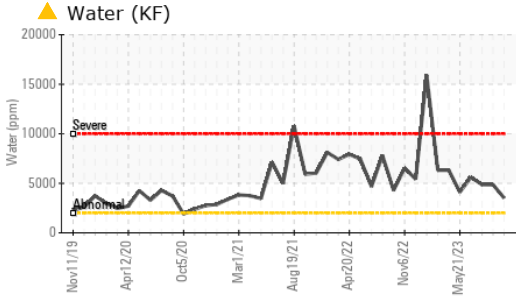






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	100.0	103	103

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

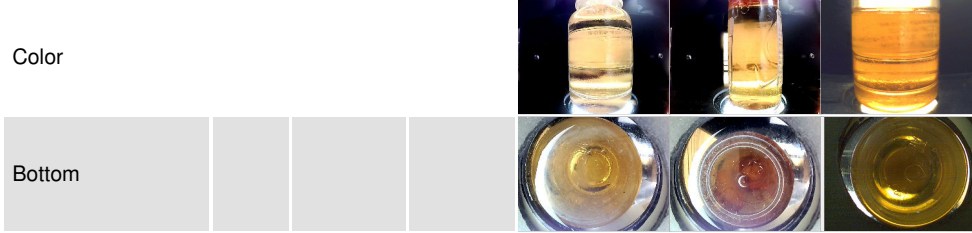

GRAPHS

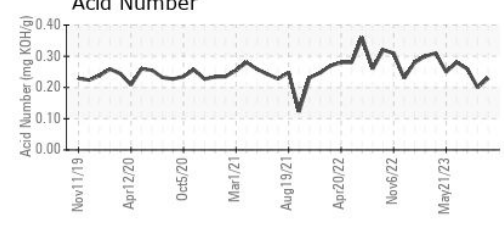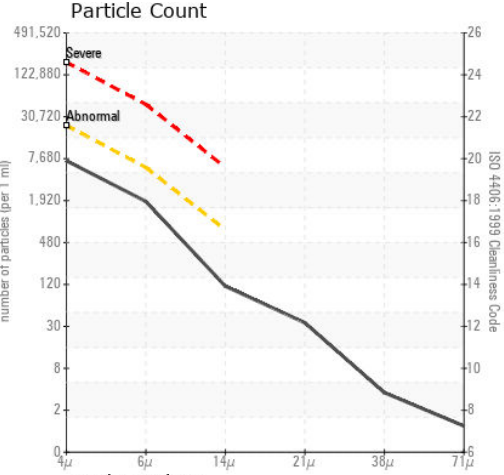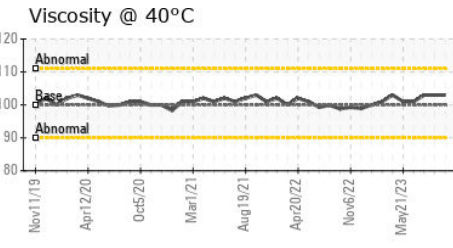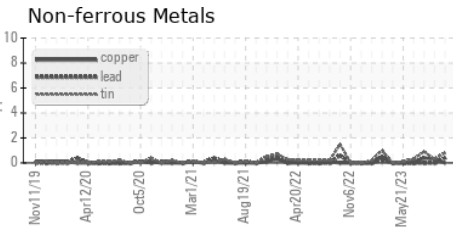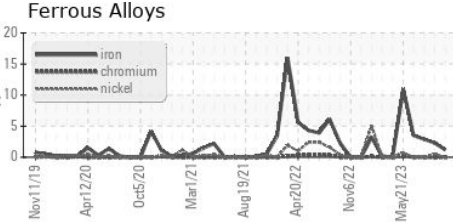

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : USP0001760 **Received** : 02 Oct 2023
Lab Number : 05966367 **Diagnosed** : 03 Oct 2023
Unique Number : 10672918 **Diagnostician** : Doug Bogart
Test Package : IND 2

POET BIO PROCESSING
 1277 102ND ST
 FAIRBANK, IA
 US 50662
 Contact: JASON GOEDKEN
 Jason.Goedken@POET.COM
 T: (319)284-2621
 F:

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)