




# OIL ANALYSIS REPORT

Sample Rating Trend

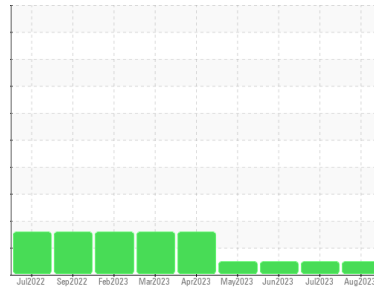

**NORMAL**



Machine Id  
**COMP 401 (S/N 3024)**

Component  
**Compressor**

Fluid  
**VILTER NATURAL GAS (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0803955</b>	WC0803951	WC0803943
Sample Date	Client Info		<b>14 Aug 2023</b>	21 Jul 2023	21 Jun 2023
Machine Age	hrs	Client Info	<b>27526</b>	27003	26285
Oil Age	hrs	Client Info	<b>0</b>	9791	8420
Oil Changed	Client Info		<b>N/A</b>	N/A	Changed
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>1</b>	2	2
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	<b>&lt;1</b>	<1	1
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >25	<b>&lt;1</b>	<1	0
Lead	ppm	ASTM D5185m >25	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m >50	<b>0</b>	<1	<1
Tin	ppm	ASTM D5185m >15	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	<1	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	0
Magnesium	ppm	ASTM D5185m	<b>0</b>	0	0
Calcium	ppm	ASTM D5185m	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	<b>77</b>	76	76
Zinc	ppm	ASTM D5185m	<b>0</b>	0	2
Sulfur	ppm	ASTM D5185m	<b>0</b>	<1	0

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>509</b>	521	525
Sodium	ppm	ASTM D5185m	<b>&lt;1</b>	1	0
Potassium	ppm	ASTM D5185m >20	<b>0</b>	0	<1
Water	%	ASTM D6304 >0.1	<b>0.00</b>	---	0.001
ppm Water	ppm	ASTM D6304 >1000	<b>0.00</b>	---	0.00

## FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	<b>1807</b>	1828	1558
Particles >6µm	ASTM D7647	>2500	<b>567</b>	561	364
Particles >14µm	ASTM D7647	>320	<b>41</b>	41	22
Particles >21µm	ASTM D7647	>80	<b>7</b>	8	4
Particles >38µm	ASTM D7647	>20	<b>1</b>	0	0
Particles >71µm	ASTM D7647	>4	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/15	<b>18/16/13</b>	18/16/13	18/16/12

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.05	<b>0.234</b>	0.26	0.242




# OIL ANALYSIS REPORT

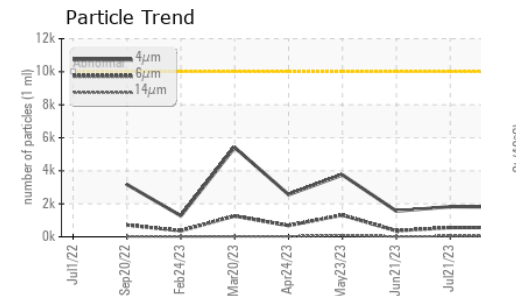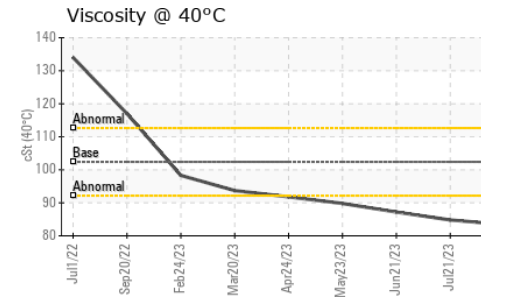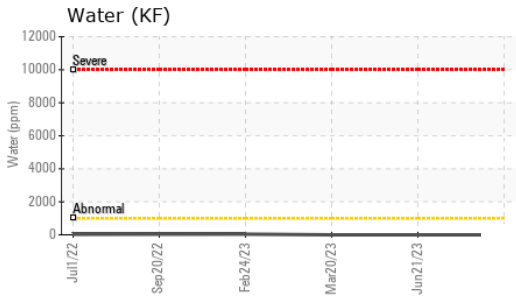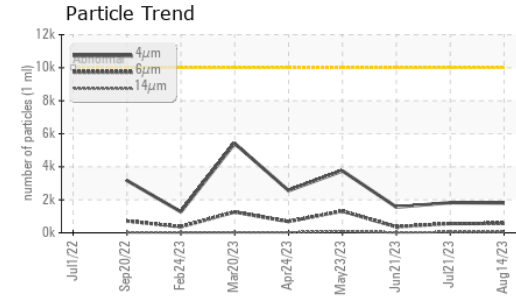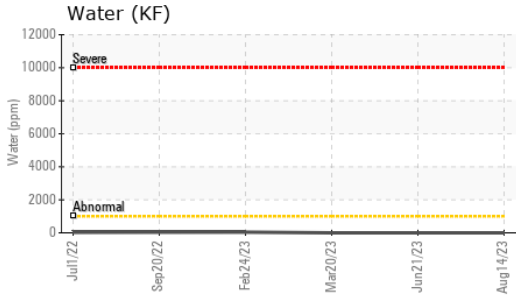





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	102.4	83.4	84.8

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

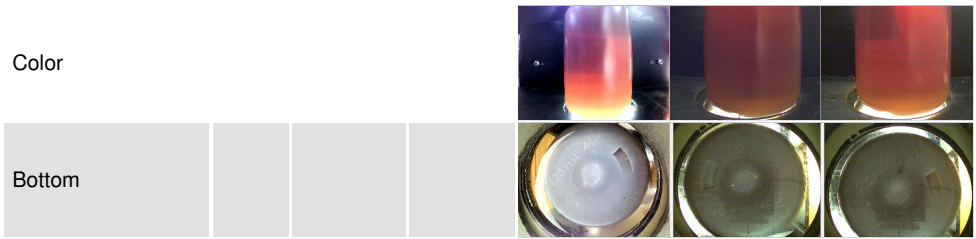

## GRAPHS

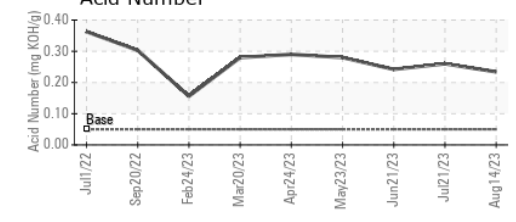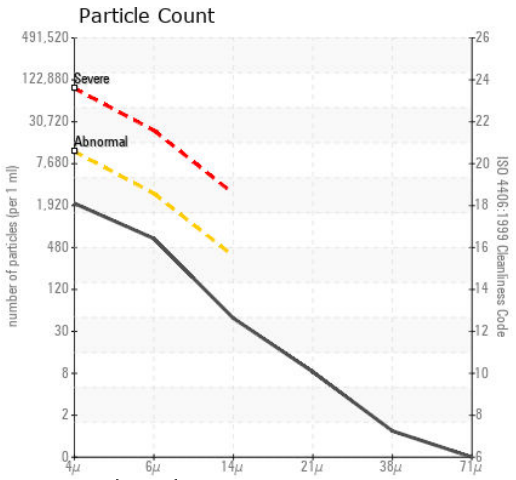

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0803955 **Received** : 02 Oct 2023  
**Lab Number** : 05966403 **Diagnosed** : 03 Oct 2023  
**Unique Number** : 10672954 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**EDL NA Recips-Indy High BTU RNG Plant**  
 2319 KENTUCKY AVE  
 INDIANAPOLIS, IN  
 US 46221  
 Contact: William Prestin  
 william.prestin@edlenergy.com

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: