

OIL ANALYSIS REPORT

Area **ROTO XTEND DUTY** Machine Id **ATLAS COPCO AII366533 - KAISA USA** Component

Compressor

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear


All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



Sample Rating Trend




NORMAL

SAMPLE INFORM	NATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH05966437		
Sample Date		Client Info		25 Sep 2023		
Machine Age	hrs	Client Info		80409		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		motory
Chromium	ppm	ASTM D5185m		0		
Nickel		ASTM D5185m	>0	0		
	ppm	ASTM D5185m		0		
Titanium	ppm			-		
Silver	ppm	ASTM D5185m	4.5	0		
Aluminum	ppm	ASTM D5185m	>15	<1		
Lead	ppm	ASTM D5185m	>65	0		
Copper	ppm	ASTM D5185m	>65	0		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m		0		
Calcium	ppm	ASTM D5185m		<1		
Phosphorus	ppm	ASTM D5185m		38		
Zinc	ppm	ASTM D5185m		18		
Sulfur	ppm	ASTM D5185m		85		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>35	4		
Sodium	ppm	ASTM D5185m		1		
Potassium	ppm	ASTM D5185m	>20	<1		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.14	0.23		
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	LIGHT		
Yellow Metal	scalar	*Visual	NONE	NONE		
Precipitate	scalar	*Visual	NONE	NONE		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	NONE		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML		
Odor	scalar	*Visual	NORML	NORML		
Emulsified Water	scalar	*Visual	>0.1	NEG		
Free Water	scalar	*Visual	2011	NEG		
	Social	Visual				



OIL ANALYSIS REPORT

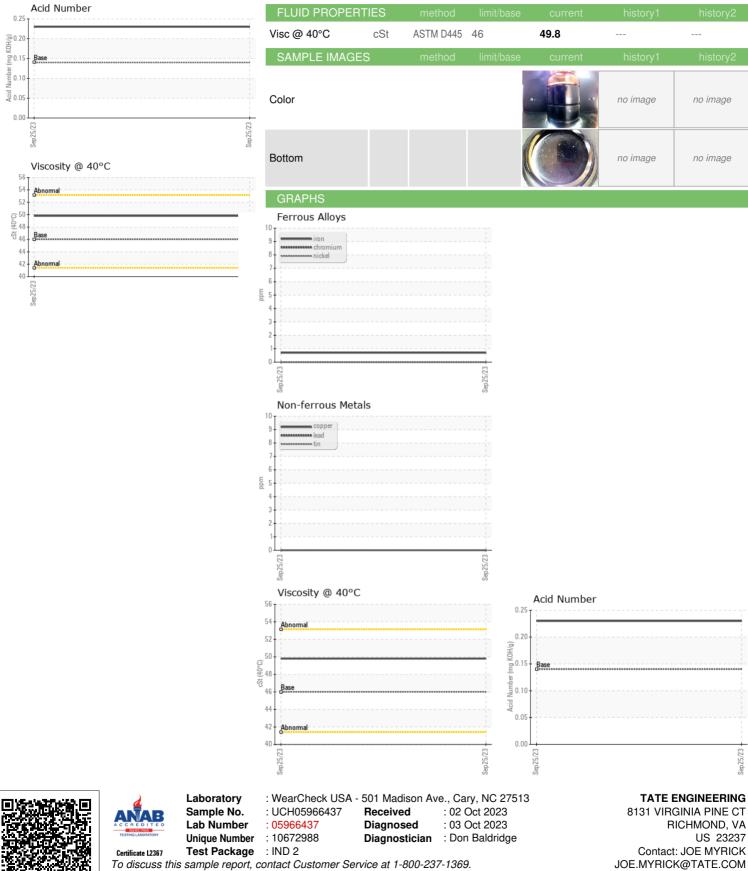

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: JOE MYRICK - UCTATRIC

US 23237

T: (804)339-0007

F: (804)743-0415

no image

no image