



FUEL REPORT


Sample Rating Trend

NORMAL



Area
[CP29159]
Machine Id
T3Y00201 - DELIVERY TRUCK

Component
Diesel Fuel
Fluid
DIESEL FUEL No. 2 (--- QTS)

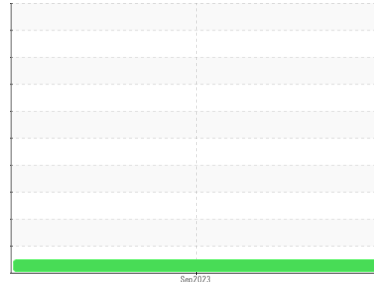

DIAGNOSIS

Recommendation

ASTM D0482, D5452, and D6079 performed at subcontracted ISO 17025 laboratory. All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel.

Corrosion

All metal levels are normal indicating no corrosion in the system.

Contaminants

The water content is negligible. There is no bacteria or fungus (yeast and/or mold) indicated in the sample. There is no indication of any contamination in the fuel. The amount and size of particulates present in the system are acceptable.

Fuel Condition

Sulfur value derived by ASTM D5453 method for ULSD validation. Sulfur level is acceptable for ULSD specification.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0863784	---	---
Sample Date	Client Info			22 Sep 2023	---	---
Machine Age	hrs	Client Info		0	---	---
Sample Status				NORMAL	---	---

PHYSICAL PROPERTIES		method	limit/base	current	history1	history2
Specific Gravity		*ASTM D1298		0.840	---	---
Fuel Color	text	*Visual Screen		Red	---	---
ASTM Color	scalar	*ASTM D1500		L4.0	---	---
Visc @ 40°C	cSt	ASTM D445	4.1	2.43	---	---
Pensky-Martens Flash Point	°C	*PMCC Calculated		58	---	---

SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m		2	---	---
Sulfur (UVF)	ppm	ASTM D5453		10	---	---






DISTILLATION		method	limit/base	current	history1	history2
Initial Boiling Point	°C	ASTM D86		163	---	---
5% Distillation Point	°C	ASTM D86		189	---	---
10% Distill Point	°C	ASTM D86		201	---	---
15% Distillation Point	°C	ASTM D86		211	---	---
20% Distill Point	°C	ASTM D86		218	---	---
30% Distill Point	°C	ASTM D86		232	---	---
40% Distill Point	°C	ASTM D86		247	---	---
50% Distill Point	°C	ASTM D86		260	---	---
60% Distill Point	°C	ASTM D86		274	---	---
70% Distill Point	°C	ASTM D86		289	---	---
80% Distill Point	°C	ASTM D86		305	---	---
85% Distillation Point	°C	ASTM D86		314	---	---
90% Distill Point	°C	ASTM D86		326	---	---
95% Distillation Point	°C	ASTM D86		343	---	---
Final Boiling Point	°C	ASTM D86		351	---	---
Distillation Residue	%	ASTM D86		1.4	---	---
Distillation Loss	%	ASTM D86		0.9	---	---

IGNITION QUALITY		method	limit/base	current	history1	history2
API Gravity		ASTM D7777		37.0	---	---
Cetane Index		ASTM D4737	<40.0	48.6	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	0	---	---
Sodium	ppm	ASTM D5185m	<0.1	0	---	---
Potassium	ppm	ASTM D5185m	<0.1	0	---	---
Water	%	ASTM D6304	<0.05	0.002	---	---
ppm Water	ppm	ASTM D6304	<500	23.4	---	---
% Gasoline	%	*In-House	<0.50	0.0	---	---
% Biodiesel	%	*In-House	<20.0	0.0	---	---





FUEL REPORT

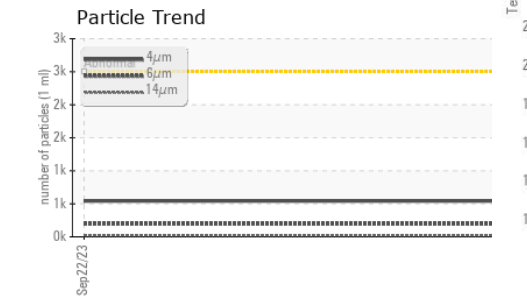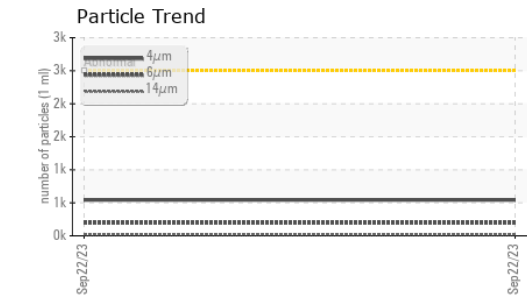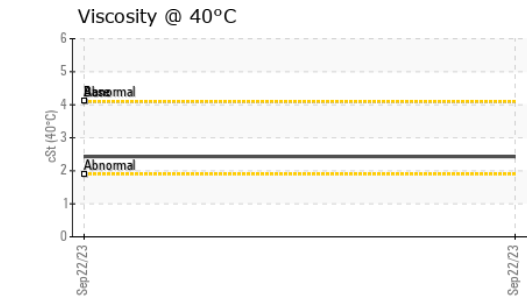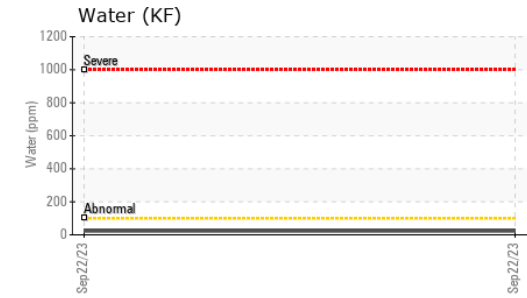
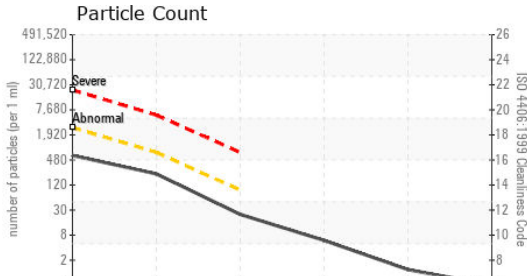


FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>2500	542	---	---
Particles >6µm	ASTM D7647	>640	196	---	---
Particles >14µm	ASTM D7647	>80	21	---	---
Particles >21µm	ASTM D7647	>20	5	---	---
Particles >38µm	ASTM D7647	>4	1	---	---
Particles >71µm	ASTM D7647	>3	0	---	---
Oil Cleanliness	ISO 4406 (c)	>18/16/13	16/15/12	---	---

HEAVY METALS	method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m <0.1	<1	---	---
Nickel	ppm	ASTM D5185m <0.1	0	---	---
Lead	ppm	ASTM D5185m <0.1	0	---	---
Vanadium	ppm	ASTM D5185m <0.1	0	---	---
Iron	ppm	ASTM D5185m <0.1	0	---	---
Calcium	ppm	ASTM D5185m <0.1	1	---	---
Magnesium	ppm	ASTM D5185m <0.1	2	---	---
Phosphorus	ppm	ASTM D5185m <0.1	4	---	---
Zinc	ppm	ASTM D5185m <0.1	0	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

GRAPHS

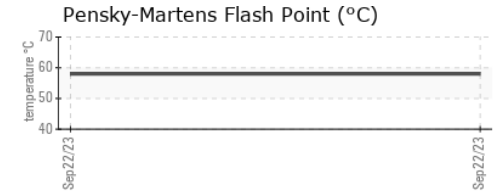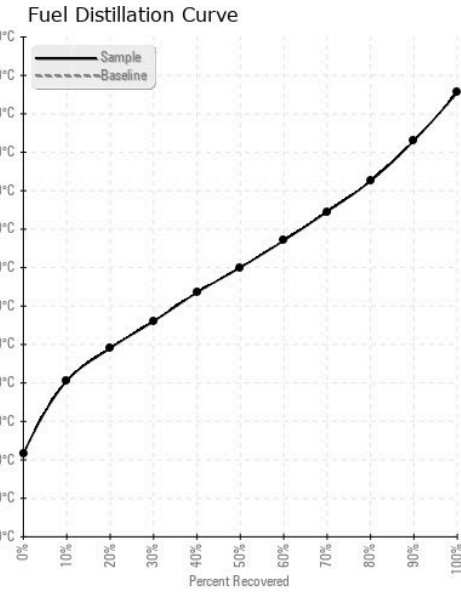

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0863784 **Received** : 02 Oct 2023
Lab Number : **05966773** **Diagnosed** : 26 Oct 2023
Unique Number : 10673324 **Diagnostician** : Doug Bogart
Test Package : DF-2 (Additional Tests: Screen)

CARTER MACHINERY COMPANY INC
 1330 LYNCHBURG TURNPIKE
 SALEM, VA
 US 24153
 Contact: Gary Wheeler
 gary_wheeler@cartermachinery.com
 T: (540)387-1111
 F: (540)387-1814

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)