


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



7376154 (S/N 1327) Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

D	IΑ	Gi	MC.).5	18
	I/ V	uі	4	\sim	\cdot

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Jun 2022	Sep2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA006381	KCP40776	
Sample Date		Client Info		26 Sep 2023	27 Jun 2022	
Machine Age	hrs	Client Info		8560	4271	
Oil Age	hrs	Client Info		0	2000	
Oil Changed		Client Info		N/A	Changed	
Sample Status				NORMAL	NORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	1	2	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	5	3	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	10	8	
Tin	ppm	ASTM D5185m	>10	0	<1	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	3	
Barium	ppm	ASTM D5185m	90	0	0	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m	100	2	0	
Calcium	ppm	ASTM D5185m	0	0	0	
Phosphorus	ppm	ASTM D5185m	0	224	226	
Zinc	ppm	ASTM D5185m	0	222	257	
Sulfur	ppm	ASTM D5185m	23500	1491	1672	
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	0	
Sodium	ppm	ASTM D5185m		0	1	
Potassium	ppm	ASTM D5185m	>20	<1	0	
Water	%	ASTM D6304	>0.05	0.003	0.004	
ppm Water	ppm	ASTM D6304	>500	30.1	48.5	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		2069	2986	
Particles >6μm		ASTM D7647	>1300	598	530	
Particles >14μm		ASTM D7647	>80	25	14	
Particles >21µm		ASTM D7647	>20	7	4	
Particles >38µm		ASTM D7647	>4	1	0	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/16/12	19/16/11	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
A at al. N.L. made and (ANI)	I/OII/-	ACTM DOOM	1.0	0.60	0.01	

Acid Number (AN)


mg KOH/g ASTM D8045 1.0

0.61

0.60



OIL ANALYSIS REPORT

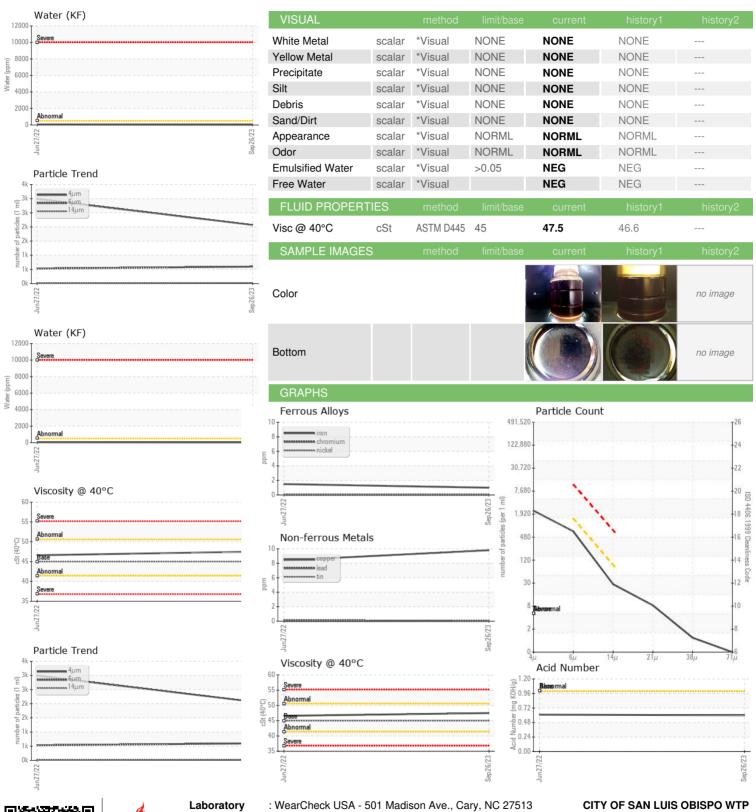





Sample No. Lab Number **Unique Number**

: KCPA006381

: 05967041 : 10673592 Received Diagnosed

: 02 Oct 2023 : 04 Oct 2023

Diagnostician : Jonathan Hester

Test Package : IND 2 (Additional Tests: KF, PrtCount) Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

1900 STENNER CREEK RD SAN LUIS OBISPO, CA US 93405

Contact: S. DUNTON sdunton@slocity.org

T:

F: Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)