




# PROBLEM SUMMARY


Sample Rating Trend

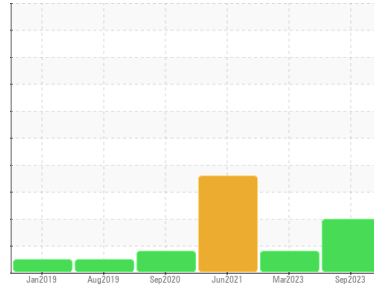

Machine Id  
**KAESER SFC 55 6273890 (S/N 1116)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) FG-460 (--- GAL)**

## COMPONENT CONDITION SUMMARY

▲ Particle Trend

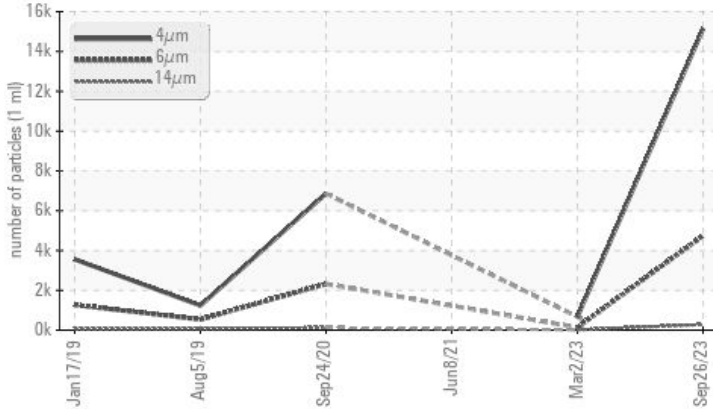

## RECOMMENDATION

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ABNORMAL	ABNORMAL
Particles >6µm	ASTM D7647	>1300	▲ 4734	134	---
Particles >14µm	ASTM D7647	>80	▲ 280	11	---
Particles >21µm	ASTM D7647	>20	▲ 81	5	---
Particles >38µm	ASTM D7647	>4	▲ 5	0	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 21/19/15	17/14/11	---

Customer Id: CAMSHA  
 Sample No.: KCPA001049  
 Lab Number: 05967054  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Jonathan Hester +1 919-379-4092 x4092  
[jhester@wearcheckusa.com](mailto:jhester@wearcheckusa.com)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

*There are no recommended actions for this sample.*

## HISTORICAL DIAGNOSIS

### 02 Mar 2023 Diag: Don Baldrige

#### WEAR



Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor. The aluminum level is abnormal. All other component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 08 Jun 2021 Diag: Don Baldrige

#### WATER



Oil and filter change at the time of sampling has been noted. We recommend an early resample in 500 hours to monitor this condition. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. There is a light concentration of water present in the oil. Free water present. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid.

view report



### 24 Sep 2020 Diag: Angela Borella

#### ISO



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report



Machine Id  
**KAESER SFC 55 6273890 (S/N 1116)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) FG-460 (--- GAL)**

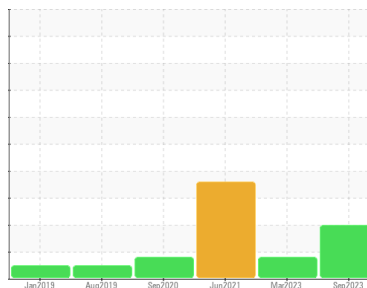

## DIAGNOSIS

### ▲ Recommendation

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### ▲ Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA001049</b>	KC101697	KC99971
Sample Date	Client Info			<b>26 Sep 2023</b>	02 Mar 2023	08 Jun 2021
Machine Age	hrs	Client Info		<b>35942</b>	32345	21469
Oil Age	hrs	Client Info		<b>0</b>	2574	4948
Oil Changed	Client Info			<b>N/A</b>	Changed	Changed
Sample Status				<b>ABNORMAL</b>	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>1</b>	5	2
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>3</b>	▲ 21	9
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m	>50	<b>&lt;1</b>	<1	2
Tin	ppm	ASTM D5185m	>10	<b>0</b>	0	<1
Antimony	ppm	ASTM D5185m		<b>---</b>	---	1
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	<1
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m		<b>0</b>	<1	1
Calcium	ppm	ASTM D5185m		<b>0</b>	3	0
Phosphorus	ppm	ASTM D5185m	500	<b>17</b>	322	132
Zinc	ppm	ASTM D5185m		<b>1</b>	135	46
Sulfur	ppm	ASTM D5185m		<b>973</b>	1778	1189

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>0</b>	<1	0
Sodium	ppm	ASTM D5185m		<b>0</b>	0	<1
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	0	0
Water	%	ASTM D6304	>0.05	<b>0.012</b>	0.003	▲ 0.270
ppm Water	ppm	ASTM D6304	>500	<b>120.8</b>	26.8	▲ 2700

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>15135</b>	668	---
Particles >6µm		ASTM D7647	>1300	▲ <b>4734</b>	134	---
Particles >14µm		ASTM D7647	>80	▲ <b>280</b>	11	---
Particles >21µm		ASTM D7647	>20	▲ <b>81</b>	5	---
Particles >38µm		ASTM D7647	>4	▲ <b>5</b>	0	---
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ <b>21/19/15</b>	17/14/11	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.5	<b>0.37</b>	1.19	0.503

# OIL ANALYSIS REPORT

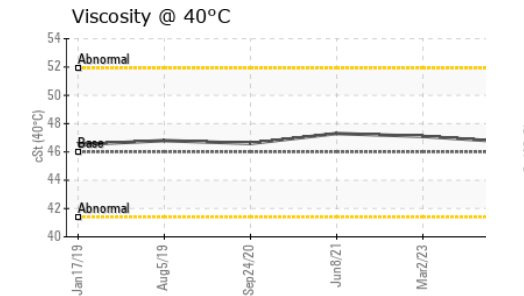
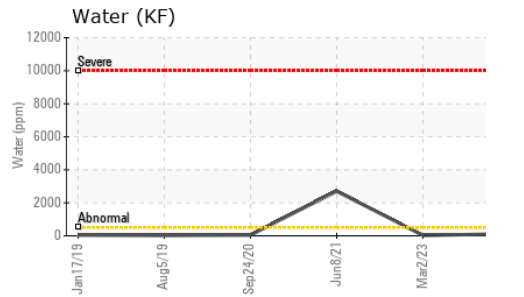
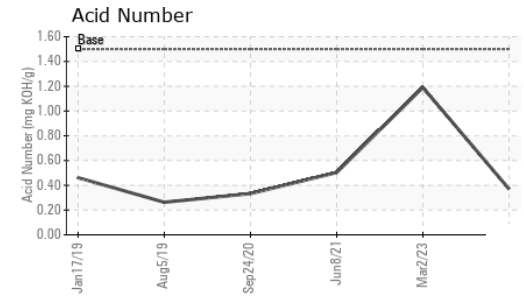
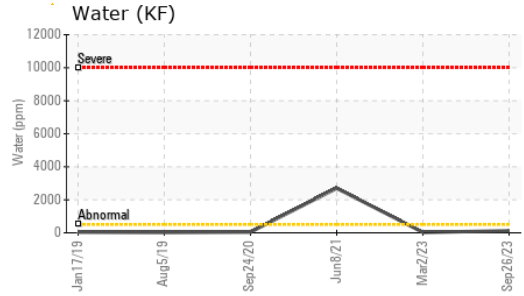
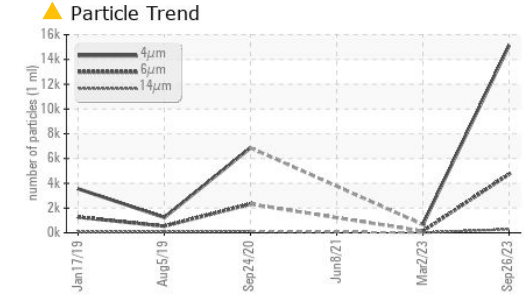


PARAMETER	VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG	▲ 1.0

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	<b>46.7</b>	47.1	47.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

## GRAPHS

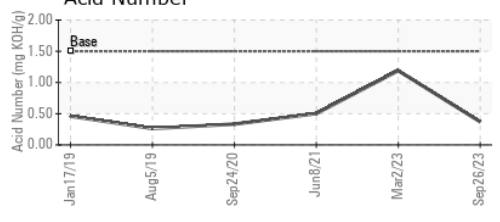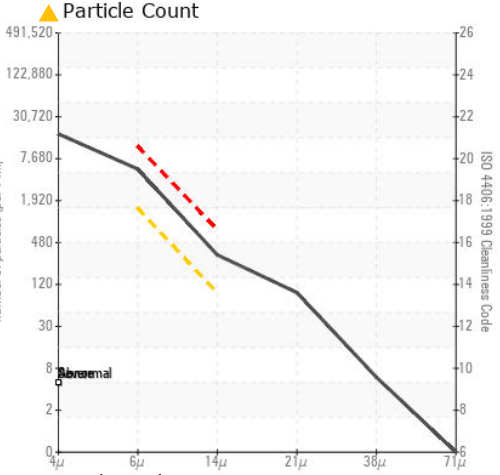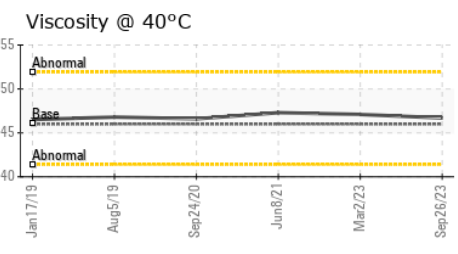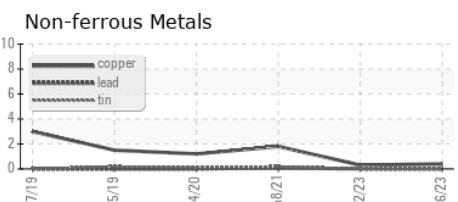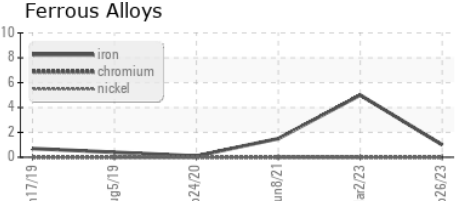

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA001049 **Received** : 02 Oct 2023  
**Lab Number** : 05967054 **Diagnosed** : 06 Oct 2023  
**Unique Number** : 10673605 **Diagnostician** : Jonathan Hester  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**CAMERONS SPECIALTY COFFEE**  
 5700 12TH AVE E  
 SHAKOPEE, MN  
 US 55379  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: