

# **PROBLEM SUMMARY**

ISO

# KAESER SK 20 6849174 (S/N 1282)


Compressor

KAESER SIGMA (OEM) M-460 (--- QTS)

# Sample Rating Trend



## **COMPONENT CONDITION SUMMARY**

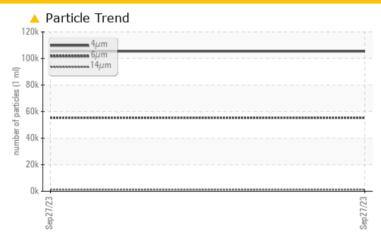

## RECOMMENDATION

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST	T RESULTS			
Sample Status			<b>ABNORMAL</b>	 
Particles >6µm	ASTM D7647	>1300	<b>△</b> 55366	 
Particles >14µm	ASTM D7647	>80	<b>1334</b>	 
Particles >21µm	ASTM D7647	>20	<b>△</b> 66	 
Oil Cleanliness	ISO 4406 (c)	>/17/13	<b>4</b> 24/23/18	 

Customer Id: BRMMENWI Sample No.: KCPA000959 Lab Number: 05967055 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Jonathan Hester +1 919-379-4092 x4092 jhester@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

## RECOMMENDED ACTIONS

There are no recommended actions for this sample.

## HISTORICAL DIAGNOSIS



# **OIL ANALYSIS REPORT**

ISO

KAESER SK 20 6849174 (S/N 1282)

Compressor

KAESER SIGMA (OEM) M-460 (--- QTS)

# Sample Rating Trend



## **DIAGNOSIS**

## Recommendation

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

All component wear rates are normal.

## Contamination

There is a high amount of particulates present in the oil.

## **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Sep 2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA000959		
Sample Date		Client Info		27 Sep 2023		
Machine Age	hrs	Client Info		1273		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	1		
Lead	ppm	ASTM D5185m	>10	<1		
Copper	ppm	ASTM D5185m	>50	4		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	17		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	100	71		
Calcium	ppm	ASTM D5185m	0	2		
Phosphorus	ppm	ASTM D5185m	0	3		
Zinc	ppm	ASTM D5185m		3		
Sulfur	ppm	ASTM D5185m	23500	20479		
CONTAMINANTS	6	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		12		
Potassium	ppm	ASTM D5185m	>20	12		
Water	%	ASTM D6304	>0.05	0.037		
opm Water	ppm	ASTM D6304	>500	379.4		
FLUID CLEANLIN	NESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		105409		
Particles >6µm		ASTM D7647	>1300	<b>△</b> 55366		
Particles >14µm		ASTM D7647	>80	<b>1334</b>		
Particles >21µm		ASTM D7647	>20	<b>^</b> 66		
Particles >38µm		ASTM D7647	>4	3		
Particles >71µm		ASTM D7647	>3	1		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>4</u> 24/23/18		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	ma K∩H/a	ASTM DROVE	1.0	0.34		


Acid Number (AN)

mg KOH/g ASTM D8045 1.0

0.34



## **OIL ANALYSIS REPORT**

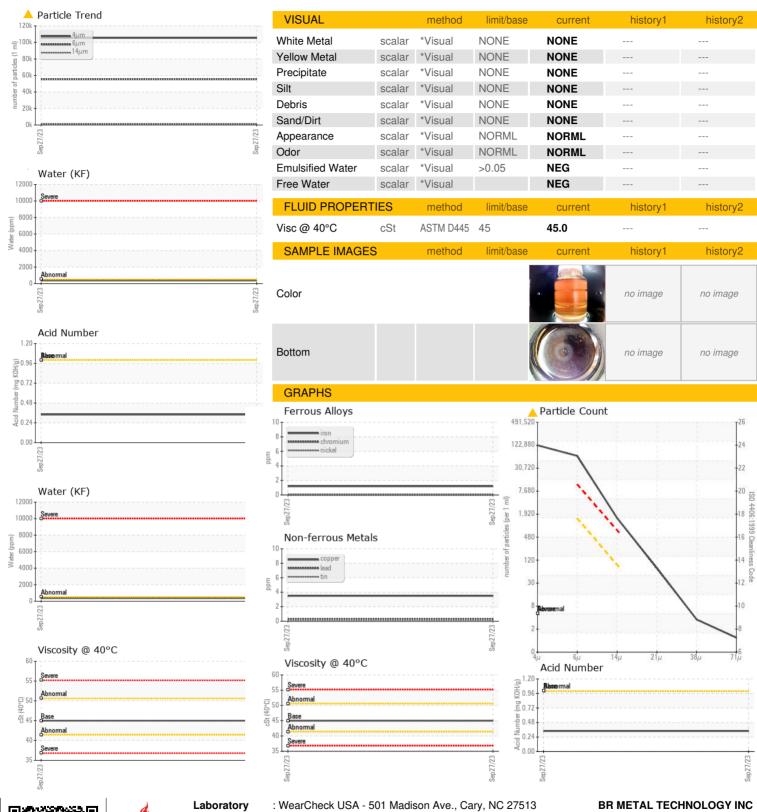





Certificate L2367

Sample No. Lab Number **Unique Number** 

: KCPA000959 : 05967055

: 10673606

Received Diagnosed

: 02 Oct 2023 : 04 Oct 2023

Diagnostician : Jonathan Hester Test Package : IND 2 ( Additional Tests: KF, PrtCount )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

N52W13366 FALLS CREEK CT MENOMONEE FALLS, WI US 53051

Contact: MIKE

MIKE@BRMETAL.COM

T:

F:

Contact/Location: MIKE - BRMMENWI