

PROBLEM SUMMARY

Sample Rating Trend

ISO

KAESER 4220165 (S/N NOT GIVEN)


Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)





COMPONENT CONDITION SUMMARY

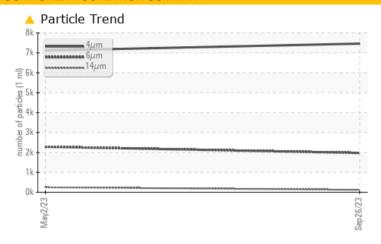

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS										
Sample Status			ATTENTION	ABNORMAL						
Particles >6µm	ASTM D7647	>1300	1973	<u>^</u> 2284						
Particles >14µm	ASTM D7647	>80	<u> </u>	<u>4</u> 249						
Particles >21µm	ASTM D7647	>20	△ 30	<u>^</u> 86						
Oil Cleanliness	ISO 4406 (c)	>/17/13	20/18/14	20/18/15						

Customer Id: NOREASNY Sample No.: KCPA006237 Lab Number: 05967062 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

02 May 2023 Diag: Don Baldridge

ISO




We recommend you service the filters on this component. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT



KAESER 4220165 (S/N NOT GIVEN)

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			May2023	Sep2023		
SAMPLE INFORM	AATIONI	method	limit/base		history1	hiotony
	MATION		IIIIII/base	current	,	history2
Sample Number		Client Info		KCPA006237	KCP52710	
Sample Date	la una	Client Info		26 Sep 2023	02 May 2023	
Machine Age	hrs	Client Info		25063 0	0	
Oil Age	hrs	Client Info		N/A	N/A	
Oil Changed Sample Status		Client inio		ATTENTION	ABNORMAL	
				ATTENTION		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	1	<1	
Chromium	ppm		>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	<1	
Titanium	ppm	ASTM D5185m		0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	2	0	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	2	5	
Tin	ppm	ASTM D5185m	>10	0	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	90	5	2	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		0	<1	
Magnesium	ppm	ASTM D5185m	100	39	4	
Calcium	ppm	ASTM D5185m	0	0	0	
Phosphorus	ppm	ASTM D5185m	0	2	2	
Zinc	ppm	ASTM D5185m	0	21	0	
Sulfur	ppm	ASTM D5185m	23500	21035	24073	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	0	
Sodium	ppm	ASTM D5185m		7	<1	
Potassium	ppm	ASTM D5185m	>20	2	<1	
Water	%	ASTM D6304	>0.05	0.028	0.049	
ppm Water	ppm	ASTM D6304	>500	286.6	495.9	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		7463	7117	
Particles >6µm		ASTM D7647	>1300	1973	<u>^</u> 2284	
Particles >14µm		ASTM D7647	>80	<u> </u>	<u>^</u> 249	
Particles >21µm		ASTM D7647	>20	A 30	<u></u> 86	
Particles >38µm		ASTM D7647	>4	1	<u>^</u> 7	
Particles >71μm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>^</u> 20/18/14	<u>^</u> 20/18/15	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.35	0.53	



OIL ANALYSIS REPORT

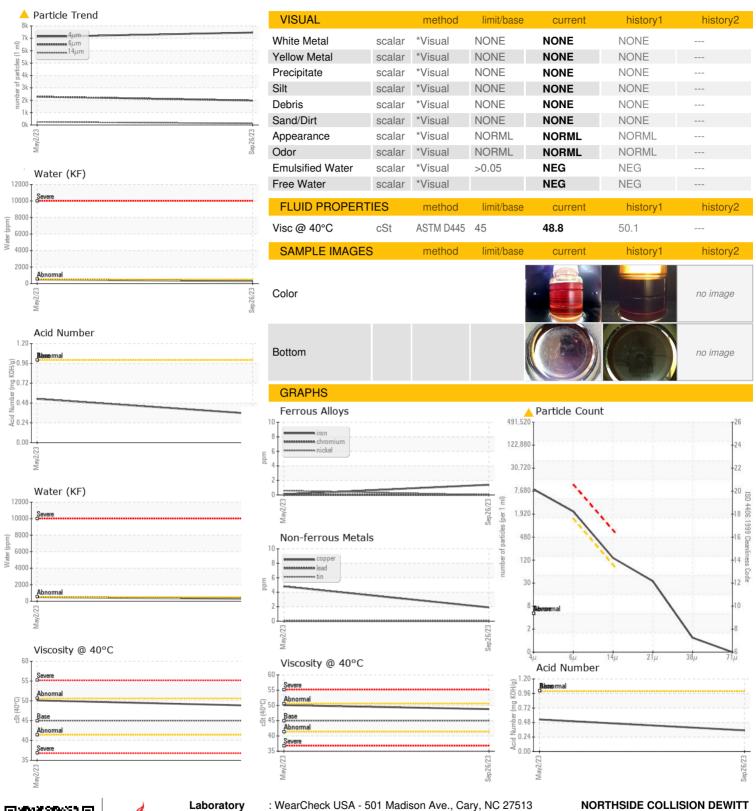





Certificate L2367

Laboratory Sample No. Lab Number **Unique Number**

: 05967062 : 10673613

Received : KCPA006237

Diagnosed Diagnostician : Don Baldridge

: 02 Oct 2023

: 04 Oct 2023

Test Package : IND 2 (Additional Tests: KF, PrtCount) To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

6881 MANLIUS CENTER RD

EAST SYRACUSE, NY US 13057

Contact: Service Manager

T: F: