




# PROBLEM SUMMARY


Sample Rating Trend

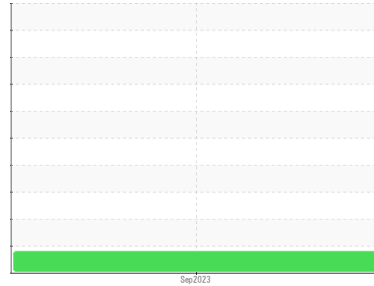

Machine Id  
**KAESER ASD 30T 5136972 (S/N 1053)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- QTS)**

## COMPONENT CONDITION SUMMARY

### ▲ Particle Trend

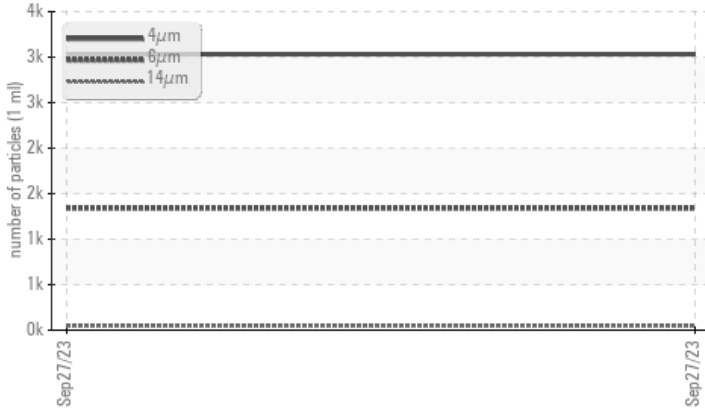

## RECOMMENDATION

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status			<b>ATTENTION</b>	---	---
Particles >6µm	ASTM D7647	>1300	▲ <b>1340</b>	---	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ <b>19/18/13</b>	---	---

Customer Id: BRMMENWI  
 Sample No.: KCP48035D  
 Lab Number: 05967073  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Don Baldrige +1  
[don.b505@comcast.net](mailto:don.b505@comcast.net)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.

## HISTORICAL DIAGNOSIS



# OIL ANALYSIS REPORT

Sample Rating Trend



ISO



Machine Id  
**KAESER ASD 30T 5136972 (S/N 1053)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- QTS)**

## DIAGNOSIS

### Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KCP48035D</b>	---	---
Sample Date	Client Info		<b>27 Sep 2023</b>	---	---
Machine Age	hrs	Client Info	<b>12389</b>	---	---
Oil Age	hrs	Client Info	<b>4000</b>	---	---
Oil Changed	Client Info		<b>Changed</b>	---	---
Sample Status			<b>ATTENTION</b>	---	---

WEAR METALS	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>&lt;1</b>	---	---
Chromium	ppm	ASTM D5185m >10	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m >3	<b>0</b>	---	---
Titanium	ppm	ASTM D5185m >3	<b>0</b>	---	---
Silver	ppm	ASTM D5185m >2	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m >10	<b>1</b>	---	---
Lead	ppm	ASTM D5185m >10	<b>0</b>	---	---
Copper	ppm	ASTM D5185m >50	<b>6</b>	---	---
Tin	ppm	ASTM D5185m >10	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	---	---

ADDITIVES	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	---	---
Barium	ppm	ASTM D5185m 90	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m	<b>0</b>	---	---
Manganese	ppm	ASTM D5185m	<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m 90	<b>36</b>	---	---
Calcium	ppm	ASTM D5185m 2	<b>0</b>	---	---
Phosphorus	ppm	ASTM D5185m	<b>2</b>	---	---
Zinc	ppm	ASTM D5185m	<b>84</b>	---	---
Sulfur	ppm	ASTM D5185m	<b>25562</b>	---	---


CONTAMINANTS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>&lt;1</b>	---	---
Sodium	ppm	ASTM D5185m	<b>13</b>	---	---
Potassium	ppm	ASTM D5185m >20	<b>4</b>	---	---
Water	%	ASTM D6304 >0.05	<b>0.025</b>	---	---
ppm Water	ppm	ASTM D6304 >500	<b>251.7</b>	---	---

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>3032</b>	---	---
Particles >6µm	ASTM D7647	>1300	<b>▲ 1340</b>	---	---
Particles >14µm	ASTM D7647	>80	<b>46</b>	---	---
Particles >21µm	ASTM D7647	>20	<b>6</b>	---	---
Particles >38µm	ASTM D7647	>4	<b>0</b>	---	---
Particles >71µm	ASTM D7647	>3	<b>0</b>	---	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	<b>▲ 19/18/13</b>	---	---


FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	<b>0.34</b>	---	---

# OIL ANALYSIS REPORT


## ▲ Particle Trend

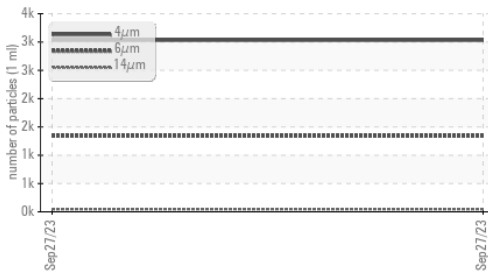

## Water (KF)

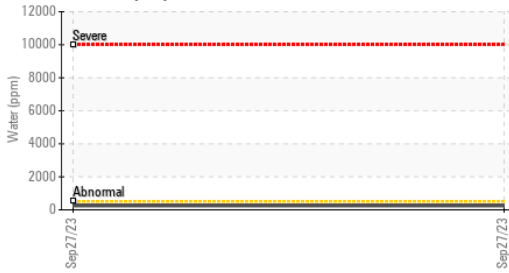


## Acid Number

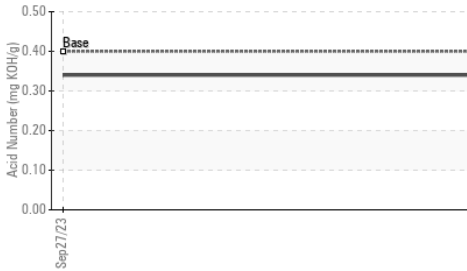

## Water (KF)



## Viscosity @ 40°C

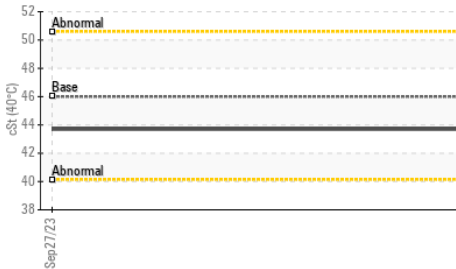

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	---
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	---
Debris	scalar	*Visual	NONE	<b>NONE</b>	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	---
Emulsified Water	scalar	*Visual	>0.05	<b>NEG</b>	---
Free Water	scalar	*Visual		<b>NEG</b>	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	<b>43.7</b>	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------


Color				no image	no image
Bottom				no image	no image

## GRAPHS


### Ferrous Alloys




### Non-ferrous Metals

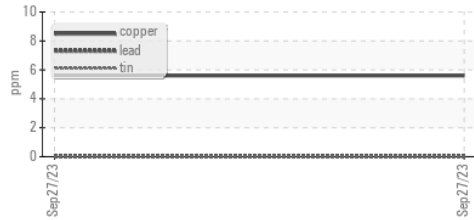

### Viscosity @ 40°C

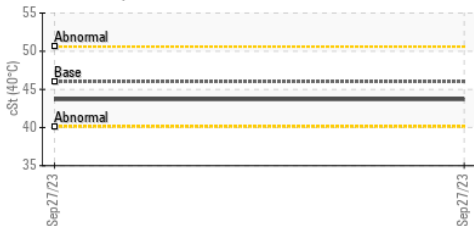

### ▲ Particle Count

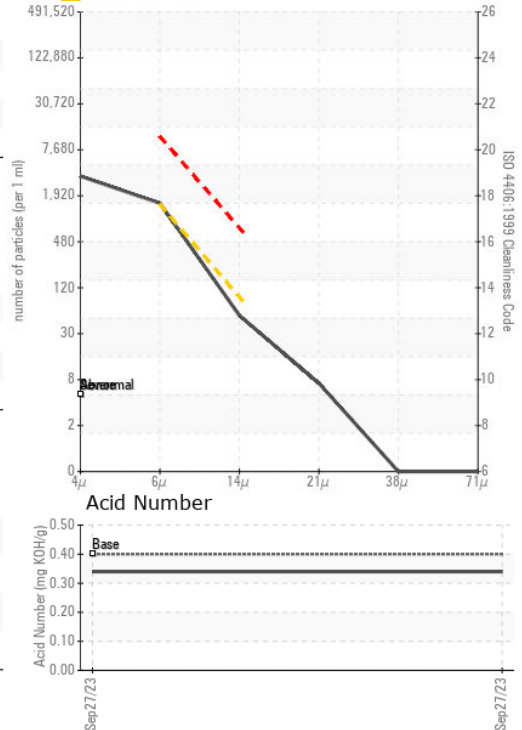

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCP48035D **Received** : 02 Oct 2023  
**Lab Number** : 05967073 **Diagnosed** : 04 Oct 2023  
**Unique Number** : 10673624 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**BR METAL TECHNOLOGY INC**  
 N52W13366 FALLS CREEK CT  
 MENOMONEE FALLS, WI  
 US 53051  
 Contact: MIKE  
 MIKE@BRMETAL.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: