


OIL ANALYSIS REPORT



NORMAL



KAESER 7473587

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Sep	2021	Oct2022 Sep20	23	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC126153	KC107835	KC99440
Sample Date		Client Info		25 Sep 2023	07 Oct 2022	21 Sep 2021
Machine Age	hrs	Client Info		674	536	207
Oil Age	hrs	Client Info		0	329	207
Oil Changed		Client Info		N/A	Changed	Changed
Sample Status				NORMAL	ABNORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	<1
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	1	<1	<1
Lead	ppm	ASTM D5185m	>10	0	<1	1
Copper	ppm	ASTM D5185m	>50	0	<1	<1
Tin	ppm	ASTM D5185m	>10	0	0	<1
Antimony	ppm	ASTM D5185m				0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	50	18	16
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	<1	<1
Magnesium	ppm	ASTM D5185m	90	75	66	70
Calcium	ppm	ASTM D5185m	2	1	<1	0
Phosphorus	ppm	ASTM D5185m		2	0	4
Zinc	ppm	ASTM D5185m		1	2	3
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	3	5	<1
Sodium	ppm	ASTM D5185m		5	5	6
Potassium	ppm	ASTM D5185m	>20	2	4	6
Water	%	ASTM D6304	>0.05	0.031	0.016	0.023
ppm Water	ppm	ASTM D6304	>500	315.0	165.4	238.1
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1257	9880	2316
Particles >6µm		ASTM D7647	>1300	379	△ 3064	992
Particles >14μm		ASTM D7647	>80	17	△ 197	50
Particles >21µm		ASTM D7647	>20	5	<u>△</u> 25	11
Particles >38μm		ASTM D7647	>4	1	2	0
Particles >71µm		ASTM D7647	>3	1	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	17/16/11	2 0/19/15	17/13
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.30	0.35	0.305



OIL ANALYSIS REPORT

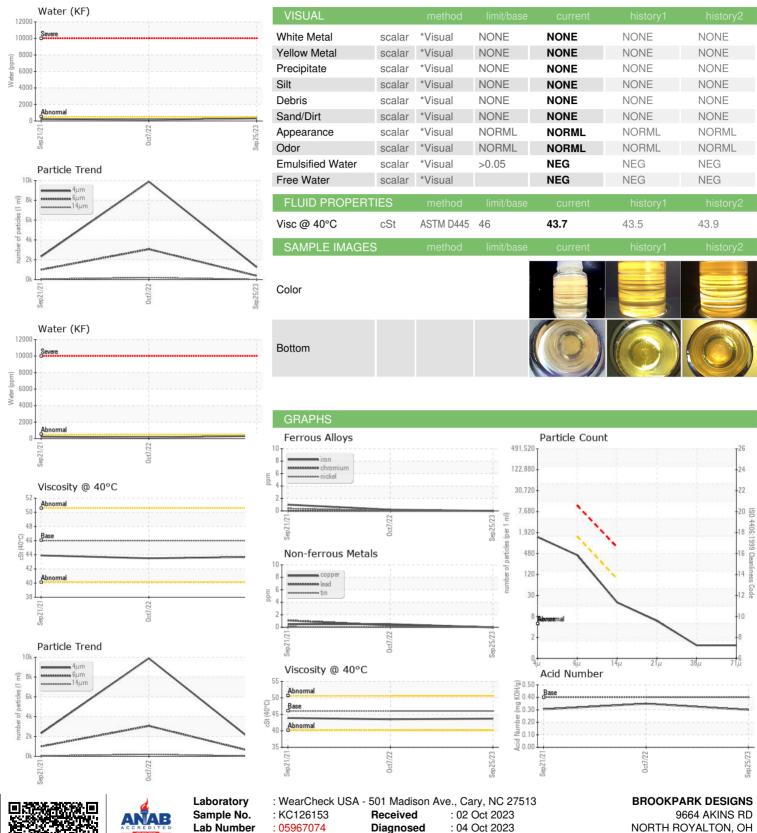





Certificate L2367

Lab Number **Unique Number** Test Package

: 05967074 : 10673625 : IND 2

Diagnosed : 04 Oct 2023

Diagnostician

: Don Baldridge

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

US 44133

T: F:

Contact: Service Manager