



PROBLEM SUMMARY

Sample Rating Trend




ISO



Machine Id
KAESER 1569650 (S/N 576233)
 Component
Compressor
 Fluid
NOT GIVEN (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

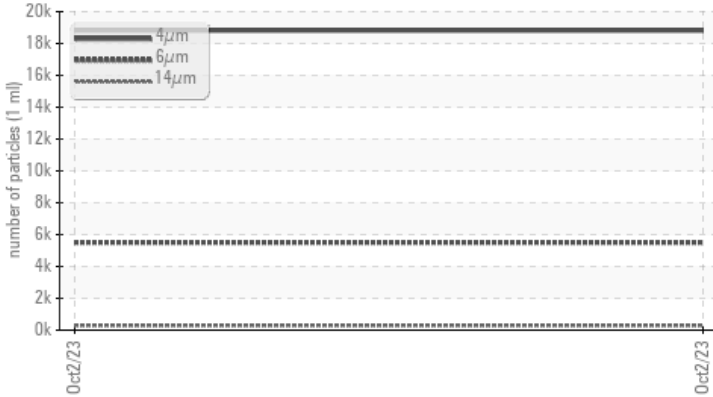

RECOMMENDATION

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

PROBLEMATIC TEST RESULTS

| Sample Status | | | ABNORMAL | --- | --- |
|-----------------|--------------|-----------|-------------------|-----|-----|
| Particles >6µm | ASTM D7647 | >1300 | ▲ 5502 | --- | --- |
| Particles >14µm | ASTM D7647 | >80 | ▲ 290 | --- | --- |
| Particles >21µm | ASTM D7647 | >20 | ▲ 67 | --- | --- |
| Oil Cleanliness | ISO 4406 (c) | >--/17/13 | ▲ 21/20/15 | --- | --- |

Customer Id: PLAARV
 Sample No.: KCP48100
 Lab Number: 05967079
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

| Action | Status | Date | Done By | Description |
|----------------------|--------|------|---------|-------------------------------------------------------------------------------|
| Change Fluid | --- | --- | ? | Oil and filter change at the time of sampling has been noted. |
| Change Filter | --- | --- | ? | Oil and filter change at the time of sampling has been noted. |
| Information Required | --- | --- | ? | Please specify the brand, type, and viscosity of the oil on your next sample. |

HISTORICAL DIAGNOSIS



OIL ANALYSIS REPORT

Sample Rating Trend



ISO



Machine Id
KAESER 1569650 (S/N 576233)

Component
Compressor
Fluid
NOT GIVEN (--- GAL)

DIAGNOSIS

▲ Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

| method | limit/base | current | history1 | history2 |
|---------------|-----------------|--------------------|----------|----------|
| Sample Number | Client Info | KCP48100 | --- | --- |
| Sample Date | Client Info | 02 Oct 2023 | --- | --- |
| Machine Age | hrs Client Info | 45943 | --- | --- |
| Oil Age | hrs Client Info | 0 | --- | --- |
| Oil Changed | Client Info | Changed | --- | --- |
| Sample Status | | ABNORMAL | --- | --- |

WEAR METALS

| method | limit/base | current | history1 | history2 |
|--------------|-----------------|--------------|----------|----------|
| Iron ppm | ASTM D5185m >50 | 0 | --- | --- |
| Chromium ppm | ASTM D5185m >10 | 0 | --- | --- |
| Nickel ppm | ASTM D5185m >3 | 0 | --- | --- |
| Titanium ppm | ASTM D5185m >3 | 0 | --- | --- |
| Silver ppm | ASTM D5185m >2 | 0 | --- | --- |
| Aluminum ppm | ASTM D5185m >10 | 1 | --- | --- |
| Lead ppm | ASTM D5185m >10 | 0 | --- | --- |
| Copper ppm | ASTM D5185m >50 | 0 | --- | --- |
| Tin ppm | ASTM D5185m >10 | <1 | --- | --- |
| Vanadium ppm | ASTM D5185m | 0 | --- | --- |
| Cadmium ppm | ASTM D5185m | 0 | --- | --- |

ADDITIVES

| method | limit/base | current | history1 | history2 |
|----------------|-------------|--------------|----------|----------|
| Boron ppm | ASTM D5185m | 0 | --- | --- |
| Barium ppm | ASTM D5185m | 0 | --- | --- |
| Molybdenum ppm | ASTM D5185m | 0 | --- | --- |
| Manganese ppm | ASTM D5185m | 0 | --- | --- |
| Magnesium ppm | ASTM D5185m | <1 | --- | --- |
| Calcium ppm | ASTM D5185m | <1 | --- | --- |
| Phosphorus ppm | ASTM D5185m | 306 | --- | --- |
| Zinc ppm | ASTM D5185m | <1 | --- | --- |
| Sulfur ppm | ASTM D5185m | 97 | --- | --- |

CONTAMINANTS

| method | limit/base | current | history1 | history2 |
|---------------|------------------|--------------|----------|----------|
| Silicon ppm | ASTM D5185m >25 | 0 | --- | --- |
| Sodium ppm | ASTM D5185m | 0 | --- | --- |
| Potassium ppm | ASTM D5185m >20 | <1 | --- | --- |
| Water % | ASTM D6304 >0.05 | 0.017 | --- | --- |
| ppm Water ppm | ASTM D6304 >500 | 177.1 | --- | --- |






FLUID CLEANLINESS

| method | limit/base | current | history1 | history2 |
|-----------------|------------------------|-------------------|----------|----------|
| Particles >4µm | ASTM D7647 | 18816 | --- | --- |
| Particles >6µm | ASTM D7647 >1300 | ▲ 5502 | --- | --- |
| Particles >14µm | ASTM D7647 >80 | ▲ 290 | --- | --- |
| Particles >21µm | ASTM D7647 >20 | ▲ 67 | --- | --- |
| Particles >38µm | ASTM D7647 >4 | 1 | --- | --- |
| Particles >71µm | ASTM D7647 >3 | 0 | --- | --- |
| Oil Cleanliness | ISO 4406 (c) >--/17/13 | ▲ 21/20/15 | --- | --- |

FLUID DEGRADATION

| method | limit/base | current | history1 | history2 |
|---------------------------|------------|-------------|----------|----------|
| Acid Number (AN) mg KOH/g | ASTM D8045 | 0.50 | --- | --- |

OIL ANALYSIS REPORT

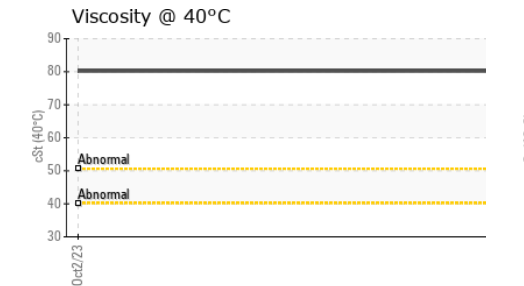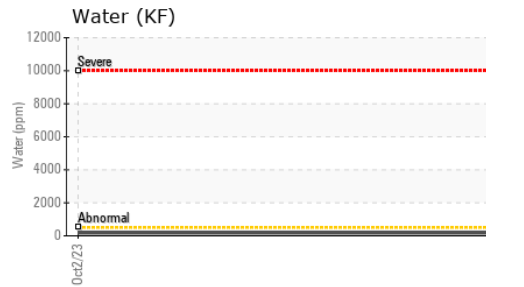
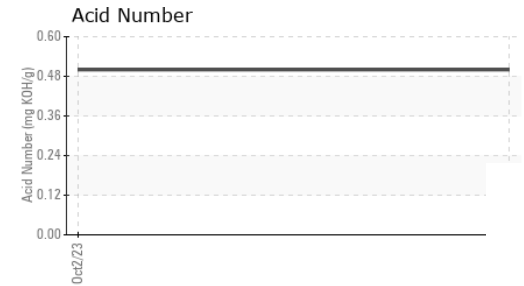
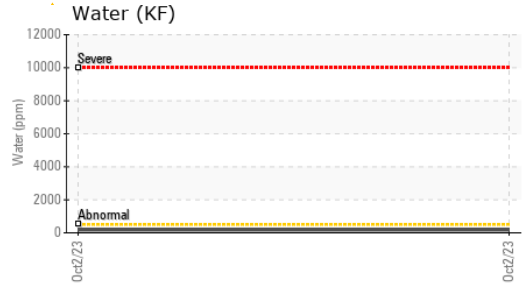
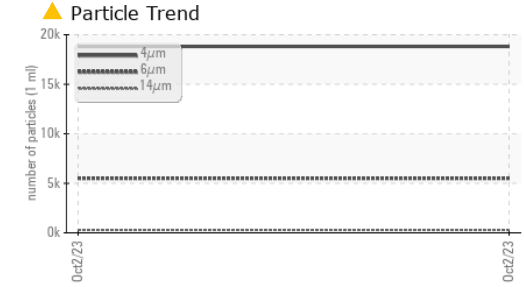


| VISUAL | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal | scalar | *Visual | NONE | NONE | --- |
| Yellow Metal | scalar | *Visual | NONE | NONE | --- |
| Precipitate | scalar | *Visual | NONE | NONE | --- |
| Silt | scalar | *Visual | NONE | LIGHT | --- |
| Debris | scalar | *Visual | NONE | NONE | --- |
| Sand/Dirt | scalar | *Visual | NONE | NONE | --- |
| Appearance | scalar | *Visual | NORML | NORML | --- |
| Odor | scalar | *Visual | NORML | NORML | --- |
| Emulsified Water | scalar | *Visual | >0.05 | NEG | --- |
| Free Water | scalar | *Visual | | NEG | --- |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| Visc @ 40°C | cSt | ASTM D445 | 80.2 | --- | --- |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
| Color | | | | no image | no image |
| Bottom | | | | no image | no image |

GRAPHS

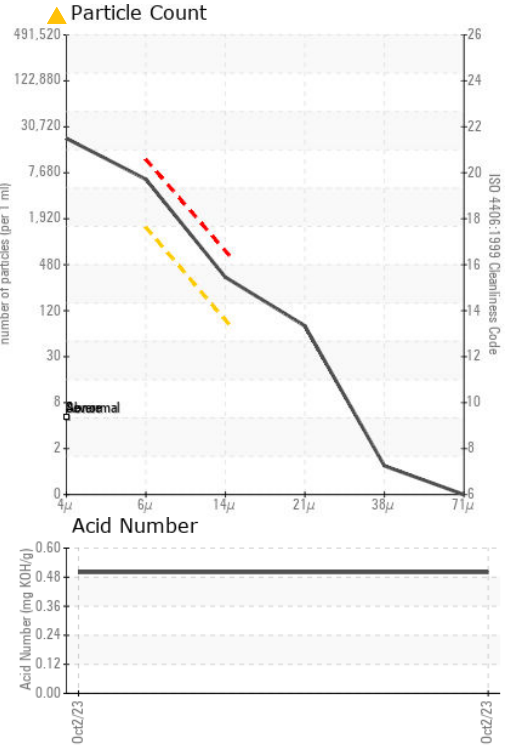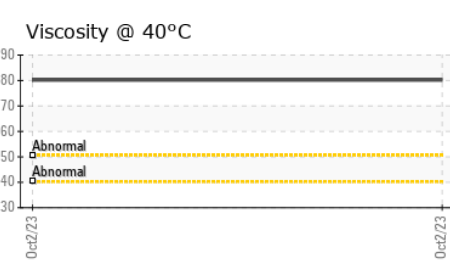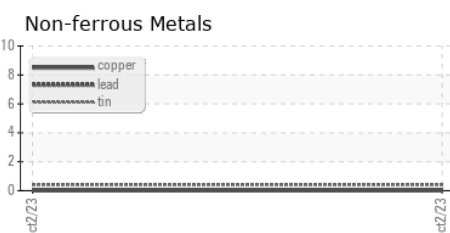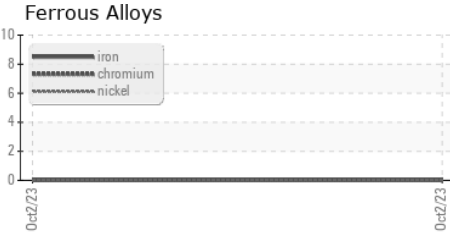

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCP48100 **Received** : 02 Oct 2023
Lab Number : 05967079 **Diagnosed** : 04 Oct 2023
Unique Number : 10673630 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

PLAINS END
 8950 HWY 93
 ARVADA, CO
 US 80007
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: