




# PROBLEM SUMMARY

Sample Rating Trend

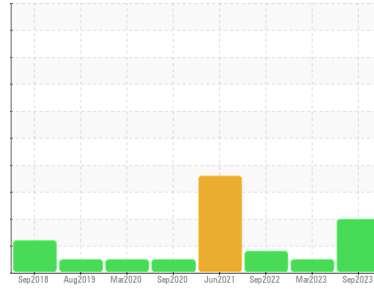


**WATER**



Machine Id  
**KAESER SFC 55 6059343 (S/N 1106)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) FG-460 (--- GAL)**

## COMPONENT CONDITION SUMMARY

▲ Water (KF)

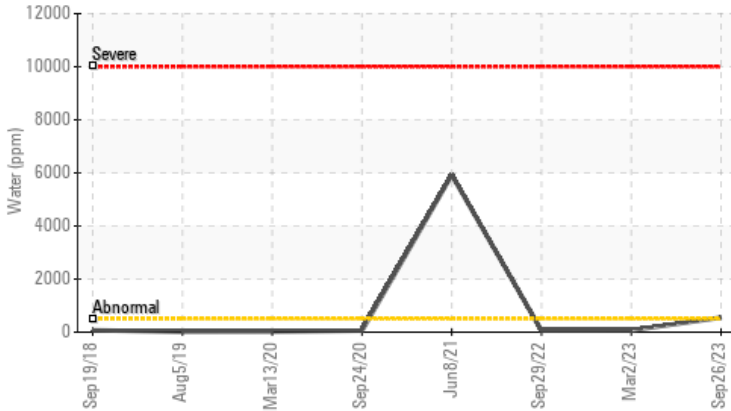

## RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

## PROBLEMATIC TEST RESULTS

Sample Status				<b>ABNORMAL</b>	NORMAL	ATTENTION
Water	%	ASTM D6304	>0.05	▲ <b>0.055</b>	0.006	0.005
ppm Water	ppm	ASTM D6304	>500	▲ <b>550</b>	69.5	58.3
Debris	scalar	*Visual	NONE	▲ <b>HEAVY</b>	NONE	NONE

Customer Id: CAMSHA  
 Sample No.: KCPA003624  
 Lab Number: 05967086  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Don Baldrige +1  
[don.b505@comcast.net](mailto:don.b505@comcast.net)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Alert	---	---	?	We were unable to perform a particle count due to a high concentration of particles present in this sample.

## HISTORICAL DIAGNOSIS

### 02 Mar 2023 Diag: Don Baldrige

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service. The condition of the oil is acceptable for the time in service.

view report



### 29 Sep 2022 Diag: Doug Bogart

ISO



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 08 Jun 2021 Diag: Don Baldrige

WATER



Oil and filter change at the time of sampling has been noted. We recommend an early resample in 500 hours to monitor this condition. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. There is a trace of moisture present in the oil. Free water present. The AN level is acceptable for this fluid.


view report





# OIL ANALYSIS REPORT

Sample Rating Trend

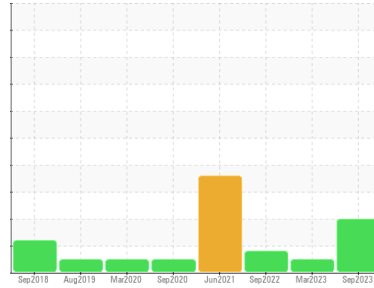

**WATER**



Machine Id  
**KAESER SFC 55 6059343 (S/N 1106)**

Component  
**Compressor**  
Fluid  
**KAESER SIGMA (OEM) FG-460 (--- GAL)**

## DIAGNOSIS

### ▲ Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

### Wear

All component wear rates are normal.

### ▲ Contamination

High concentration of visible dirt/debris present in the oil. There is a trace of moisture present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>KCPA003624</b>	KC94535	KC106961
Sample Date	Client Info	<b>26 Sep 2023</b>	02 Mar 2023	29 Sep 2022
Machine Age	hrs	<b>37979</b>	34663	31326
Oil Age	hrs	<b>0</b>	3337	2626
Oil Changed	Client Info	<b>N/A</b>	Changed	Changed
Sample Status		<b>ABNORMAL</b>	NORMAL	ATTENTION

## WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	<b>4</b>	4	0
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>6</b>	11	1
Lead	ppm	ASTM D5185m >10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >50	<b>1</b>	1	0
Tin	ppm	ASTM D5185m >10	<b>0</b>	<1	0
Antimony	ppm	ASTM D5185m	<b>---</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	<1	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0
Calcium	ppm	ASTM D5185m	<b>0</b>	<1	0
Phosphorus	ppm	ASTM D5185m 500	<b>33</b>	133	6
Zinc	ppm	ASTM D5185m	<b>4</b>	37	0
Sulfur	ppm	ASTM D5185m	<b>1262</b>	1223	1033

## CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	<b>0</b>	0	0
Sodium	ppm	ASTM D5185m	<b>0</b>	<1	2
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	<1	<1
Water	%	ASTM D6304 >0.05	<b>▲ 0.055</b>	0.006	0.005
ppm Water	ppm	ASTM D6304 >500	<b>▲ 550</b>	69.5	58.3




## FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	<b>---</b>	5498	7839
Particles >6µm	ASTM D7647 >1300	<b>---</b>	877	▲ 1388
Particles >14µm	ASTM D7647 >80	<b>---</b>	29	77
Particles >21µm	ASTM D7647 >20	<b>---</b>	6	21
Particles >38µm	ASTM D7647 >4	<b>---</b>	0	1
Particles >71µm	ASTM D7647 >3	<b>---</b>	0	0
Oil Cleanliness	ISO 4406 (c) >--/17/13	<b>---</b>	20/17/12	▲ 20/18/13

## FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 1.5	<b>0.39</b>	0.62	0.38


# OIL ANALYSIS REPORT

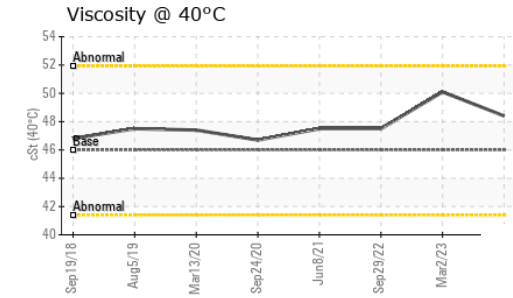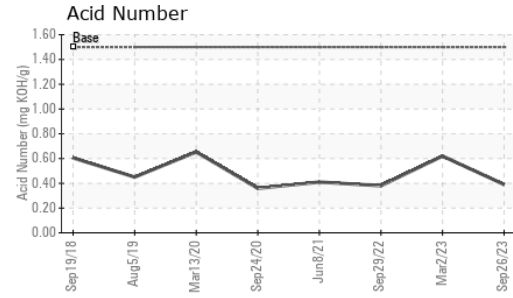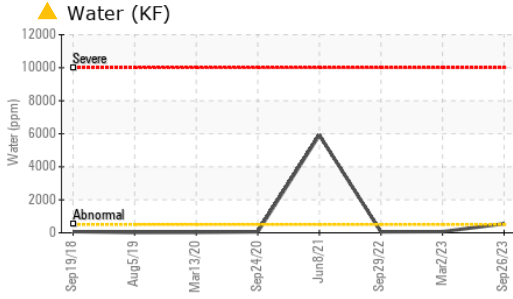





PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	0.2%	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	48.4	50.1	47.5

**SAMPLE IMAGES**

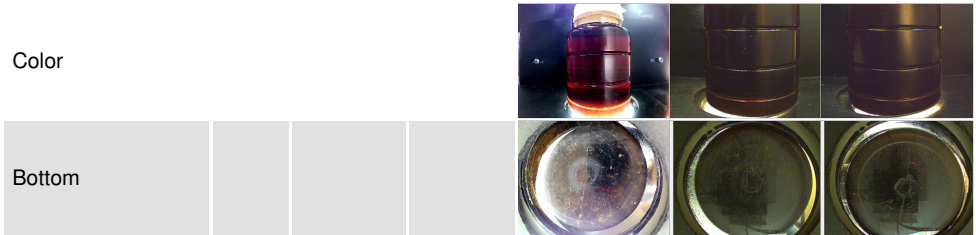

**GRAPHS**

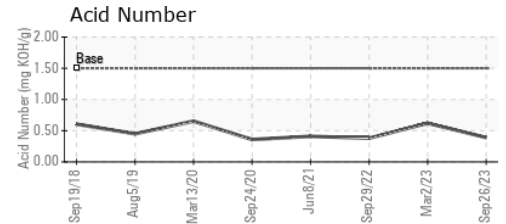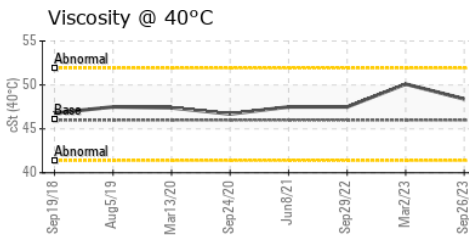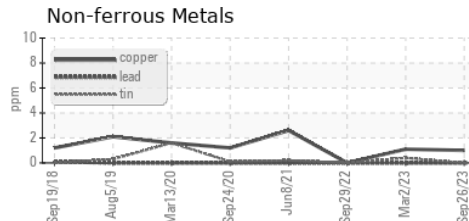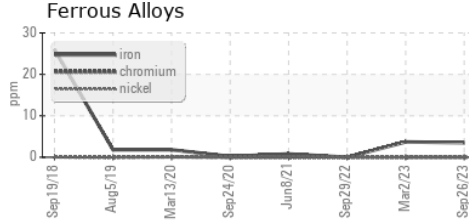

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA003624 **Received** : 02 Oct 2023  
**Lab Number** : 05967086 **Diagnosed** : 04 Oct 2023  
**Unique Number** : 10673637 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**CAMERONS SPECIALTY COFFEE**  
 5700 12TH AVE E  
 SHAKOPEE, MN  
 US 55379  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: