


PROBLEM SUMMARY

Sample Rating Trend

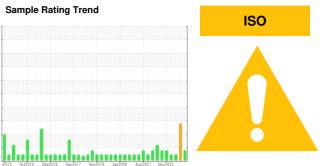


FRICK TYSSED FP 5 (S/N TDSL283XL0159JJ)

Refrigeration Compressor

USPI ALT-68 SC (--- GAL)

COMPONENT CONDITION SUMMARY

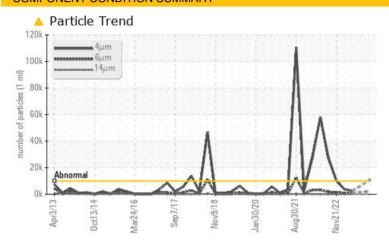

RECOMMENDATION

Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS										
Sample Status			ATTENTION	ABNORMAL	NORMAL					
Particles >4µm	ASTM D7647	>10000	<u> </u>		2491					
Oil Cleanliness	ISO 4406 (c)	>20/18/15	21/18/13		18/17/12					

Customer Id: TYSSED Sample No.: USP0001740 Lab Number: 05967123 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Doug Bogart +1 (800)237-1369 x4016 dougb@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

12 Jul 2023 Diag: Doug Bogart

WATER



We recommend you service the filters on this component. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. Appearance is hazy. Moderate concentration of visible dirt/debris present in the oil. There is a light concentration of water present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



03 May 2023 Diag: Doug Bogart

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



12 Feb 2023 Diag: Doug Bogart

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

FRICK TYSSED FP 5 (S/N TDSL283XL0159JJ)

Component

Refrigeration Compressor

USPI ALT-68 SC (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 6 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

2813 Oct014 Mar2016 Sep2817 Nov2018 Jan2020 Aug2021 Nov2022								
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2		
Sample Number		Client Info		USP0001740	USP255302	USP248019		
Sample Date		Client Info		27 Sep 2023	12 Jul 2023	03 May 2023		
Machine Age	hrs	Client Info		0	0	0		
Oil Age	hrs	Client Info		0	0	0		
Oil Changed		Client Info		N/A	N/A	N/A		
Sample Status				ATTENTION	ABNORMAL	NORMAL		
WEAR METALS		method	limit/base	current	history1	history2		
Iron	ppm	ASTM D5185m	>8	<1	<1	<1		
Chromium	ppm	ASTM D5185m	>2	0	0	0		
Nickel	ppm	ASTM D5185m		0	0	0		
Titanium	ppm	ASTM D5185m		0	<1	0		
Silver	ppm	ASTM D5185m	>2	0	0	0		
Aluminum	ppm	ASTM D5185m	>3	<1	<1	0		
Lead	ppm	ASTM D5185m	>2	0	0	0		
Copper	ppm	ASTM D5185m	>8	0	0	0		
Tin	ppm	ASTM D5185m	>4	0	0	0		
Vanadium	ppm	ASTM D5185m		0	<1	0		
Cadmium	ppm	ASTM D5185m		0	0	0		
ADDITIVES		method	limit/base	current	history1	history2		
Boron	ppm	ASTM D5185m		0	0	0		
Barium	ppm	ASTM D5185m		0	0	0		
Molybdenum	ppm	ASTM D5185m		0	0	0		
Manganese	ppm	ASTM D5185m		0	0	0		
Magnesium	ppm	ASTM D5185m		<1	0	<1		
Calcium	ppm	ASTM D5185m		0	0	0		
Phosphorus	ppm	ASTM D5185m		0	<1	1		
Zinc	ppm	ASTM D5185m		0	0	0		
Sulfur	ppm	ASTM D5185m	50	0	0	12		
CONTAMINANTS		method	limit/base	current	history1	history2		
Silicon	ppm	ASTM D5185m	>15	2	1	2		
Sodium	ppm	ASTM D5185m		0	<1	0		
Potassium	ppm	ASTM D5185m	>20	<1	3	0		
Water	%	ASTM D6304	>0.01	0.002	▲ 0.069	0.003		
ppm Water	ppm	ASTM D6304	>100	21.0	△ 690.6	39.1		
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2		
Particles >4µm		ASTM D7647	>10000	<u> </u>		2491		
Particles >6µm		ASTM D7647	>2500	2204		679		
Particles >14μm		ASTM D7647	>320	57		34		
Particles >21µm		ASTM D7647	>80	11		4		
Particles >38μm		ASTM D7647	>20	1		0		
Particles >71µm		ASTM D7647	>4	1		0		
Oil Cleanliness		ISO 4406 (c)	>20/18/15	<u> </u>		18/17/12		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2		
Acid Number (AN)	mg KOH/g	ASTM D974	0.005	0.013	0.014	0.014		



OIL ANALYSIS REPORT







Certificate L2367

Sample No. Lab Number **Unique Number**

Test Package

: 05967123

: IND 2

: USP0001740 : 10673674

: 02 Oct 2023 Received Diagnosed Diagnostician

: 03 Oct 2023 : Doug Bogart

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) 19578 WHITFIELD RD SEDALIA, MO US 65301

Contact: BONNIE

bonnie.weathers@tyson.com

T: F:

Report Id: TYSSED [WUSCAR] 05967123 (Generated: 10/05/2023 03:57:57) Rev: 1

Contact/Location: BONNIE ? - TYSSED